

COMMERCIAL ELECTRIC WATER HEATERS



500 Tennessee Waltz Parkway
Ashland City, TN 37015

MODELS CSB-52/80/120 (SERIES 100)

Saudi Arabia and Kuwait Manual

INSTALLATION - SERVICE - MAINTENANCE
- OPERATION - LIMITED WARRANTY



Thank you for buying this energy efficient water heater.
We appreciate your confidence in our products.



⚠ WARNING

Read and understand this instruction manual and the safety messages herein before installing, operating, or servicing this water heater.

Failure to follow these instructions and safety messages could result in death or serious injury.

This manual must remain with the water heater.

⚠ WARNING

If the heater becomes immersed in water up to or above the level of the bottom of the element doors, the heater should be examined by a qualified service agency before it is placed in operation, see Page 2.

PLACE THESE INSTRUCTIONS ADJACENT TO HEATER AND NOTIFY OWNER TO KEEP FOR FUTURE REFERENCE.

SAFE INSTALLATION, USE, AND SERVICE

The proper installation, use and servicing of this water heater is extremely important to your safety and the safety of others.

Many safety-related messages and instructions have been provided in this manual and on your own water heater to warn you and others of a potential injury hazard. Read and obey all safety messages and instructions throughout this manual. It is very important that the meaning of each safety message is understood by you and others who install, use, or service this water heater.

	This is the safety alert symbol. It is used to alert you to potential personal injury hazards. Obey all safety messages that follow this symbol to avoid possible injury or death.
 DANGER	DANGER indicates an imminently hazardous situation which, if not avoided, will result in death or injury.
 WARNING	WARNING indicates a potentially hazardous situation which, if not avoided, could result in death or injury.
 CAUTION	CAUTION indicates a potentially hazardous situation which, if not avoided, could result in minor or moderate injury.
CAUTION	CAUTION used without the safety alert symbol indicates a potentially hazardous situation which, if not avoided, could result in property damage.

All safety messages will generally tell you about the type of hazard, what can happen if you do not follow the safety message, and how to avoid the risk of injury.

IMPORTANT DEFINITIONS

- **Qualified Installer or Service Agency:**
Installation and service of this water heater requires ability equivalent to that of a Qualified Agency (as defined by ANSI below) in the field involved. Installation skills such as plumbing, electrical supply are required in addition to electrical testing skills when performing service.
- **ANSI Z223.1 2006 Sec. 3.3.83:**
“Qualified Agency” - “Any individual, firm, corporation or company that either in person or through a representative is engaged in and is responsible for (a) the installation, testing or replacement of gas piping or (b) the connection, installation, testing, repair or servicing of appliances and equipment; that is experienced in such work; that is familiar with all precautions required; and that has complied with all the requirements of the authority having jurisdiction.”

 WARNING
Risk of Electrical Shock
• Installation and Service, including Maintenance, shall be conducted by a Qualified Installer or Service Agency only.

GENERAL SAFETY INFORMATION

PRECAUTIONS

DO NOT USE THIS APPLIANCE IF ANY PART HAS BEEN UNDER WATER. Immediately call a qualified service technician to inspect the appliance and to replace any part of the control system which has been under water.

If the unit is exposed to the following, do not operate the heater until all corrective steps have been made by a qualified service agency.

1.) External fire 2.) Damage. 3.) Firing without water.

This appliance is not to be used by children or persons with reduced physical, sensory or mental capabilities, or lack of experience and knowledge, unless they have been given supervision or instruction concerning use of the appliance by a person responsible for their safety.


Children should be supervised to insure they do not play with the appliance.

GROUNDING INSTRUCTIONS

This water heater must be grounded in accordance with the National Electrical Code and/or Local/National Code. These must be followed in all cases. Failure to ground this water heater properly may also cause erratic control system operation on ELECTRONIC CONTROL models.

This water heater must be connected to a grounded metal, permanent wiring system; or an equipment grounding conductor must be run with the circuit conductors and connected to the equipment grounding terminal or lead on the water heater.

HYDROGEN GAS (FLAMMABLE)

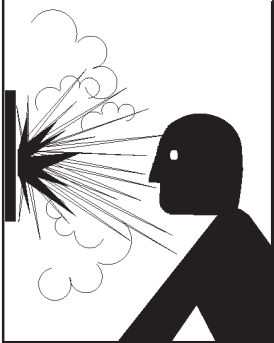

⚠ WARNING

Explosion Hazard

- Flammable hydrogen gases may be present.
- Keep all ignition sources away from faucet when turning on hot water.

Hydrogen gas can be produced in a hot water system served by this heater that has not been used for a long period of time (generally two weeks or more). Hydrogen gas is extremely flammable. To reduce the risk of injury under these conditions, it is recommended that the hot water faucet be opened for several minutes at the kitchen sink before using any electrical appliance connected to the hot water system. If hydrogen is present there will probably be an unusual sound such as air escaping through the pipe as the water begins to flow. THERE SHOULD BE NO SMOKING OR OPEN FLAME NEAR THE FAUCET AT THE TIME IT IS OPEN.



⚠ WARNING

Read and understand this instruction manual and the safety messages herein before installing, operating, or servicing this water heater.

Failure to follow these instructions and safety messages could result in death or serious injury.

This manual must remain with the water heater.


CAUTION

Improper Installation, use and service may result in property damage.

- Do not operate water heater if flood damaged.
- Inspect anode rods regularly, replace when significantly depleted.
- Install in location with drainage.
- Fill tank with water before operation.
- Properly sized thermal expansion tanks are required on all closed water systems.

Refer to this manual for installation and service.

⚠ DANGER




Water temperature over 125°F (52°C) can cause severe burns resulting in severe injury or death.

Children, the elderly, and the physically or mentally disabled are at highest risk for scald injury.

Feel water before bathing or showering.

Temperature limiting valves are available.

Read instruction manual for safe temperature setting.

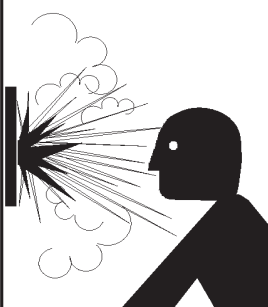

⚠ WARNING

Explosion Hazard

- Overheated water can cause water tank explosion.
- Properly sized temperature and pressure relief valve must be installed in opening provided.

TABLE OF CONTENTS

SAFE INSTALLATION, USE, AND SERVICE	2	ELECTRICAL	21
Important Definitions	2	Amperage Table/Overcurrent Protection	22
GENERAL SAFETY INFORMATION	2	Heater Circuits - Electronic Control Models	22
Precautions	2	Control Circuit - Electronic Control Models	22
Hydrogen Gas (Flammable)	3	WIRING DIAGRAMS	23
INTRODUCTION	4	OPERATION	32
Preparing for the Installation	4	General	32
DIMENSIONS AND CAPACITIES DATA	5	Filling the Water Heater	32
MODEL AND RATING	6	Initial Start Up	32
LOCATING THE NEW WATER HEATER	7	Draining the Water Heater	32
Facts to Consider About the Location	7	TEMPERATURE REGULATION	33
USER CARE	7	High Temperature Limit Controls (ECO)	33
Draining the Water Heater	7	Thermostat Controls	33
Filling the Water Heater	7	Thermostat Settings - Surface Mount Control	33
USER'S INFORMATION	8	MAINTENANCE	34
ELECTRONIC CONTROL MODELS OPERATION	8-18	General	34
INSTALLATION	19	Anode Inspection and Replacement	34
Required Ability	19	Flushing	34
General	19	Sediment Removal	34
Contaminated Water	19	Lime Scale Removal	34
Circulating Pump	19	TROUBLESHOOTING CHECKLIST	35
Insulation Blankets	19	Checklist	35
Temperature-Pressure Relief Valve	19	Leakage Checkpoints	36
Water Line Connections	20	FEATURES AND COMPONENTS	37
Closed Water Systems	20	PIPING DIAGRAMS	39
Thermal Expansion	20	NOTES	48

Note:

USER/OWNER (BOLD TEXT)

QUALIFIED INSTALLER/SERVICE AGENCY ONLY (STANDARD TEXT).

INTRODUCTION

Thank You for purchasing this water heater. Properly installed and maintained, it should give you years of trouble free service. Installation and service of this water heater requires ability equivalent to that of a licensed tradesman or qualified agency (page 2) in the field involved. Plumbing and electrical work are required.

Abbreviations Found In This Instruction Manual:

- ANSI - American National Standards Institute
- ASME - American Society of Mechanical Engineers
- GAMA - Gas Appliance Manufacturer's Association
- NEC - National Electrical Code
- NFPA - National Fire Protection Association
- UL - Underwriters Laboratory

PREPARING FOR THE INSTALLATION

1. Read the "General Safety Information" section of this manual first and then the entire manual carefully. If you don't follow the safety rules, the water heater may not operate safely. It could cause DEATH, SERIOUS BODILY INJURY AND/OR PROPERTY DAMAGE.

This manual contains instructions for the installation, operation, and maintenance of the electric water heater. It also contains warnings throughout the manual that you must read and be aware of. All warnings and all instructions are essential to the proper operation of the water heater and your safety. READ THE ENTIRE MANUAL BEFORE ATTEMPTING TO INSTALL OR OPERATE THE WATER HEATER.

Detailed installation diagrams are provided for the Qualified

Installer in this manual. These diagrams will serve to provide the installer with a reference for the materials and method of piping suggested. IT IS NECESSARY THAT ALL WATER PIPING AND THE ELECTRICAL WIRING BE INSTALLED AND CONNECTED AS SHOWN IN THE DIAGRAMS.


The model and rating plate on page 6 contain markings into useful information. These references should be used to identify the heater.

2. The installation must conform with these instructions and the Local/National code authority having jurisdiction and the requirements of the power company. In the absence of Local/National codes, the installation must comply with the latest editions of the National Electrical Code, NFPA 70 or the Canadian Electrical Code CSA C22.1. The National Electrical Code may be ordered from: National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02269. The Canadian Electrical Code is available from the Canadian Standards Association, 8501 East Pleasant Valley Road, Cleveland, OH 44131.
3. If after reading this manual you have any questions or do not understand any portion of the instructions, call the toll free number listed on the back cover of this manual for technical assistance.

A sample rating plate is shown on page 6 of this manual. In order to expedite your request, please have full model and serial number available for the technician.

4. Carefully plan your intended placement of the water heater. Examine the location to ensure the water heater complies with the "Locating the New Water Heater" section in this manual.

DIMENSIONS AND CAPACITIES DATA

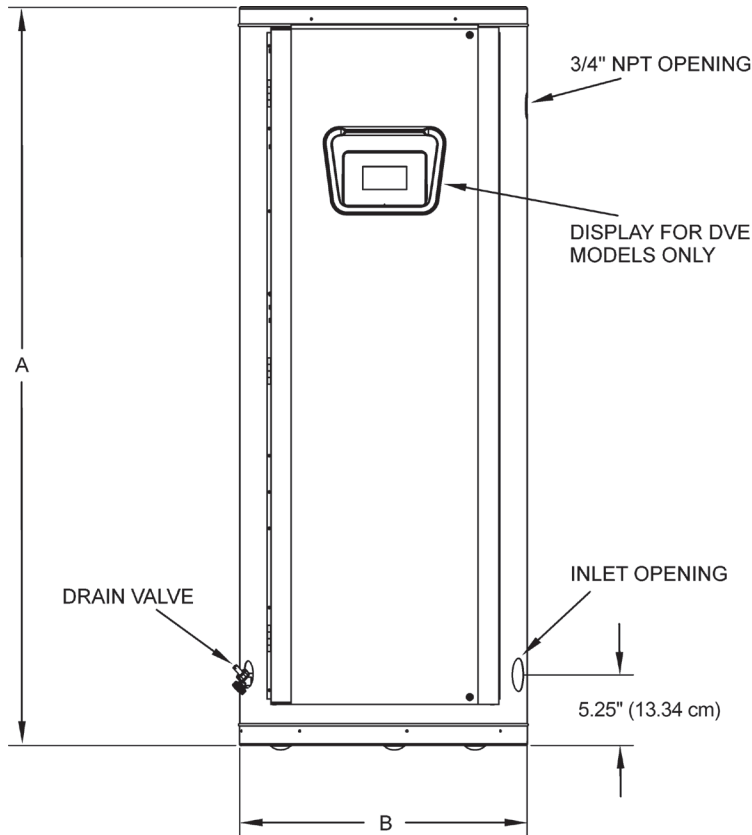

DRE/DVE MODEL DIFFERENCES

This Instruction Manual covers two models of commercial electric water heaters; CSBS models and CSBI models. These two models are equipped from the factory with different controls.

CSBS models are factory equipped with surface mounted thermostat/ECO combination controls. CSBI models are factory equipped with an electronic control system.

In this Instruction Manual "CSBS" models are referred to as: "Surface Mount Control" models.

In this Instruction Manual "CSBI" models are referred to as: "Electronic Control" models.

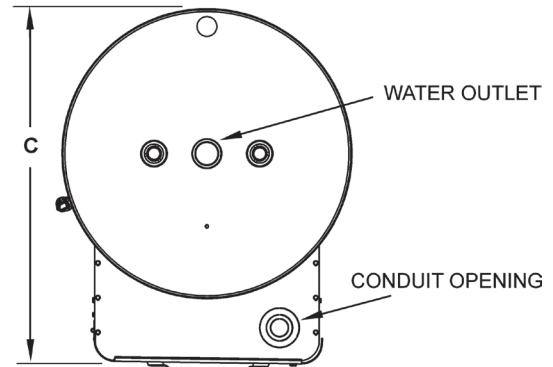


FIGURE 1.

TABLE 1.

Tank Capacity in Gallons (Liters)	Max. Working Pressure in PSI (kPa)	A - Inches (mm)	B - Inches (mm)	C - Inches (mm)	Inlet/Outlet
50 (189.3)	150 (1034.2)	55 3/4 (1416)	21 3/4 (552)	27 (685)	1 1/4 NPT
80 (302.8)	150 (1034.2)	60 1/4 (1350)	25 1/2 (648)	31 (787)	1 1/4 NPT
119 (450.5)	150 (1034.2)	62 1/4 (1581)	29 1/2 (749)	35 (889)	1 1/4 NPT

TABLE 2. RECOVERY CAPACITIES

Standard kW Input	Input BTUH	U. S. Gallons/Hr. and Liters/Hr. at TEMPERATURE RISE INDICATED													
		DegF	30°	40°	50°	60°	70°	80°	90°	100°	110°	120°	130°	140°	
		DegC	17°	22°	28°	33°	39°	44°	50°	56°	61°	67°	72°	78°	
6	20,478	Gallon	82	62	49	41	35	31	27	25	22	21	19	18	
		Liter	310	235	185	155	132	117	102	95	83	79	72	68	
9	30,717	Gallon	123	92	74	62	53	46	41	37	34	31	28	26	
		Liter	466	348	280	235	201	174	155	140	129	117	106	98	
12	40,956	Gallon	164	123	98	82	70	61	55	49	45	41	38	35	
		Liter	621	466	371	310	265	231	208	185	170	155	144	132	
13.5	46,075	Gallon	184	138	111	92	79	69	62	55	50	46	43	40	
		Liter	696	522	420	348	299	261	235	208	189	174	163	151	
15	51,195	Gallon	205	154	123	102	88	77	68	61	56	51	47	44	
		Liter	776	583	466	386	333	291	257	231	212	193	178	167	
18	61,434	Gallon	246	184	148	123	105	92	82	74	67	61	57	53	
		Liter	931	696	560	466	397	348	310	280	254	231	216	201	
24	81,912	Gallon	328	246	197	164	140	123	109	98	89	82	76	70	
		Liter	1241	931	746	621	530	466	413	371	337	310	288	265	
27	92,151	Gallon	369	276	221	184	158	138	123	111	101	92	85	79	
		Liter	1397	1045	836	696	598	522	466	420	382	348	322	299	
30	102,390	Gallon	410	307	246	205	176	154	137	123	112	102	95	88	
		Liter	1552	1162	931	776	666	583	519	466	424	386	360	333	
36	122,868	Gallon	492	369	295	246	211	184	164	148	134	123	113	105	
		Liter	1862	1397	1117	931	799	696	621	560	507	466	428	397	
40.5	138,226	Gallon	554	418	3332	277	237	208	1185	166	151	138	128	119	
		Liter	2097	1582	12612	1048	897	787	4485	628	572	522	484	450	
45	153,585	Gallon	615	461	369	307	263	230	205	184	168	154	142	132	
		Liter	2328	1745	1397	1162	995	871	776	696	636	583	537	500	
54	184,302	Gallon	738	553	443	369	316	277	246	221	201	184	170	158	
		Liter	2793	2093	1677	1397	1196	1048	931	836	761	696	643	598	

MODEL AND RATING

COMMERCIAL STORAGE TANK WATER HEATER IPX1							
MODEL NUMBER		SERIAL NUMBER		ITEM ID / PART NUMBER			
XXXXXXXXXX		1116M000575		XXXXXXXXXX			
Ph (PHASE)	V (VOLTS)	Hz (HERTZ)	No. of ELEMENTS	W (WATTS) EACH TOTAL		MAXIMUM WORKING PRESSURE PSI kPa	
3	220-240	50-60	6	6000	36000	150	1034
CAPACITY							
US GAL		I (LITERS)					
119.0		450.5					

FIGURE 2.

LOCATING THE NEW WATER HEATER

FACTS TO CONSIDER ABOUT THE LOCATION

CAUTION

Property Damage Hazard

- All water heaters eventually leak
- Do not install without adequate drainage.

Carefully choose a location for the new water heater. The placement is a very important consideration for the safety of the occupants in the building and for the most economical use of the appliance.

Whether replacing an old water heater or putting the water heater in a new location, the following critical points must be observed. The water heater must be located:

1. On a level surface. The Qualified Installer may shim the channel type skid base as necessary if levelling is required.
2. Near a floor drain. The heater should be located in an area where leakage of the tank or connections will not result in damage to the area adjacent to the heater or to lower floors of the structure.
3. Close to the point of major hot water usage and the power supply.

Hot water piping and branch circuit wiring should be as short as possible.

Insulate hot and cold water piping where heat loss and condensation may be a problem.

Heater construction permits installation, maintenance, and service work to be performed through the front control panel.

Suggested clearances from adjacent surfaces are 12" (30 cm) on top, 30" (76 cm) in front for access to the unit.

The heater may be installed on or against combustible surfaces. The left side and back may be placed flush against adjacent surfaces.

The temperature of the space in which the water heater is installed must not go below 32°F (0°C) or above 122°F (50°C).

USER CARE

Water may drip from the discharge pipe of the pressure relief device and this pipe must be left open to the atmosphere.

The pressure relief device must be operated at least once a year to insure proper operation, verify that it is not blocked and to remove lime deposits. This is to be done by a Qualified Service Agent as a part of the regular maintenance.


DRAINING THE WATER HEATER

The water heater must be drained if it is to be shut down and exposed to freezing temperatures. Maintenance and service procedures may also require draining the heater.

1. Turn off the electrical disconnect switch.
2. Close the supply water inlet valve to heater.
3. Attach hose to outlet opening of drain valve and direct end to drain.
4. Open a nearby hot water faucet and the heater drain valve.
5. If the heater is being drained for an extended shutdown, it is suggested the drain valve be left open during this period. The hose may be removed.

Follow FILLING instructions when restoring hot water service.

⚠ DANGER



- Burn hazard
- Hot water discharge.
- Keep clear of relief valve/drain valve discharge outlet.

FILLING THE WATER HEATER

CAUTION

Property Damage Hazard

In order to avoid water heater damage, fill tank with water before operating.

1. Turn off the electrical disconnect switch.
2. Close the water heater drain valve.
3. Open a nearby hot water faucet to permit the air in the system to escape.
4. Fully open the cold water inlet pipe valve allowing the heater and piping to be filled.
5. Close the hot water faucet as water starts to flow. The heater is now ready for STARTUP and TEMPERATURE REGULATION.

USER'S INFORMATION

THERMOSTAT SETTINGS-SURFACE MOUNT CONTROLS

Adjustment of temperature controls on surface mounted controls is to be performed by a qualified service agent at initial start-up.

THERMOSTAT SETTINGS - ELECTRONIC CONTROLS

**DANGER**


Water temperature over 125°F (52°C) can cause severe burns resulting in severe injury or death.

Children, the elderly, and the physically or mentally disabled are at highest risk for scald injury.

Feel water before bathing or showering.

Temperature limiting valves are available.

Read instruction manual for safe temperature setting.



HOT

BURN

These models are equipped with an electronic control system. The control system senses temperature from a factory installed Immersion Temperature Probe. See Figure 3. The "Operating Set Point" is adjusted to control water temperature. This is an adjustable user setting in the control system's "Temperatures Menu." This and all

control system menus are accessed through the UIM (User Interface Module) located on front panel of water heater. See Figure 5.

The Operating Set Point is adjustable from 90°F/42°C to 190°F/88°C. The factory setting is 120°F/49°C. See the Electronic Control Models Operation section of this manual for instructions on how to adjust the Operating Set Point and other user settings.

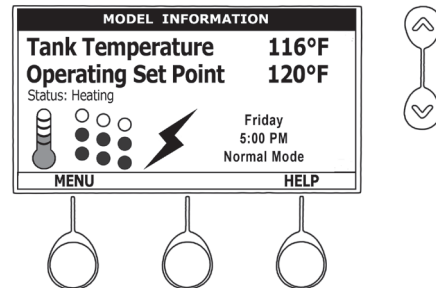


FIGURE 3. UIM (USER INTERFACE MODULE)

Set the Operating Set Point at the lowest setting which produces an acceptable hot water supply. This will always give the most energy efficient operation.

ELECTRONIC CONTROL MODELS OPERATION

CONTROL SYSTEM FEATURES

Advanced Diagnostics: Plain English text and animated icons display detailed operational and diagnostic information. LCD screen on the front of the water heater displays the Sequence of Operation in real time. Fault or Alert messages are displayed when operational problems occur. Advanced Service menu displays a list of possible causes for current Fault and Alert conditions to aid in servicing.

Economy Mode Operation: Control system automatically lowers the Operating Set Point by a programmed value during user defined time periods. Helps reduce operating costs during unoccupied or peak demand periods.

Linear Sequencing: Banks of heating elements (3 elements per bank) are energized according to adjustable (1 to 20°) differential set points for each bank. First bank on is the last bank off. Helps reduce operating costs during low/moderate loads.

CONTROL SYSTEM NAVIGATION

The UIM (User Interface Module) is located on the front cabinet of the Electronic Control Model water heaters. All operational information and user settings are displayed and accessed using the UIM. The UIM includes five snap acting (momentary) user input buttons; an Up, Down and 3 Operational Buttons.

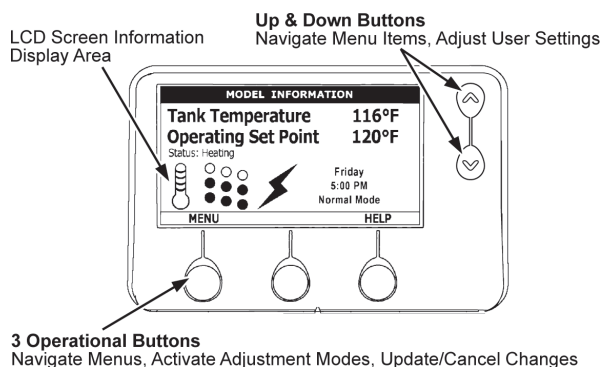


FIGURE 4. UIM - USER INTERFACE MODULE

Up & Down Buttons

Used to navigate (up and down) and to select (highlight) menu items. Also used to adjust or change (increase/decrease, on/off, set time) various user settings.

Operational Buttons

The 3 Operational Buttons are multifunctional. Their current function is defined by the text that appears above each button on the LCD screen. The function will change depending on what menu is currently displayed or what menu item is selected. When no text appears on the LCD screen above an Operational Button there is no function assigned.

THE DESKTOP SCREEN

Figure 5 below shows the control system "Desktop Screen." This is the default screen. If there are no active Fault or Alert conditions and no user input for approximately 10 minutes the control system will return to this screen automatically.

Model Information

Model information and menu titles are shown in the black bar at the top of the Desktop Screen.

Tank Temperature

Current water temperature as sensed from the immersion Temperature Probe.

Operating Set Point: Temperature at which the control system will maintain tank (water) temperature in the Normal Mode. This line of text will read Economy Set Point whenever the control system is operating in the Economy Mode.

Status: The Operating State of the control system is displayed beneath the Operating Set Point.

Service Note: The Desktop Screen displays text and animated icons that convey operational information.

Review the Status Icons explanation in Table 1. Learning to use this real time visual display of the operating sequence will help to quickly and accurately diagnose operational problems.

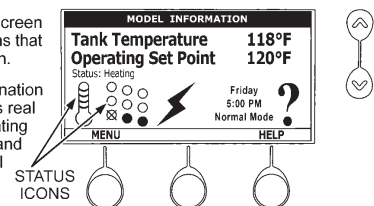


FIGURE 5.

Menu: The left Operational Button is pressed to enter the Main Menu where all control system menus are accessed. See Table 5. - Control System Menus for a list of control system menus.

Help: The right Operational Button is pressed to access instructions and explanations for user settings, Operating States, Status Icons, manufacturer's web address, technical support phone number and service agent contact information.

Day/Time/Operating Mode: The current time and day are also displayed on the Desktop Screen. "Clock Not Set" will be displayed until the time clock has been initially set. Day and Time are adjusted

in the Economy Mode Setup menu. The current Operating Mode, either Normal Mode or Economy Mode, is displayed beneath the day and time.

Discreet Menu Contact Information: From the Desktop Screen press and hold down the middle (unmarked) Operational Button for 30 seconds and then release it. This will launch a discreet menu where personalized contact information can be entered. Installing contractors and/or service agents can enter their company name and telephone number. This contact information will be displayed with all Fault and Alert messages.

TABLE 3. - STATUS ICONS

ICON	DESCRIPTION
	Water temperature in the tank has fallen. Shaded area of the animated thermometer icon will rise and fall in response to water temperature in the storage tank as sensed from the immersion Temperature Probe.
	Water temperature in the tank has reached the Operating Set Point. Shaded area of the animated thermometer icon will rise and fall in response to water temperature in the storage tank as sensed from the immersion Temperature Probe.
	The control is unable to initiate a heating cycle. This will happen whenever a Fault condition is detected by the control system or when either of the two Enable/Disable circuits are open circuits.
	The control system is in Heating Mode and has energized the electromagnetic contactor coils for at least one bank of heating elements. This animated icon DOES NOT indicate current has been sensed from the heating elements, only that there is a call for heat present and the control system has initiated heating operation.
	Heating elements icon for a water heater equipped with 1 Bank of heating elements. Each circle represents one heating element. Each diagonal row of 3 elements = 1 Bank of elements. Open circles represent heating elements the control system has not energized and is not sensing electrical current from.
	Heating elements icon for a water heater equipped with 2 Banks of heating elements. Each circle represents one heating element. Each diagonal row of 3 elements = 1 Bank of elements. Open circles represent heating elements the control system has not energized and is not sensing electrical current from.
	Heating elements icon for a water heater equipped with 3 Banks of heating elements. Each circle represents one heating element. Each diagonal row of 3 elements = 1 Bank of elements. Open circles represent heating elements the control system has not energized and is not sensing electrical current from.
	Heating elements icon for a water heater equipped with 3 Banks of heating elements. Each circle represents one heating element. Each diagonal row of 3 elements = 1 Bank of elements. Filled circles represent heating elements the control system has energized AND is sensing electrical current from.
	Heating elements icon for a water heater equipped with 3 Banks of heating elements. Each circle represents one heating element. Each diagonal row of 3 elements = 1 Bank of elements. Open circles with an X represent heating elements the control system has energized that it IS NOT sensing electrical current from.
	The control has detected/declared a Fault Condition. Fault message details can be viewed in the Current Fault menu. Heating operation is discontinued (locked out) until the condition that caused the fault is corrected. Power to the water heater must be cycled off and on to reset the control system. Note; cycling power will not reset the control system if the condition that caused the fault has not been corrected.
	The control has detected/declared an Alert Condition. The water heater will continue to operate during an Alert Condition but there is an operational condition that requires the attention of a Qualified Service Agent. Alert message details can be viewed in the Current Alert menu.

TABLE 4. - OPERATING STATES

STATE	DESCRIPTION
Standby	The water heater is not in an active heating cycle. This usually indicates the temperature in the tank has reached the Operating Set Point and the control system has terminated the heating cycle.
Heating	The control system is in the Heating Mode. At least one bank of heating elements has been energized.
Alert	The control system has detected/declared an Alert Condition. The controls system will continue heating operation. However, a Qualified Service Agent should be contacted to check/service the water heater.
Fault	The control system has detected/declared a Fault Condition. The control system will discontinue heating operation and "lock out." Power to the water heater must be cycled off and on to reset the control system. Note; cycling power will not reset the control system until the condition that caused the fault has been corrected.

TABLE 5. - CONTROL SYSTEM MENUS

MENUS	DESCRIPTION
Temperatures	Most commonly accessed menu. Operating Set Point, Differential settings, Tank Temperature and Tank Probe Offset are located in this menu.
Heater Status	Current Operating State/Mode (heating/standby etc) and status (open/closed - on/off - yes/no) of monitored water heater functions and components are displayed in this menu.
Economy Mode Setup	Seven day 24 hour time clock with temperature set back capability to reduce operating costs during unoccupied or reduced demand periods.
Alarm Output Setup	The control system's CCB (Central Control Board) features on board SPDT (single pole double throw) relay contacts for building EMS (Energy Management System) notification of operational conditions such as Fault Conditions and heating mode status. This menu features a list of user definable conditions for relay activation.
Display Settings	Temperature units (°F or °C), appearance (brightness contrast) and backlight delay user adjustable settings are located in this menu.
Heater Information	Elapsed time of operation, total heating cycle time, heating cycle count, heating element bank(s) cycle count and heating bank on time along with UIM and CCB software revisions can be viewed in this menu.
Current Fault/Alert	Displays any current Alert or Fault messages.
Fault History	Retains 9 event history of Fault/Alert messages with time stamp. The Fault History is useful when dealing with intermittent operational problems or when the customer has reset the control system prior to a service agent's arrival.
Fault Occurrence	Running total of all Fault and Alert Conditions that have occurred are displayed in this menu. Can help determine potential root cause(s) of related operational problems.
Restore Factory Defaults	This control system feature allows the user to restore control system user settings to their factory default settings. Alarm Output Setup and Display Settings menu items ARE NOT changed when factory defaults are restored.
Help Menu	Accessible by pressing the corresponding Operational Button from most menus and screen displays. This menu provides access to instructions and explanations for user settings, Operating States, Status Icons, manufacturer's web address, technical support phone number and service agent contact information.

TEMPERATURES MENU

Operating Set Point

User adjustable setting 90°F (32.2°C) to 190°F (87.8°C) range; factory default is 120°F (48.9°C). When the water temperature sensed by the control system from the immersion Temperature Probe reaches the Operating Set Point the control system will end the heating cycle. A call for heat will be activated again when the water temperature drops below the Operating Set Point minus the 1st Differential Setting.

Example: Operating Set Point is 120°F (48.9°C), the 1st Differential Setting is 2°F (1.1°C) (factory default). A call for heat will be activated when the sensed water temperature drops to 118°F (47.8°C).

Temperatures	
Operating Set Point	120°F
1st Differential	2°F
2nd Differential	2°F
3rd Differential	2°F
Tank Temperature	105°F
Tank Probe Offset	0°F
CHANGE	BACK HELP

Differential Settings

Adjustable user setting(s) 1°F (0.6°C) to 20°F (11.0°C) range; factory default is 2°F (1.1°C). The water heaters covered in this Instruction Manual will have 3, 6 or 9 heating elements. Each group of 3 heating elements is one "Bank" of heating elements. Heating elements are energized in Banks of 3. Each Bank of heating elements will have a Differential Setting associated with it. Differential Settings are located in the Temperatures Menu.

There is a 1st Differential Setting on all models. There will be one additional Differential Setting visible/adjustable for each additional Bank of (3) heating elements.

Operating Sequence

With an Operating Set Point of 120°F (48.9°C) and all Differential settings at 2°F (1.1°C) the On/Off sequencing of heating element Banks would be as follows:

BANK NUMBER	DIFFERENTIAL SETTING	TURN ON TEMP	TURN OFF TEMP
Bank 1	2°F (1.1°C)	118°F (47.8°C)	120°F (48.9°C)
Bank 2	2°F (1.1°C)	116°F (46.7°C)	118°F (47.8°C)
Bank 3	2°F (1.1°C)	114°F (45.6°C)	116°F (46.7°C)

Tank Temperature

Non adjustable information display. Current water temperature as sensed by the control system from the immersion Temperature Probe.






Tank Probe Offset

User adjustable setting -5°F (-2.8°C) to +5°F (2.8°C) range; factory default is 0°F (0°C). If the current Tank Temperature is sensed (from the immersion Temperature Probe) at 120°F (48.9°C) and the offset is adjusted to -5°F (-2.8°C) the control system would calibrate or "offset" the Tank Temperature to 115°F (46.1°C). Heating cycles would then start/stop based on the calibrated Tank Temperature.

Used to calibrate for slight differences in control system temperature sensing. This can improve the precision of temperature control in the storage tank and at points of use. This feature can also be used to compensate for building recirculation loops (hot water returning to the storage tank) that may cause the heating cycle to terminate prematurely.

TEMPERATURE SETTINGS

The Operating Set Point and the Differential Settings are adjusted in the Temperatures Menu. The following instructions explain how to adjust these user settings and navigate the control system menus.

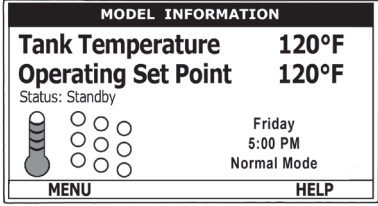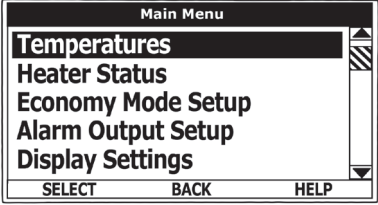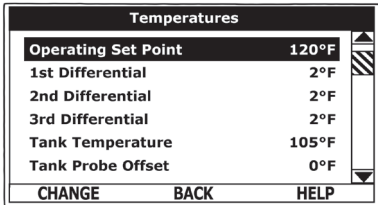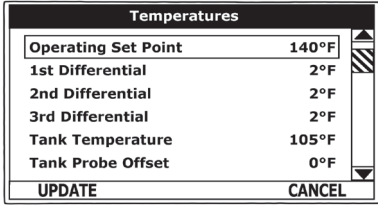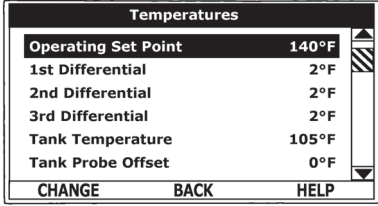ACTION	DISPLAY
From the Desktop Screen, press the Operational Button underneath "MENU" to enter the Main Menu. Notice how the text above the Operational Buttons on the display changes as you navigate through the various menus and screens.	
With Temperatures selected (highlight in black) in the Main Menu, press the Operational Button underneath "SELECT" to enter the Temperatures Menu. If Temperatures is not selected use the Up and Down buttons to select this menu item.	
With the Operating Set Point selected in the Temperatures Menu, press the Operational Button underneath "CHANGE" to activate the adjustment mode for this menu item.	
Press the Up and Down buttons to adjust the Operating Set Point to the desired setting. Press the Operational Button underneath "UPDATE" to confirm the new setting. Press the Operational Button underneath "CANCEL" to discard the new setting and retain the previous setting. The new Operating Set Point value should now be displayed as the current value. NOTE: Use this same procedure to adjust the Differential settings and the Tank Probe Offset in the Temperatures Menu. This same procedure is used to change user settings in other control system menus.	 

HEATER STATUS MENU

This menu displays non adjustable operational information. This menu contains more information that can be displayed on one screen of the LCD display. Use the Up & Down Buttons to navigate to the bottom of this menu.

Top of Menu

Heater Status	
Status	Heating
Element Banks On	1
ECO Contact	Closed
Enable / Disable 1	Closed
Enable / Disable 2	Closed
Element Bank 1 On	Yes
Element Bank 2 On	No
BACK	HELP

Bottom of Menu

Heater Status	
Enable / Disable 1	Closed
Enable / Disable 2	Closed
Element Bank 1 On	Yes
Element Bank 2 On	No
Element Bank 3 On	No
Alarm Condition	No
Alarm Relay Output	Open
BACK	HELP

Status

Displays the current Operating State of the control system. IE: Heating, Standby, Fault see Table 4. - Operating States.

Element Banks On

Displays the current number of heating element Banks the control system has energized. Each Bank of elements contains 3 heating elements.

ECO Contact

Displays the current state of the ECO high temperature limit switch contacts. The ECO switch is located inside the immersion Temperature Probe (two red wires).

Enable / Disable 1 & 2

Displays the current state, open or closed, of the two Enable/Disable circuits (J7 socket on the CCB - see wiring diagrams) provided for external supervisory controls such as building EMS (Energy Management System). Both of these Enable/Disable circuits must be closed to "enable" heating operation. If either Enable/Disable circuit is open for any reason heating operation will be "disabled." There is a plug with two jumper wires installed from the factory in the CCB J7 socket to enable heating operation when external controls are not in use.

Service Note: If a supervisory control(s) is used to enable/disable heating operation, install field wiring between the J7 socket on the CCB and a set of "dry contacts" on the external control per all applicable building codes. This is a switching circuit only: DO NOT apply any external voltage or connect any load (IE: relay coil) to either circuit. This can only be set up by a Qualified Installer or Service Technician.

Element Bank On

Displays the on/off status of each Bank of heating elements. Yes = On, No = Off.

Alarm Condition

Displays the status of the user definable Alarm Output function - see Alarm Output Setup Menu. Yes = alarm condition has been met, No = alarm condition has not been met.

Alarm Relay Output

Displays the state of the normally open contacts of the Alarm Output relay. This relay (J3 contacts on the CCB) is used for building EMS (Energy Management System) notification of operational conditions such as Fault conditions.

ECONOMY MODE SETUP MENU

This menu contains settings used to establish an "Economy Set Point" and "Economy Mode" operating periods. This control system feature can help reduce operating costs during unoccupied, low load, or peak demand periods.

Desktop Screen During Economy Mode

MODEL INFORMATION	
Tank Temperature	120°F
Economy Set Point	100°F
Status: Standby	
	
Friday 5:00 PM Economy Mode	
MENU	HELP

Economy Mode Setup Menu

Economy Mode Setup	
Setpoint Adjustment	20
Current Time	Mon 5:00 PM
Heater In Economy Mode	No
Sun	Economy Mode All Day
Mon	Normal 7:30 AM to 8:00 PM
Tue	Normal All Day
Wed	Normal All Day
CHANGE	BACK
HELP	

Setpoint Adjustment

Adjustable user setting (2°F (1.1°C) to 50°F (27.8°C) - factory default is 20°F (11.0°C) the control system uses to calculate the "Economy Set Point." The Economy Set Point = normal Operating Set Point minus the programmed Setpoint Adjustment value. The Economy Set Point is the water temperature the control system maintains during programmed Economy Mode time periods. "Economy Set Point" is displayed instead of "Operating Set Point" and "Economy Mode" appears beneath the current time on the Desktop Screen during Economy Mode time periods.

Current Time

Seven Day 24 hr clock. Use this menu item to set the current time and day of the week. Current day and time are not set from the factory. "Clock Not Set" will be displayed on the Desktop until the time/day has been initially set.

Heater In Economy Mode

Displays whether the control system is currently operating in Economy Mode or not.

Daily Operating Mode (Sun - Mon - Tue - Wed - Thu - Fri - Sat)

Seven daily sub menus are listed at the bottom of the Economy Mode Setup menu. There are 3 Operating Modes in each sub menu;

“Normal Operation All Day” - “Economy Mode All Day” and “Normal Operation Between.” Only one Operating Mode can be active, the factory default is Normal Operation All Day.






Normal Operation All Day: When this operating mode is active the normal Operating Set Point is used for the entire day.

Economy Mode All Day: When this operating mode is active the Economy Set Point is used for the entire day.

Normal Operation Between: When this operating mode is active there will also be start and stop times to program. The normal Operating Set Point is used between the programmed start and stop times and the Economy Set Point will be in effect during the rest of the day. There is one start time and one stop time event per day.






ECONOMY MODE SETTINGS

Setpoint Adjustment Value

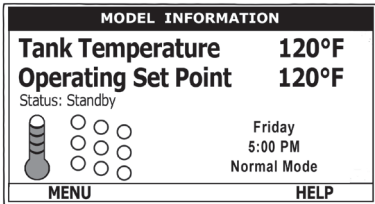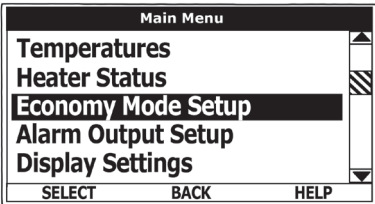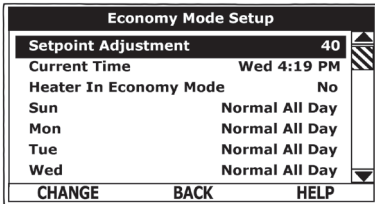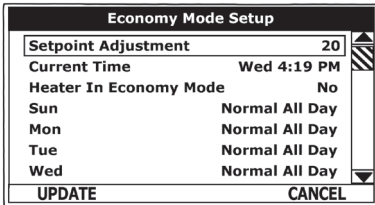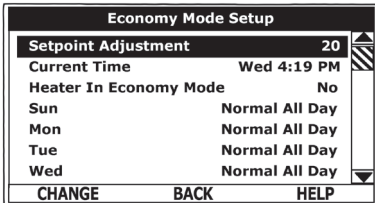ACTION	DISPLAY
From the Desktop Screen, press the Operational Button underneath “MENU” to enter the Main Menu. Notice how the text above the Operational Buttons on the display changes as you navigate through the various menus and screens.	
Use the Up/Down buttons to select (highlight in black) the Economy Mode Setup menu from the Main Menu. Press the Operational Button underneath “SELECT” to enter the Economy Mode Setup menu.	
Use the Up/Down buttons to select (highlight in black) Setpoint Adjustment. Press the Operational Button underneath “CHANGE” to activate the adjustment mode for the Setpoint Adjustment value.	
Use the Up/Down buttons to change the Setpoint Adjustment to the desired value. The Setpoint Adjustment value is adjustable from 2°F (1.1°C) to 50°F (27.8°C). The factory default is 20°F (11.0°C). Notice how the text above the Operational Buttons on the display changes to “UPDATE” & “CANCEL” when the adjustment mode is activated and how the current value is outlined rather than highlighted in black. Press the Operational Button underneath “UPDATE” to enter and confirm the new value. Pressing the Operational Button underneath “CANCEL” would discard the new value and retain the previous value.	
The new Setpoint Adjustment value should now be displayed as the current value.	







ECONOMY MODE SETTINGS

Time Clock Settings

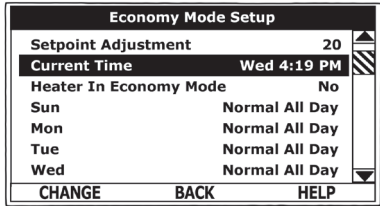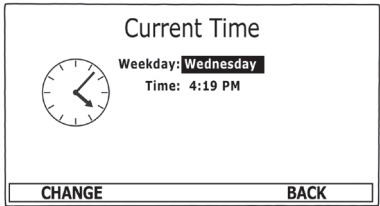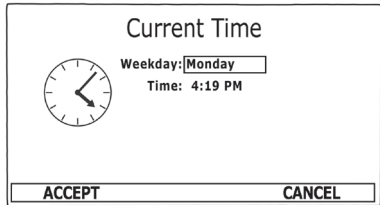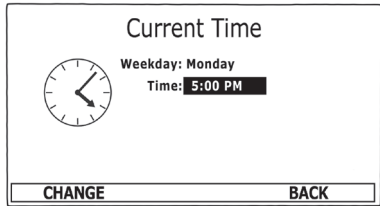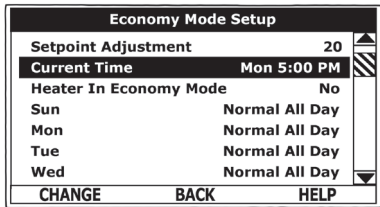ACTION	DISPLAY
From the Desktop Screen navigate to the Economy Mode Setup menu. Use the Up/Down buttons to select (highlight in black) Current Time sub menu. Press the Operational Button underneath "CHANGE" to enter the Current Time sub menu.	 The display shows the 'Economy Mode Setup' menu. The 'Current Time' option is highlighted in black. Below it, the 'Heater In Economy Mode' is set to 'No'. The days of the week (Sun, Mon, Tue, Wed) are listed with 'Normal All Day' settings. At the bottom are three buttons: 'CHANGE', 'BACK', and 'HELP'.
Use the Up/Down buttons to select the "Weekday" setting. Press the Operational Button underneath "CHANGE" to activate the adjustment mode for this setting.	 The display shows the 'Current Time' adjustment screen. It includes a clock icon, the text 'Weekday: Wednesday', and 'Time: 4:19 PM'. At the bottom are two buttons: 'CHANGE' and 'BACK'.
Press the Up and Down buttons to adjust the Weekday setting to the current day. Notice how the text above the Operational Buttons on the display changes to "ACCEPT" & "CANCEL" when the adjustment mode is activated and how the current setting is outlined rather than highlighted in black. Press the Operational Button underneath "ACCEPT" to enter and confirm the new setting. Pressing the Operational Button underneath "CANCEL" would discard the new setting and retain the previous setting.	 The display shows the 'Current Time' adjustment screen. The 'Weekday' is now 'Monday' and is outlined. The 'Time' remains '4:19 PM'. At the bottom are two buttons: 'ACCEPT' and 'CANCEL'.
Use the Up/Down and the CHANGE/ACCEPT Operational Buttons to individually select and change the remaining time settings (Hour, Minutes, AM/PM) to the current time in the same way as outlined above. When finished making changes press the Operational Button underneath "BACK" to confirm all new settings and update the control system. The display will automatically return to the Economy Mode Setup menu.	 The display shows the 'Current Time' adjustment screen. The 'Weekday' is 'Monday' and the 'Time' is now '5:00 PM'. At the bottom are two buttons: 'CHANGE' and 'BACK'.
The new settings should be displayed as the Current Time.	 The display shows the 'Economy Mode Setup' menu. The 'Current Time' is now 'Mon 5:00 PM'. The 'Heater In Economy Mode' is still 'No'. The days of the week (Sun, Mon, Tue, Wed) are listed with 'Normal All Day' settings. At the bottom are three buttons: 'CHANGE', 'BACK', and 'HELP'.

ECONOMY MODE SETTINGS

Daily Operating Mode Settings

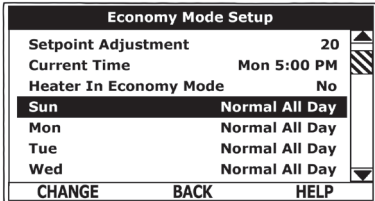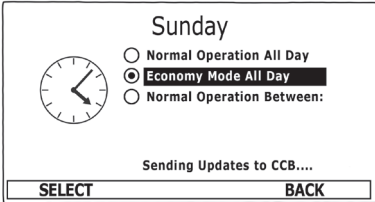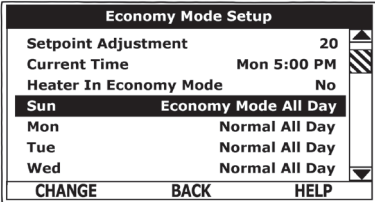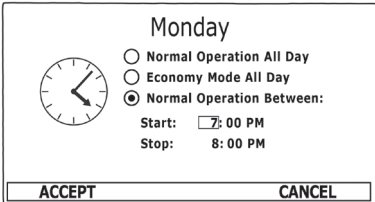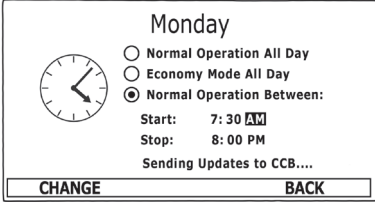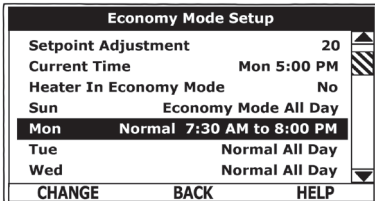ACTION	DISPLAY
<u>Economy Mode All Day:</u> From the Economy Mode Setup menu use the Up/Down buttons to select (highlight in black) the Daily sub menu for "Sun." Press the Operational Button underneath "CHANGE" to enter this menu.	 The display shows the "Economy Mode Setup" menu. The "Sun" option is highlighted in black. The menu includes: Setpoint Adjustment (20), Current Time (Mon 5:00 PM), Heater In Economy Mode (No), and a list of days (Sun, Mon, Tue, Wed) with their respective modes (Normal All Day). At the bottom are buttons for CHANGE, BACK, and HELP.
Use the Up/Down buttons to select (highlight in black) the "Economy Mode All Day" setting. Press the Operational Button underneath "SELECT" to change from the factory default Normal Operation All Day setting to the Economy Mode All Day setting. Press the Operational Button underneath "BACK" to confirm the new setting and update the control system. You will be returned to the Economy Mode Setup menu. The new setting should now be displayed for Sun.	  The first display shows the "Sunday" selection screen with a clock icon and three radio button options: "Normal Operation All Day", "Economy Mode All Day" (selected and highlighted in black), and "Normal Operation Between:". Below the options is the text "Sending Updates to CCB...." and buttons for "SELECT" and "BACK". The second display shows the "Economy Mode Setup" menu with "Sun" highlighted in black, indicating the new setting has been applied.
<u>Normal Operation Between:</u> From the Economy Mode Setup menu Use the Up/Down and CHANGE buttons to enter the Mon sub menu. Use the Up/Down buttons to select (highlight in black) the "Normal Operation Between" setting. Press the Operational Button underneath "SELECT" to change the operating mode for Monday to Normal Operation Between. Note that when this setting is selected Start and Stop time user settings appear on the display. Use the Up/Down buttons to navigate between the Start and Stop time Hour, Minutes and AM/PM settings. With each item selected press the Operational Button underneath "SELECT" to activate the adjustment mode for each setting. Use the Up/Down buttons to change the value to the desired setting. Press the Operational Button underneath "ACCEPT" to enter the new setting or "CANCEL" to discard the new setting and retain the previous setting. Press the Operational Button underneath "BACK" to confirm the settings and update the control system. You will be returned to the Economy Mode Setup menu. The new settings should be shown for Mon.	   The first display shows the "Monday" selection screen with a clock icon and three radio button options: "Normal Operation All Day", "Economy Mode All Day", and "Normal Operation Between:" (selected). Below the options are fields for "Start:" (7:00 PM) and "Stop:" (8:00 PM). At the bottom are buttons for "ACCEPT" and "CANCEL". The second display shows the "Monday" selection screen with the "Normal Operation Between:" option selected. The "Start:" field is now set to "7:30 AM" and the "Stop:" field remains "8:00 PM". Below the fields is the text "Sending Updates to CCB...." and buttons for "CHANGE" and "BACK". The third display shows the "Economy Mode Setup" menu with "Mon" highlighted in black, indicating the new setting has been applied.

ALARM OUTPUT SETUP MENU

Permits user to set the condition (from a list of options) for when the CCB's integral alarm output relay will be energized. Alarm relay connections (common, normally open, normally closed) are located on the J3 terminal strip on the CCB. Alarm output relay contacts are capable of switching 1 amp maximum at 120 VAC. This can only be set up by a Qualified Installer or Service Technician.

The alarm relay operates in the background according to the settings in this menu and is not capable of disabling water heater operation. The alarm relay is used for external notification/verification of various operational conditions such as fault conditions and heating mode status. This relay can be used with building EMS (Energy Management System) and other external supervisory controls.

Alarm Output Setup	
Output Function	Fault
Alarm SP	120°F
CHANGE BACK HELP	

Alarm Output Setup	
Output Function	Temp < Alarm SP
Alarm SP	120°F
CHANGE BACK HELP	

Output Function

Adjustable user setting. Available options for the Alarm Output Function setting are:

Heating Mode: Used for heating mode on/off status notification.

Enable / Disable Closed: Used for notification and/or verification of the enable/disable circuits open/closed status. There are two enable/disable circuits available for external supervisory control(s) at the J7 socket on the CCB - see wiring diagrams. Enable/disable circuit(s) status can be viewed in the Heater Status Menu. This can only be set up by a Qualified Installer or Service Technician.

Temp < Heater SP: Used for external notification when current tank temperature drops below Operating Set Point.

Temp < Alarm SP: Used for external notification when current tank temperature drops below programmable Alarm SP.

Fault or Alert: Used for external notification whenever a Fault or Alert condition is active.

Fault: Used for notification whenever a Fault condition is active.

Disabled: Disables the Alarm Relay Output Function.

Alarm SP: Adjustable user setting (90°F (32.2°C) to 190°F (87.8°C)) the control system uses for the "Temp < Alarm SP" function described above. This setting has no effect with any other Alarm Output functions.

Alarm Output Settings: Changing the user settings in this menu is done using the same methods for changing the Operating Set Point.

Service Note: Adjustable user settings in the Alarm Output Setup menu are unaffected by Restore Factory Defaults.

DISPLAY SETTINGS MENU

Permits user to set display options for viewing information on the UIM's LCD screen.

Display Settings	
Temperature Units	°F
Backlight Delay	30s
Contrast	20%
CHANGE BACK HELP	

Temperature Units

Adjustable user setting that changes temperature units display to Celsius °C or Fahrenheit °F.

Backlight Delay

Adjustable user setting that determines how long the UIM's LCD backlight remains illuminated after a key has been pressed. Available settings are; Always Off, 10, 30 or 60 seconds and Always On.

Contrast

Adjustable user setting to adjust the UIM's LCD screen contrast between text and background.

Display Settings

Changing the user settings in this menu is done using the same methods for changing the Operating Set Point.

Service Note

Adjustable user settings in the Display Settings menu are unaffected by Restore Factory Defaults.

HEATER INFORMATION MENU

This menu displays non adjustable operational information.

Heater Information	
Elapsed Time	7 days 18 hrs 35 mins
Total Heating Time	2 days 46 mins
Cycle Count	00000042
Bank 1 Cycles	00000035
Bank 1 On Time	
BACK HELP	

TOP OF MENU

Heater Information	
Bank 2 On Time	1 day 4 hrs 44 mins
Bank 3 Cycles	00000025
Bank 3 On Time	8 hrs 30 mins
CCB Version	0.00
UIM Version	0.00
BACK HELP	

BOTTOM OF MENU

Elapsed Time

Total accumulated time the control system (water heater) has been energized.

Total Heating Time

Total accumulated time the control system has been in the heating mode. IE: any heating elements have been energized.

Bank # Cycles

Total accumulated count of heating cycles for each Bank of heating elements.

Bank # On Time

Total accumulated heating on time for each Bank of heating elements.

CCB Version

Software version for Central Control Board.

UIM Version

Software version for User Interface Module.

CURRENT FAULT / ALERT MENU

This menu displays non adjustable operational information. With the Fault History sub menu selected in Main Menu; press the Operational Button underneath "SELECT" to display the current Fault or Alert message. If there is not a Fault or Alert condition currently active "(none)" is displayed to the right of this menu.

Main Menu - Current Fault Selected

Main Menu	
Heater Information	
Current Fault (45)	
Fault History	
Fault Occurrence	
Restore Factory Defaults	
SELECT	BACK HELP

FAULT HISTORY MENU

Fault History Menu

Fault History	
1:	No Current Detected (40D) 1 days 5 hrs 45 mins ago
2:	Energy Cut Out (ECO) (A5) 1 days 6 hrs 20 mins ago
3:	Temp Probe Short (45) 2 days 1 hrs 10 mins ago
4:	No Current Detected (40D)
VIEW	BACK HELP

This menu displays non adjustable operational information. The control system records and stores the last 9 Fault and Alert messages in chronological order in this menu. The most recent will be at the top of the list. A time stamp is displayed below each listed Fault and Alert message showing when the Fault or Alert condition occurred.

The Fault History is useful when dealing with intermittent operational problems or when the customer has reset the control system prior to a service agent's arrival.

With a Fault or Alert item selected press the Operational Button underneath "VIEW" to display the details for the Fault or Alert message. The Fault/Alert message screen displays a brief description of the condition, contact information and access to the Advanced service information sub menu.

Current / History Fault Message

Temp Probe Short	
!	Fault occurred 14 mins ago
There is a problem with the temperature probe.	
Call a service professional: Paul Stewart (XXX) XXX - XXXX	
(press [DOWN] for more.....)	
BACK	ADVANCED

FAULT OCCURRENCE MENU

Total accumulated number each individual Fault condition has occurred is displayed in this menu. This running total of Fault Occurrences can be useful in determining which (if any) operational problems have been persistent.



Fault Occurrence Menu

Fault Occurrence	
ECO	1
No Current Detected	3
Tank Temp Probe	1
CCB Hardware	0
Model Faults	0
BACK	HELP

RESTORE FACTORY DEFAULTS MENU

This control system menu allows the user to restore most of the control system's user settings to their factory default settings. User settings in the Alarm Output Setup and Display Settings menus are unaffected by executing Restore Factory Defaults.

Restore Factory Defaults

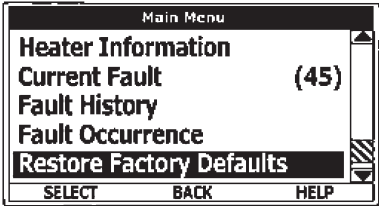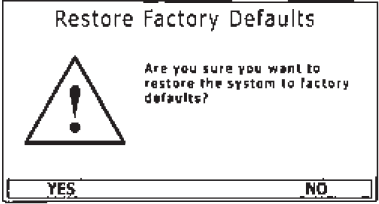ACTION	DISPLAY
From the Main Menu use the Up/Down buttons to select (highlight in black) the "Restore Factory Defaults" menu. Press the Operational Button underneath "SELECT." The Restore Factory Defaults menu will be displayed.	 The screenshot shows a 'Main Menu' with four options: 'Heater Information', 'Current Fault (45)', 'Fault History', and 'Restore Factory Defaults'. The 'Restore Factory Defaults' option is highlighted with a black background. At the bottom of the screen are three buttons: 'SELECT', 'BACK', and 'HELP'.
From the Restore Factory Defaults menu press the Operational Button underneath "YES." The display will show text confirming the factory default settings have been restored. Press the Operational Button underneath "BACK" to exit the Restore Factory Defaults menu.	 The screenshot shows a screen titled 'Restore Factory Defaults'. It features a warning triangle icon with an exclamation mark. To the right of the icon, the text reads: 'Are you sure you want to restore the system to factory defaults?'. At the bottom of the screen are two buttons: 'YES' and 'NO'.

THE FOLLOWING PAGES ARE FOR INSTALLATION, SERVICE/ MAINTENANCE AND TROUBLESHOOTING.

THESE INSTRUCTIONS ARE TO BE USED AND PERFORMED BY A QUALIFIED INSTALLER OR SERVICE AGENCY ONLY.

INSTALLATION

REQUIRED ABILITY

Installation and service of this water heater requires ability equivalent to that of a qualified agency (page 2) in the field involved. Plumbing and electrical work is required.

GENERAL

The installation must conform with these instructions and the Local/National code authority having jurisdiction and the requirements of the power company. In the absence of Local/National codes requirements, follow NFPA-70 (current edition). In the absence of Local/National codes, the installation must comply with the latest editions of the National Electrical Code, NFPA 70 or the Canadian Electrical Code CSA C22.1. The National Electrical Code may be ordered from: National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02269. The Canadian Electrical Code is available from the Canadian Standards Association, 8501 East Pleasant Valley Road, Cleveland, OH 44131.

Particular attention should be given to the installation of thermometers at the locations indicated in the diagrams as these are necessary for checking the operation of the heater.

Be sure to turn off power when working on or near the electrical system of the heater. Never touch electrical components with wet hands or when standing in water. When replacing fuses always use the correct size for the circuit. see page 13. Do NOT test electrical system before heater is filled with water, follow the START UP procedure in the OPERATION section of this manual.

The principal components of the heater are identified in the Features and Components illustrations on pages 37 and 38.



⚠ DANGER

Water temperature over 125°F (52°C) can cause severe burns resulting in severe injury or death.

Children, the elderly, and the physically or mentally disabled are at highest risk for scald injury.

Feel water before bathing or showering.

Temperature limiting valves are available.

Read instruction manual for safe temperature setting.

MIXING VALVE USAGE:

Water heaters are intended to produce hot water. Water heated to a temperature which will satisfy space heating, clothes washing, dish washing, cleaning and other sanitizing needs can scald and permanently injure you upon contact. Some people are more likely to be permanently injured by hot water than others. These include the elderly, children, the infirm, or physically/developmentally disabled. If anyone using hot water in your home fits into one of these groups or if there is a Local/National code or state law requiring a maximum water temperature at the hot water tap, then you must take special precautions. In addition to using the lowest possible temperature setting that satisfies your hot water needs, a means such as a **MIXING VALVE**, should be used at the hot water taps used by these people or at the water heater.

MIXING VALVES for reducing point of use temperature are available. Consult a qualified installer or service agency. Follow all manufacturer's Instructions for installation of these valves. Before changing the factory setting on the thermostat, read the "Temperature Regulation" section in this manual.

⚠ WARNING

Toxic Chemical Hazard

- Do not connect to non-potable water system.

CONTAMINATED WATER

This water heater shall not be connected to any heating system(s) or component(s) used with a non-potable water heating appliance.

Toxic chemicals, such as those used for boiler treatment shall not be introduced into this system.

CIRCULATING PUMP

Field installed circulating pumps should be of all bronze construction.


INSULATION BLANKETS

Insulation blankets are available to the general public for external use on electric water heaters but are not necessary with this product. The purpose of an insulation blanket is to reduce the standby heat loss encountered with storage tank heaters. Your water heater meets or exceeds the EPACT and ASHRAE/IES 90.1 standards with respect to insulation and standby loss requirements, making an insulation blanket unnecessary.

Should you choose to apply an insulation blanket to this heater, you should follow these instructions below. Failure to follow these instructions can result in fire, serious personal injury, or death.

- Do not cover the temperature and pressure relief (T & P) valve with an insulation blanket.
- Do not cover the instruction manual. Keep it on the side of the water heater or nearby for future reference.
- Do obtain new warning and instruction labels for placement on the blanket directly over the existing labels.

TEMPERATURE-PRESSURE RELIEF VALVE

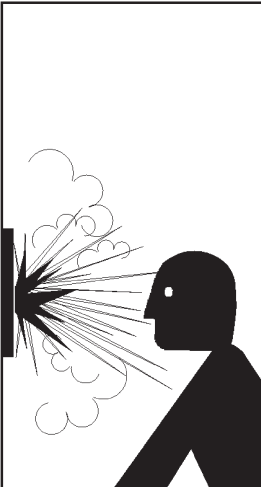

⚠ WARNING

Explosion Hazard

- Temperature-pressure relief valve must comply with ANSI Z21.22 and ASME code.
- Properly sized temperature-relief valve must be installed in opening provided.
- Failure to install relief valve can result in overheating and excessive tank pressure.
- Failure to follow these instructions can cause serious injury or death.

This water heater is provided with a properly rated/sized and certified combination temperature - pressure relief valve by the manufacturer.

that maintains periodic inspection of production of listed equipment of materials as meeting the requirements for Relief Valves for Hot Water Supply Systems, ANSI Z21.22 • CSA 4.4, and the code requirements of ASME.

If replaced, the new valve must meet the requirements of Local/ National codes, but not less than a combination temperature and pressure relief valve rated/sized and certified as indicated in the above paragraph. The new valve must be marked with a maximum set pressure not to exceed the marked hydrostatic working pressure of the water heater (150 psi = 1,035 kPa) and a discharge capacity not less than the water heater Btu/hr or kW input rate as shown on the water heater's model rating plate.


For safe operation of the water heater, the temperature and pressure relief valve must not be removed from its designated opening nor plugged. The temperature-pressure relief valve must be installed directly into the fitting of the water heater designed for the relief valve. To prevent leakage use pipe dope or Teflon tape on threads. Install discharge piping so that any discharge will exit only within 6 inches (15.2 cm) above, or at any distance below the structural floor. Be certain that no contact is made with any live electrical part. The discharge opening must not be blocked or reduced in size under any circumstances. Excessive length, over 30 feet (9.14 m), or use of more than four elbows can cause restriction and reduce the discharge capacity of the valve.

No valve or other obstruction is to be placed between the relief valve and the tank. Do not connect discharge piping directly to the drain unless a 6" (15.2 cm) air gap is provided. To prevent bodily injury, hazard to life, or property damage, the relief valve must be allowed to discharge water in adequate quantities should circumstances demand. If the discharge pipe is not connected to a drain or other suitable means, the water flow may cause property damage.

CAUTION Water Damage Hazard • Temperature-pressure relief valve discharge pipe must terminate at adequate drain.
--

The Discharge Pipe:

- Shall not be smaller in size than the outlet pipe size of the valve or have any reducing couplings or other restrictions.
- Shall not be plugged or blocked.
- Shall be of material listed for hot water distribution.
- Shall be installed so as to be in a continuously downward direction to allow complete drainage of both the temperature-pressure relief valve and the discharge pipe.
- Shall terminate at an adequate drain.
- Shall not have any valve or other obstruction between the relief valve and the drain. Water may drip from the discharge pipe of the pressure-relief device and that this pipe must be left open to the atmosphere
- Discharge must be in a frost free environment

⚠ DANGER 	Water temperature over 125°F (52°C) can cause severe burns resulting in severe injury or death. Children, the elderly, and the physically or mentally disabled are at highest risk for scald injury. Feel water before bathing or showering. Temperature limiting valves are available. Read instruction manual for safe temperature setting.
---	--

The temperature-pressure relief valve must be manually operated at least once a year, by a qualified service agent, to remove lime deposits and to verify that it is not blocked; Caution should be taken to ensure that (1) no one is in front of or around the outlet of the temperature-pressure relief valve discharge line, and (2) the water manually discharged will not cause any bodily injury or property damage because the water may be extremely hot. If after manually operating the valve, it fails to completely reset and continues to release water, immediately close the cold water inlet to the water heater, follow the draining instructions in this manual, and replace the temperature-pressure relief valve with a properly rated/sized new one.

If you do not understand these instructions or have any questions regarding the temperature-pressure relief valve call the toll free number listed on back cover of this manual for technical assistance.

WATER LINE CONNECTIONS

This manual provides detailed piping installation diagrams (see back section of this manual) for typical methods of application. Permanently connect to the water mains and do not connect by use of a hose-set. For the heater inlet and outlet connections, di-electric unions are recommended. The water heater may be installed by itself, or with a separate storage tank, on both single and two-temperature systems. When used with a separate storage tank, the circulation may be either by gravity or by means of a circulating pump. When a circulating pump is used it is important to note that the flow rate should be slow so that there will be a minimum of turbulence inside the heater.

CLOSED WATER SYSTEMS


Water supply systems may, because of Local/National code requirements or such conditions as high line pressure, among others, have installed devices such as pressure reducing valves, check valves, and back flow preventers. Devices such as these cause the water system to be a closed system.

THERMAL EXPANSION

As water is heated, it expands (thermal expansion). In a closed system the volume of water will grow when it is heated. As the volume of water grows there will be a corresponding increase in water pressure due to thermal expansion. Thermal expansion can cause premature tank failure (leakage). This type of failure is not covered under the limited warranty. Thermal expansion can also cause intermittent temperature-pressure relief valve operation: water discharged from the valve due to excessive pressure build up. This condition is not covered under the limited warranty. The temperature-pressure relief valve is not intended for the constant relief of thermal expansion.

A properly sized thermal expansion tank should be installed on all closed systems to control the harmful effects of thermal expansion. Contact a local plumbing service agency to have a thermal expansion tank installed.

ELECTRICAL

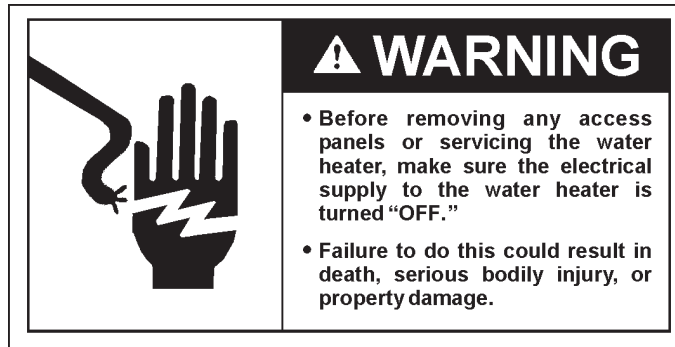

GENERAL

The installation must conform with these instructions and the Local/National code authority having jurisdiction and the requirements of the power company. In the absence of Local/National codes, the installation must comply with the current editions of the National Electrical Code, NFPA 70 or the Canadian Electrical Code CSA C22.1.

An electrical ground is required to reduce risk of electrical shock or possible electrocution. The water heater shall be connected to a separate grounded branch circuit with over-current protection and an all pole, full disconnect switch. The water heater shall be grounded in accordance with Local/National codes.

Voltage applied to the heater should not vary more than +5% to -10% of the model and rating plate marking for satisfactory operation.

All field wiring to be installed in approved conduit per local Local/National codes.

TABLE 6. - ALLOWABLE AMPACITIES OF INSULATED CONDUCTORS

Not more than three conductors in raceway, cable, or earth (directly buried), based on ambient temperature of 30°C (86°F)
(Note: Table taken from the National Electric Code, NFPA 70 (United States))

Size	Temperature Rating of Conductor, See Table 310-13								Size
	60°C (140°F)	75°C (167°F)	85°C (185°F)	90°C (194°F)	60°C (140°F)	75°C (167°F)	85°C (185°F)	90°C (194°F)	
AWG MCM	TYPES RUW, T TW, UF	TYPES FEPW, RH, RHW, RUH, THW, THWN, XHHW, USE, ZW	TYPES V, MI,	TYPES TA, TBS, SA, AVB, SIS, +FEP, +FEPB, +RHH, +THHN, +XHHW*	TYPES RUW, T TW, UF	TYPES RH, RHW, RUH, THW, THWN, XHHW, USE	TYPES V, MI,	TYPES TA, TBS, SA, AVB, SIS, +RHH, +THHN, +XHHW*	AWG MCM
COPPER					ALUMINUM OR COPPER-CLAD ALUMINUM				
18				21					
16			22	22					
14	15	15	25	25					
12	20	20	30	30	15	15	25	25	12
10	30	30	40	40	25	25	30	30	10
8	40	45	50	50	30	40	40	40	8
6	55	65	70	70	40	50	55	55	6
4	70	85	90	90	55	65	70	70	4
3	80	100	105	105	65	75	80	80	3
2		115	120	120	75	90	95	95	2
1		130	140	140		100	110	110	1
0		150	155	155		120	125	125	0
00		175	185	185		135	145	145	00
000		200	210	210		1155	165	165	000
0000		230	235	285		180	185	185	0000
250		255	270	270		205	215	215	250
300		285	300	300		230	240	240	300
350		310	325	325		250	260	260	350
400		335	360	360		270	290	290	400
500		380	405	405		310	330	330	500
CORRECTION FACTORS									
Ambient Temp. °C	For ambient temperatures over 30°C, multiply the ampacities shown above by the appropriate correction factor to determine the maximum allowable load current.								Ambient Temp. °F
31-40	.82	.88	.90	.91	.82	.88	.90	.91	86-104
41-50	.58	.75	.80	.82	.58	.75	.80	.82	105-122
51-60		.58	.67	.71		.58	.67	.71	123-141
61-70		.35	.52	.58		.35	.52	.58	142-158
71-80			.30	.41			.30	.41	159-176

+ The load current rating and the overcurrent protection for these conductors shall not exceed 15 amperes for 14 AWG, 20 amperes for 12 AWG, and 30 amperes for 10 AWG copper; or 15 amperes for 12 AWG and 25 amperes for 10 AWG aluminum and copper-clad aluminum.

* For dry locations only. See 75°C column for wet locations.

AMPERAGE TABLE/OVERCURRENT PROTECTION

The rating of the overcurrent protection must be computed on the basis of 125% of the total connected load amperage. Where the standard ratings and settings do not correspond with this computation, the next higher standard rating or setting should be selected.

HEATER CIRCUITS - ELECTRONIC CONTROL MODELS

The water heater's electrical components are pictured and identified in Diagrams 1 and 2. The model and rating plate illustration on page 6 identifies heater circuit ratings. The ELECTRONIC CONTROL model has two electrical circuits.

- The control circuit, which controls the electrical power to heating elements, referring the following control circuit diagram Figure 6.
- The power circuit, which is operated by the control circuit carries the electrical load of the heating elements. The following describes the heater circuits and includes wiring diagrams for Delta configuration, refer to the "WYE Configuration diagrams" for water heaters operating at 380V/400V/415V/575V. All heater circuits are designed for 50/60 cycle alternating current.

CONTROL CIRCUIT - ELECTRONIC CONTROL MODELS

These models are equipped with an electronic control system. The system includes a CCB (Central Control Board) circuit board, an immersion temperature probe with ECO for temperature sensing and limiting, a UIM (User Interface Module) for user interface & information display and element current sensors for monitoring the power circuits. Refer to the control circuit label on the water heater for details. The CCB is powered by a small 120V/24V transformer. The control circuit operates on 120V supplied by a larger 100VA

transformer. Standard equipment includes control circuit fusing using two, 3 amp, class G fuses with 600 volt rating. Do not substitute fuses of a different rating.

Sequence of Operation


1. When the control is powered, the UIM should display model information, water temperature, Operating Set Point, heating status and operating mode.
2. If the control determines that the actual water temperature inside the tank is below the programmed Operating Setpoint minus the (1st) differential, a call for heat is activated.
3. After all safety checks are verified, the CCB will energize contactor coils starting with the lower bank of heating elements (each diagonal row of three heating elements is considered a "bank" - see Diagram 1) then energize the middle bank (if so equipped) and top bank (if so equipped). The middle and top banks (if so equipped) are energized according to programmed 2nd and 3rd differential set points.
4. The control remains in the heating mode until the water temperature reaches the programmed Operating Setpoint. At this point the contactors will be de-energized in the reverse order.
5. The control system now enters the standby operating mode while continuing to monitor the water temperature and the state of other system devices. If the water temperature drops below the programmed Operating Setpoint minus the (1st) differential, the control will automatically return to step 2 and repeat the heating cycle.

NOTE: See the Electronic Control Models Operation section for more detailed information on temperature settings mentioned above.

FIGURE 6. - 120 VAC CONTROL CIRCUIT TRANSFORMER CONNECTIONS - ELECTRONIC CONTROL MODELS

NOTE: THIS TABLE TO BE USED FOR
8 TAP AND 5 TAP TRANSFORMERS

	VOLTS	LINE ON	LOAD ON	CONNECT
	480	H ₁ & H ₄	X ₁ & X ₄	H ₂ & H ₃
	480/277			X ₁ & X ₃ X ₂ & X ₄
	208	H ₁ & H ₂	X ₁ & X ₂	—
	240	H ₁ & H ₃	X ₁ & X ₂	—

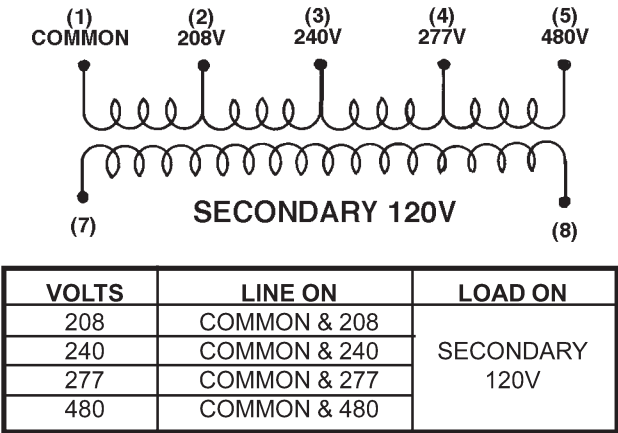

WIRING DIAGRAMS

CCB (CENTRAL CONTROL BOARD) CIRCUIT BOARD CONTROL CIRCUIT DIAGRAM - ELECTRONIC CONTROL MODELS


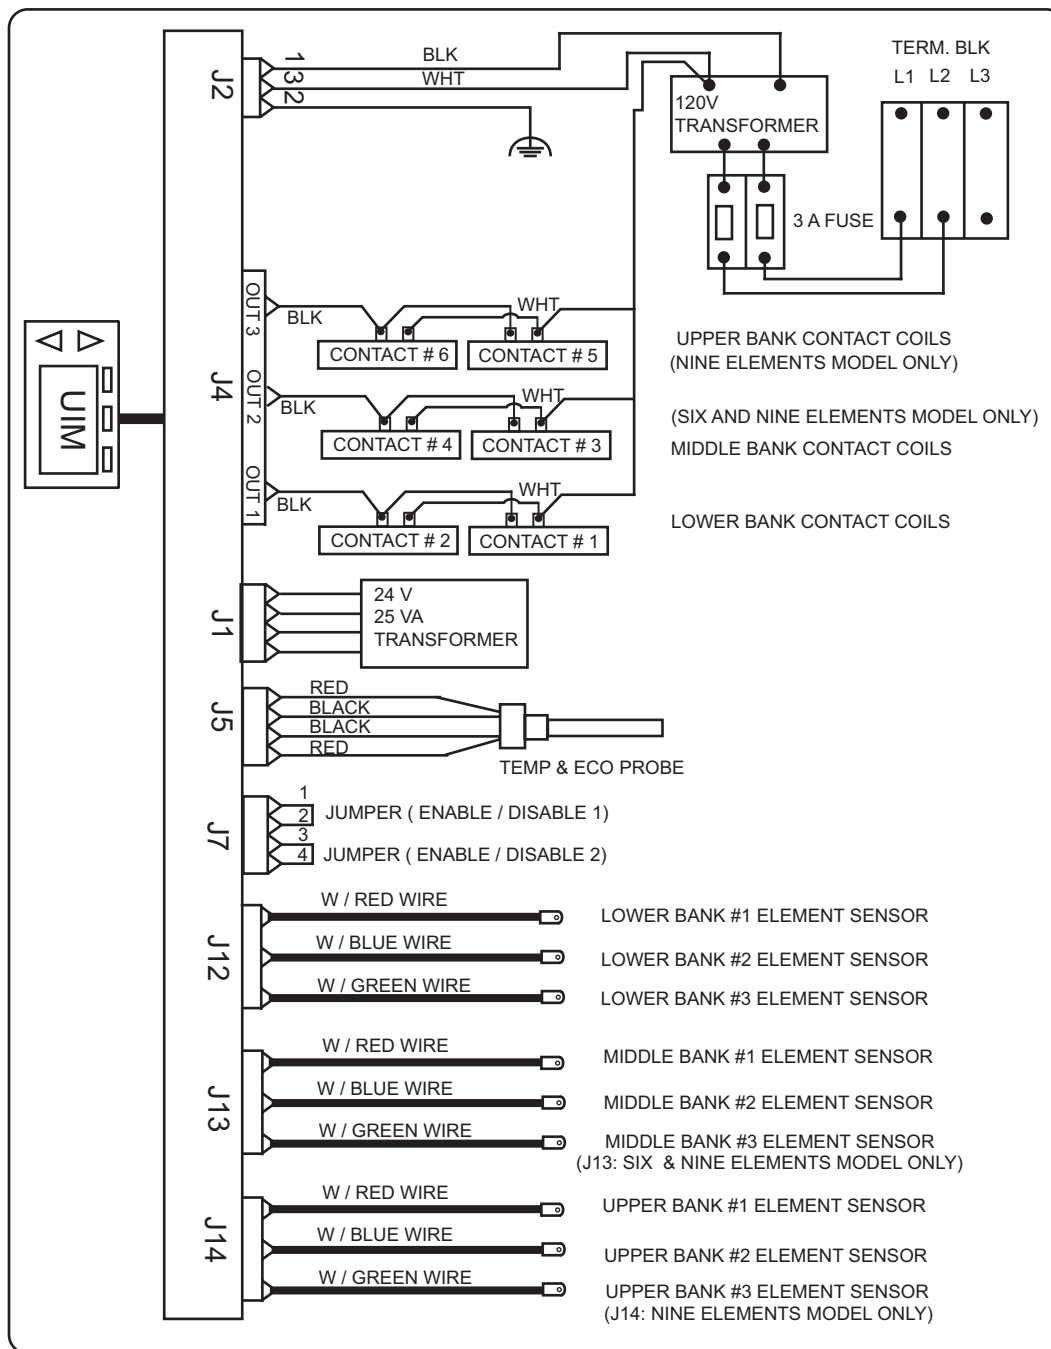


DIAGRAM 1.


WIRING DIAGRAMS

POWER CIRCUIT DIAGRAMS - ELECTRONIC CONTROL MODELS SINGLE / THREE PHASE DELTA

The water heater's electrical components are pictured and identified on page 7. The following describes the heater circuits and includes wiring diagrams. All heater circuits are designed for 60/50 hertz alternating current. The water heater circuit wiring is 12 AWG, AWM, or TEW type, rated 600 volts, 105°C. Fusing consists of three 30 amp fuses for each contactor. Fusing is an optional feature for Canadian models.

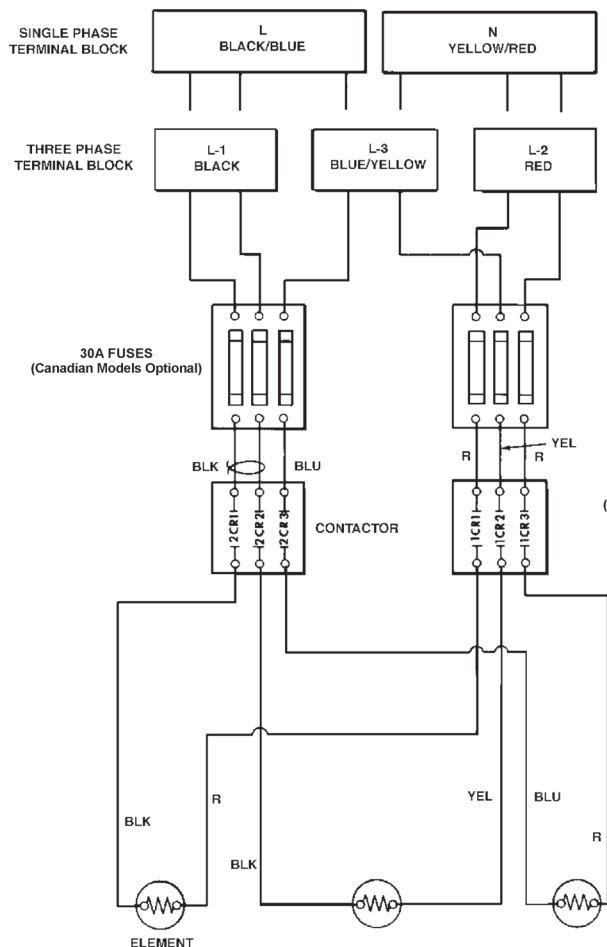


THREE ELEMENTS - SINGLE AND THREE PHASE

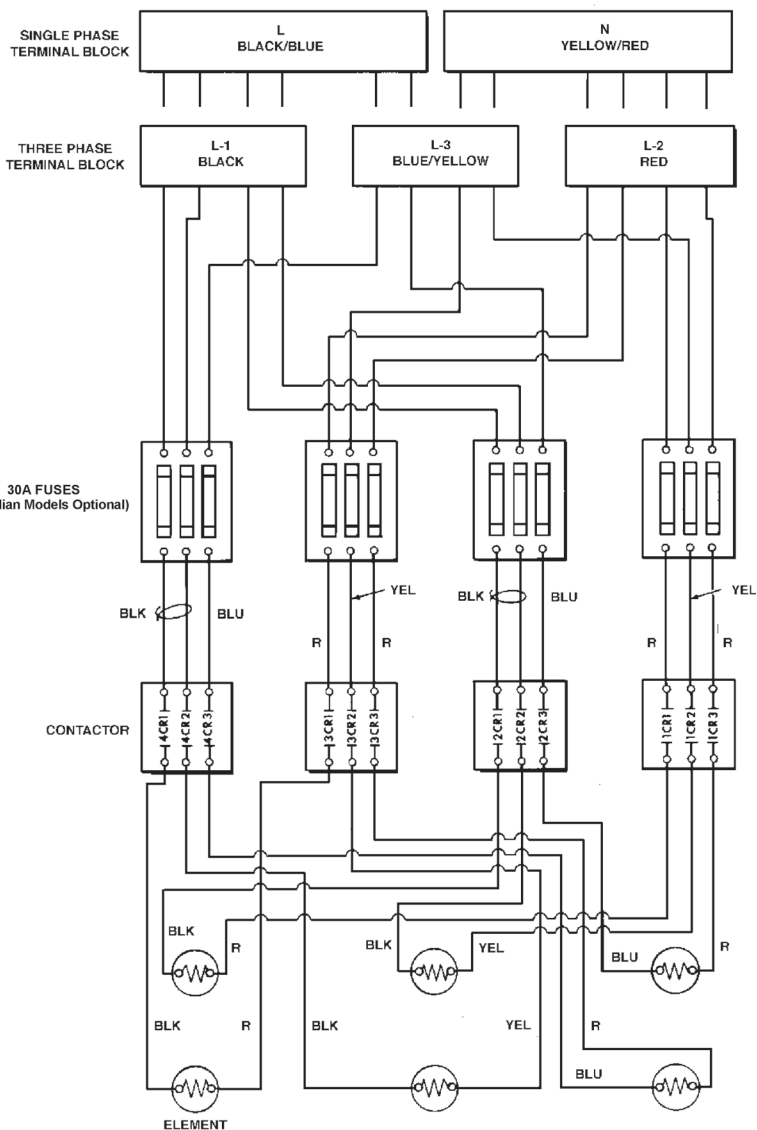

SIX ELEMENTS - SINGLE AND THREE PHASE

DIAGRAM 2.

WIRING DIAGRAMS

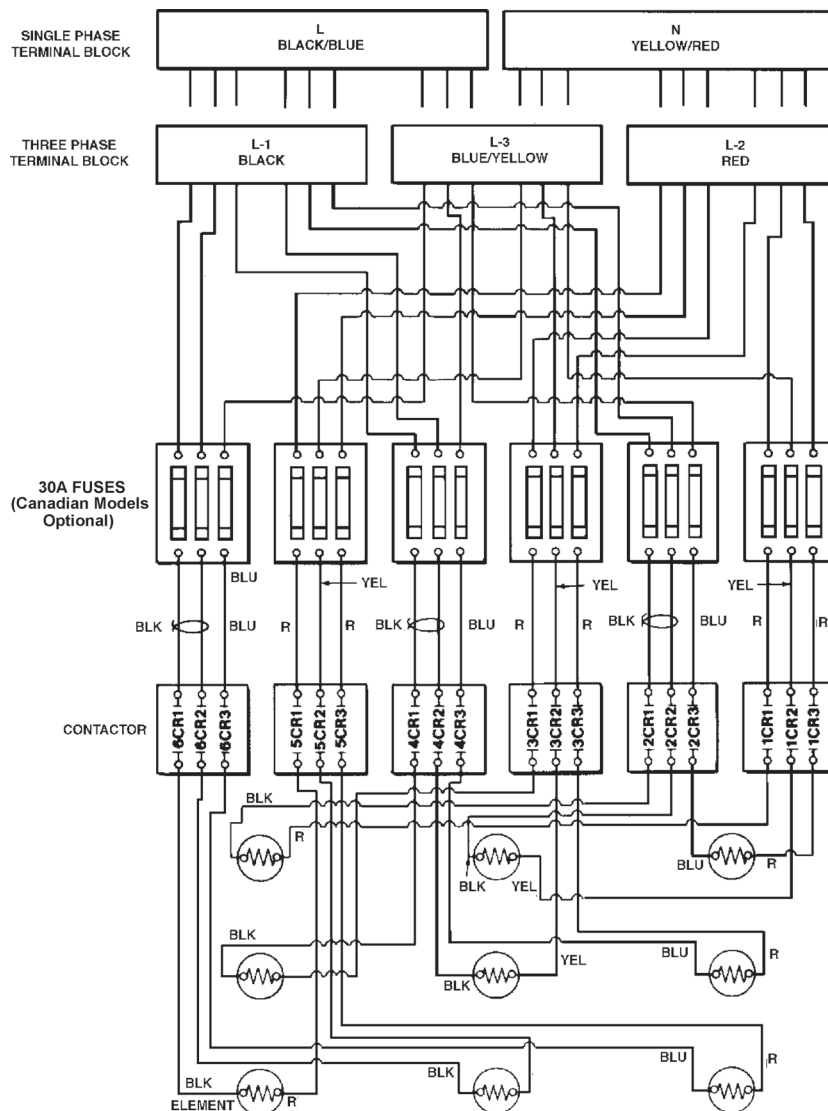

NINE ELEMENT - SINGLE AND THREE PHASE

DIAGRAM 3.

CONVERSION TO SINGLE PHASE

When the heater is shipped for connection to a three-phase electrical service, it may be connected to a single-phase electrical service of the same voltage by:

1. Disconnect blue wires and yellow wires from terminal L3.
2. Reconnect all blue wires to terminal L1 (with black wires).
3. Reconnect all yellow wires to terminal L2 (with red wires).
4. Connect incoming power to terminals L1 and L2.

CONVERSION TO THREE PHASE


When heater is shipped for connection to a single-phase electrical service, it may be connected to a three-phase electrical service of the same voltage by:

1. Disconnect blue wires from terminal L1.
2. Disconnect yellow wires from terminal L2.
3. Reconnect all blue wires and yellow wires to terminal L3.
4. Connect incoming power to terminals L1, L2, and L3.


WIRING DIAGRAMS

POWER CIRCUIT DIAGRAMS - SURFACE MOUNT CONTROL MODELS SINGLE / THREE PHASE DELTA

The water heater's electrical components are pictured and identified on page 8. The following describes the heater circuits and includes wiring diagrams. All heater circuits are designed for 60/50 hertz alternating current. The water heater circuit wiring is 12 AWG, AWM, or TEW type, rated 600 volts, 105°C. Fusing consist of two 30 amp fuses for each element. Fusing is an optional feature for Canadian models.

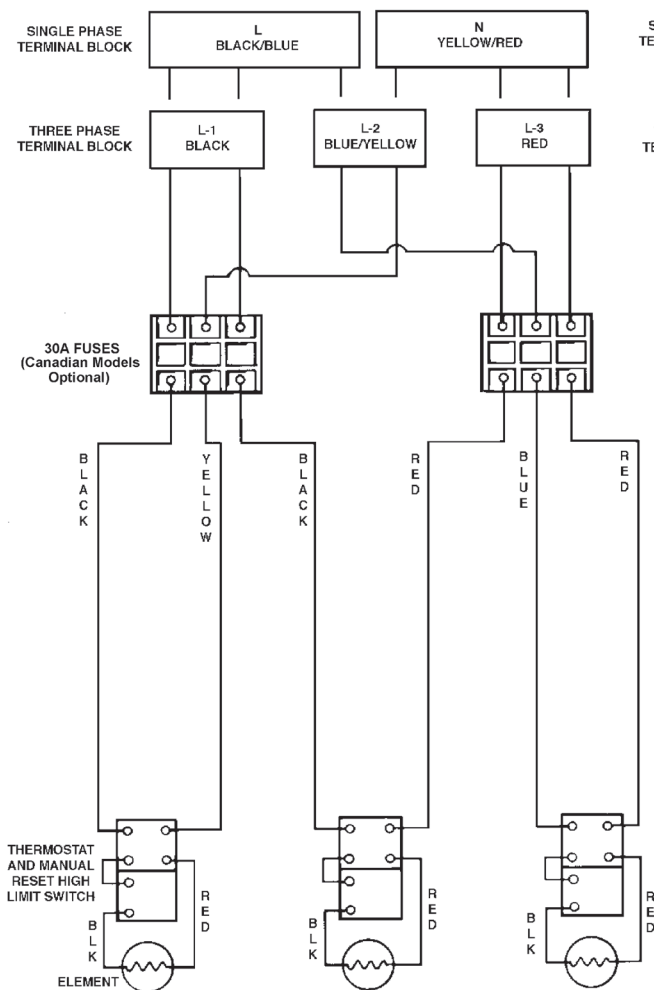


THREE ELEMENTS - SINGLE AND THREE PHASE

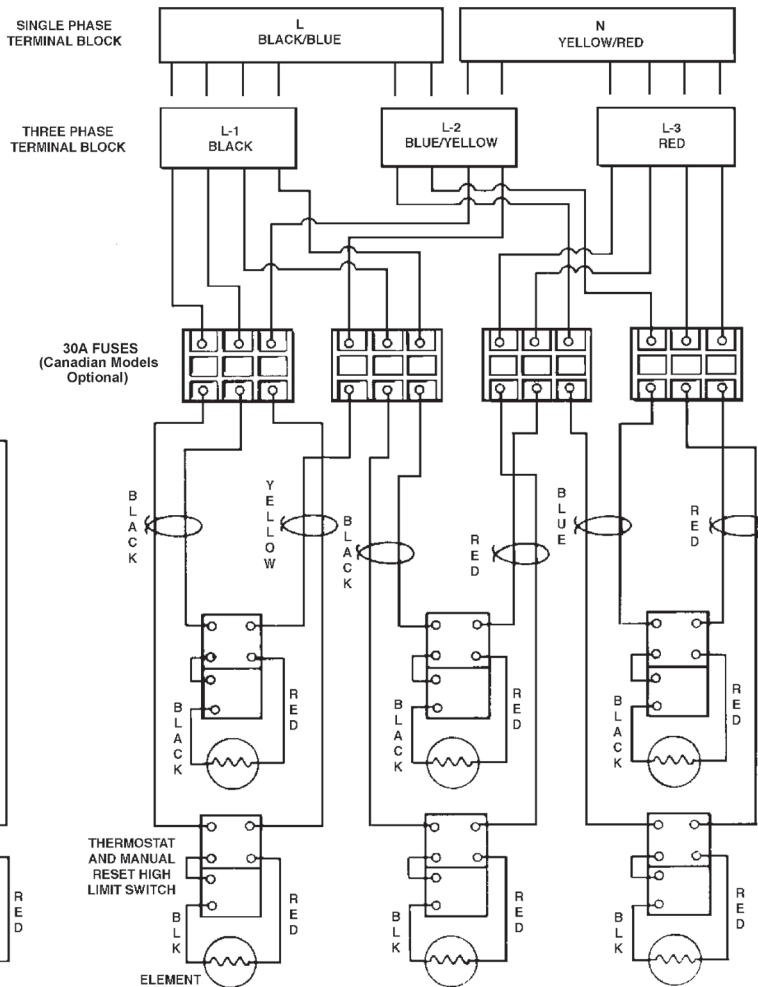

SIX ELEMENTS - SINGLE AND THREE PHASE

DIAGRAM 4.

WIRING DIAGRAMS

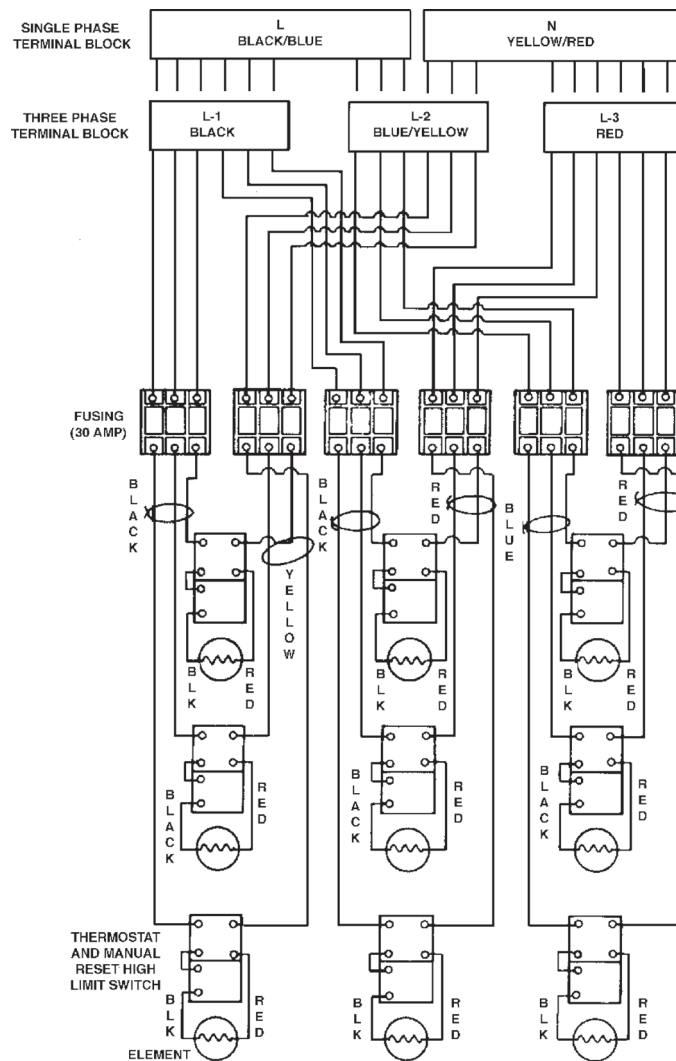

NINE ELEMENTS - SINGLE AND THREE PHASE

DIAGRAM 5.

CONVERSION TO SINGLE PHASE

When the heater is shipped for connection to a three-phase electrical service, it may be connected to a single-phase electrical service of the same voltage by:


1. Disconnect blue wires from terminal L2.
2. Connect all blue wires to terminal L1 (with black wires).
3. Disconnect all red wires from terminal L3.
4. Connect all red wires to terminal L-2 (with yellow wires).
5. Connect incoming power to terminals L1 and L2.

CONVERSION TO THREE PHASE

When heater is shipped for connection to a single-phase electrical service, it may be connected to a three-phase electrical service of the same voltage by:

1. Disconnect blue wires from terminal L1
2. Disconnect red wires from terminal L2.
3. Connect all blue wires to terminal L2 (with yellow wires).
4. Connect red wires to terminal L3.
5. Connect incoming power to terminals L1, L2 and L3.


WIRING DIAGRAMS

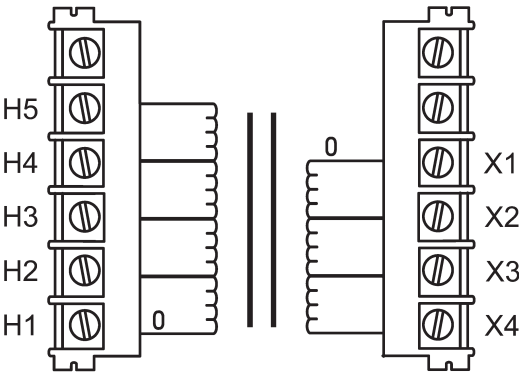

UNIVERSAL TRANSFORMER CONFIGURATION		
INPUT VOLTAGE	INPUT CONNECTION	OUTPUT CONNECTION
220 VOLT	H1-H2	X1-X4
380 VOLT	H1-H3	X1-X4
400/415 VOLT	H1-H3	X1-X3
575/600 VOLT	H1-H5	X1-X3


TRANSFORMER CONNECTIONS FOR “Y” CONNECTIONS
DIAGRAM 6.

WIRING DIAGRAMS

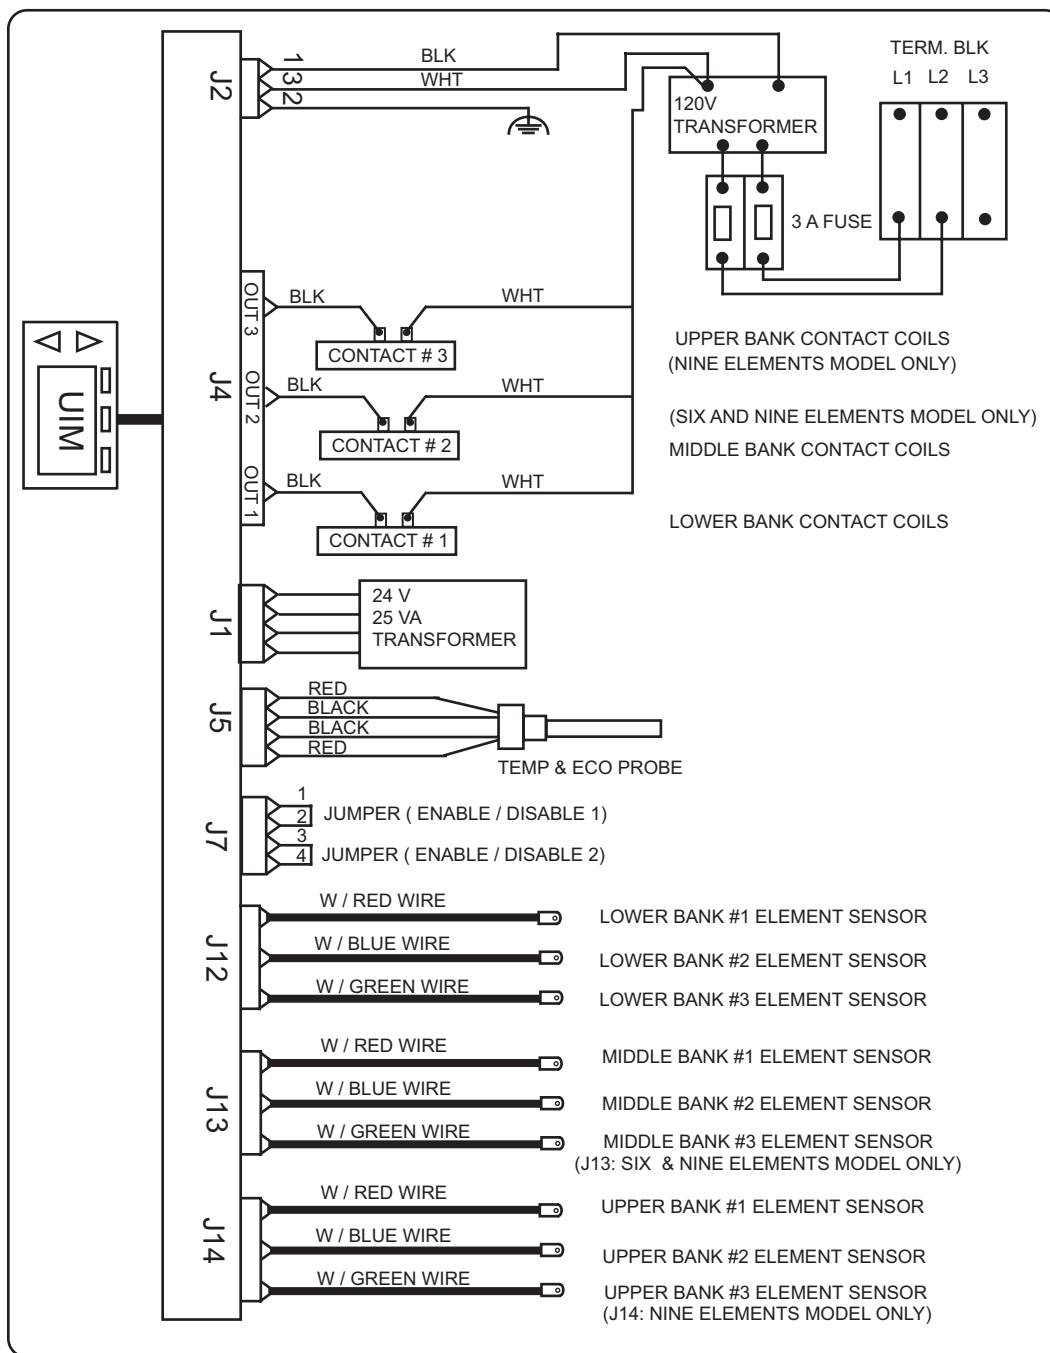


CONTROL CIRCUIT DIAGRAM "Y" CONNECTIONS - ELECTRONIC CONTROL MODELS
DIAGRAM 7.

WIRING DIAGRAMS

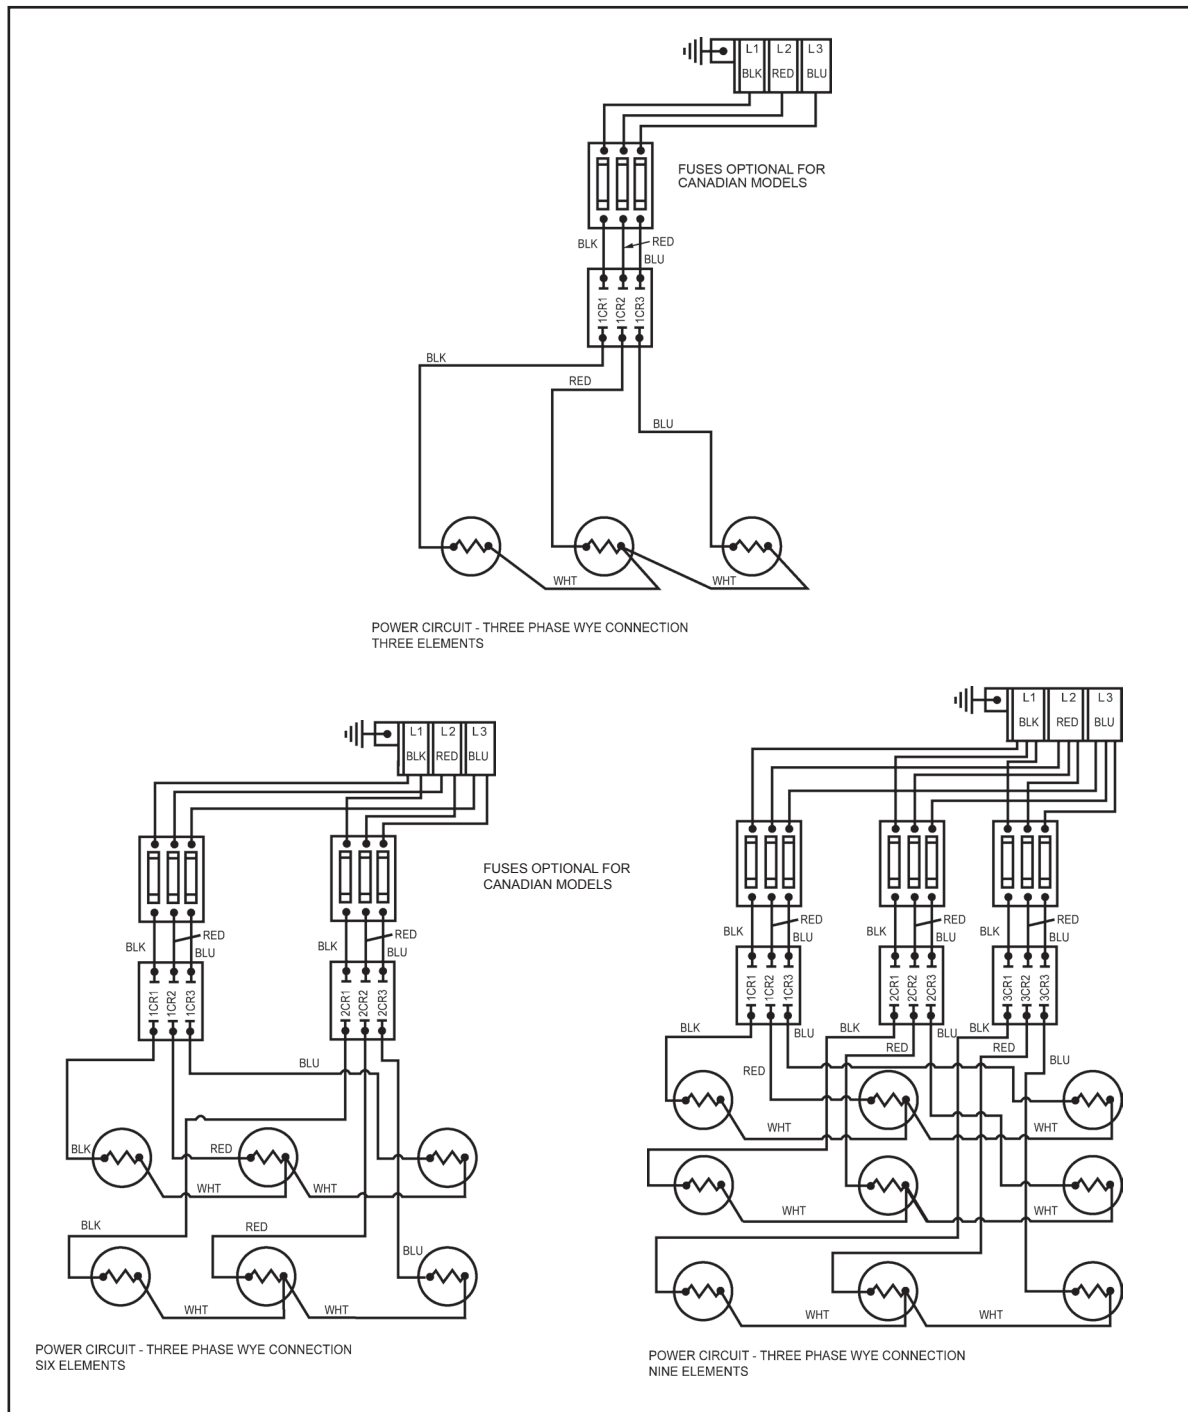

**“Y” CONNECTION POWER CIRCUIT DIAGRAM FOR UNITS WITH “IMMERSION” TYPE TEMPERATURE PROBE
DIAGRAM 8.**

WIRING DIAGRAMS

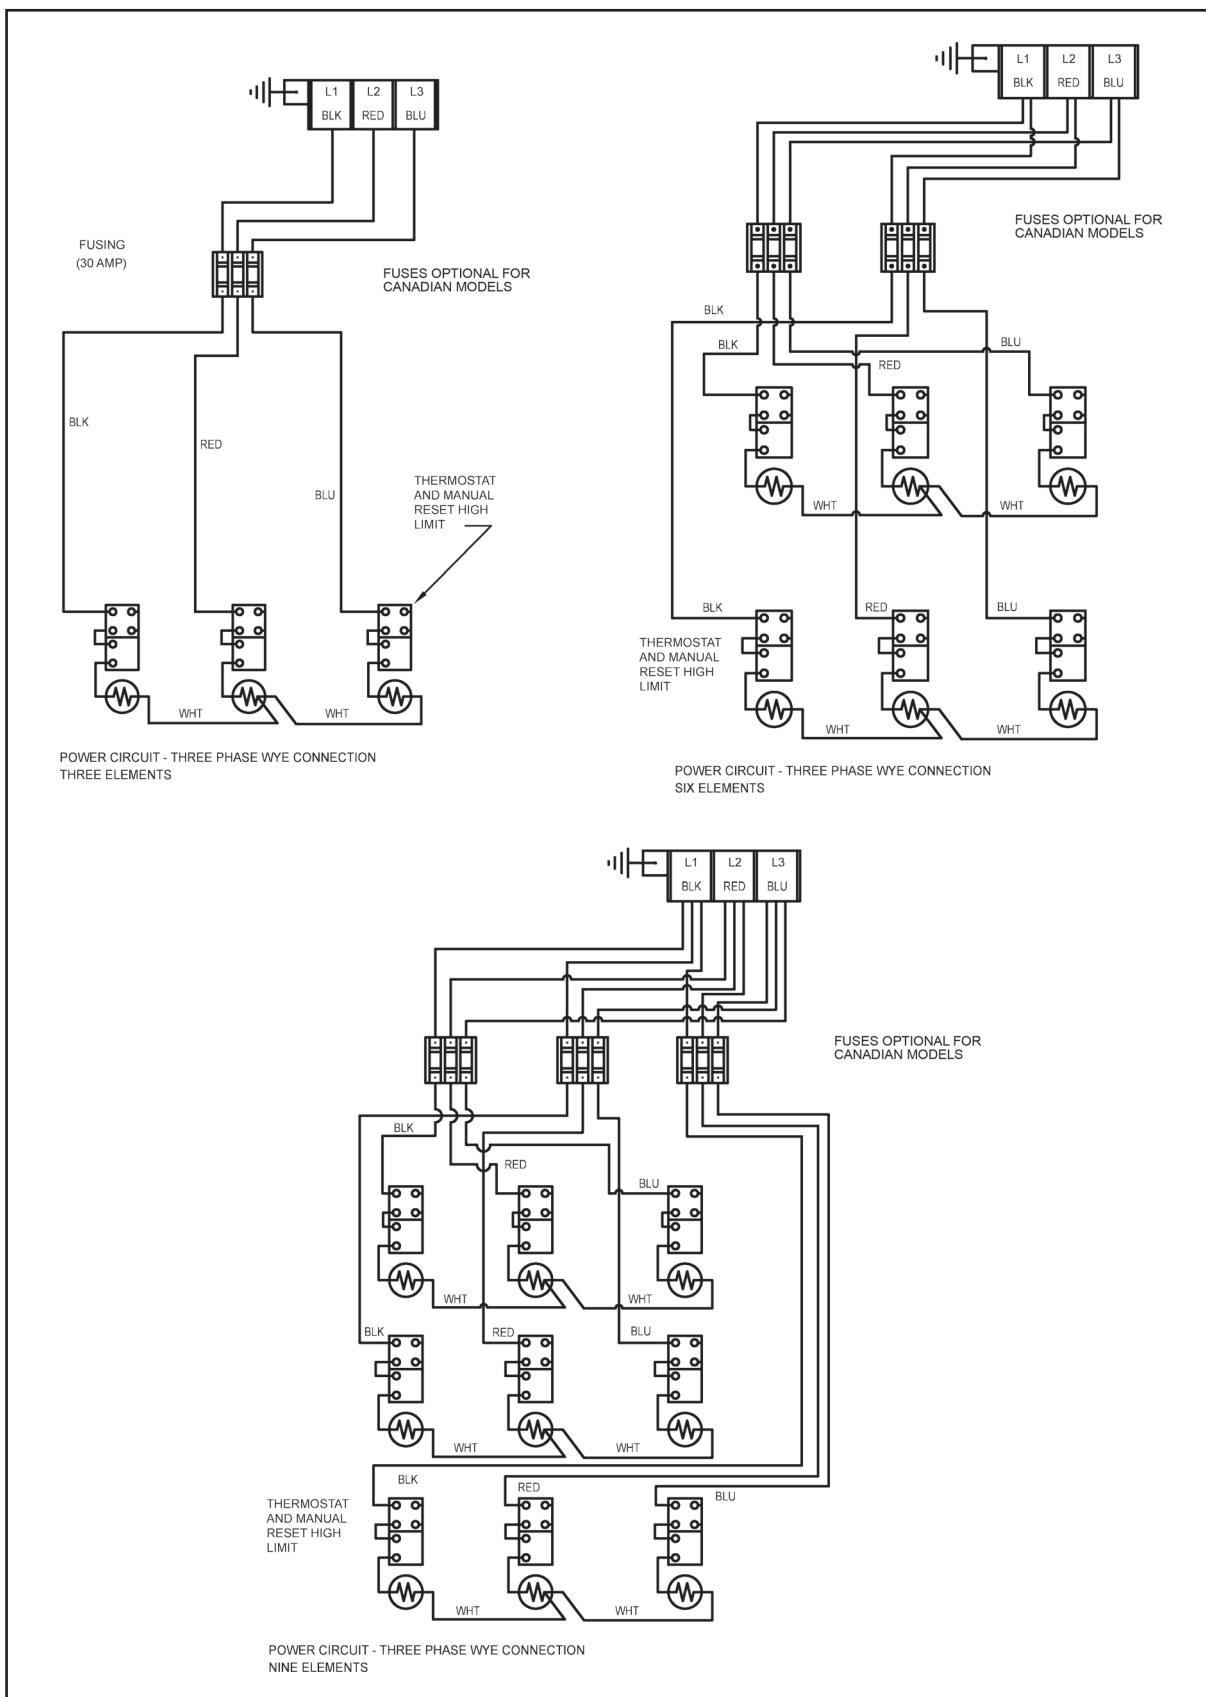

**“Y” CONNECTIONS POWER CIRCUIT DIAGRAM FOR UNITS WITH SURFACE - MOUNTED THERMOSTAT
DIAGRAM 9.**

OPERATION

GENERAL

Refer to the Features and Components section of this manual (pages 7 & 8) for the location of components mentioned in the instructions that follow.

NEVER turn on power to the water heater without being certain the water heater is filled with water and a temperature and pressure relief valve is installed in the relief valve opening.

DO NOT TEST ELECTRICAL SYSTEM BEFORE HEATER IS FILLED WITH WATER. FOLLOW FILLING AND START-UP INSTRUCTIONS IN OPERATION SECTION.



⚠ DANGER

Full power is present whenever the cabinet door is opened even with the pilot switch turned off.

FILLING THE WATER HEATER

CAUTION

Property Damage Hazard

In order to avoid water heater damage, fill tank with water before operating.

1. Turn off the electrical disconnect switch.
2. Close the water heater drain valve.
3. Open a nearby hot water faucet to permit the air in the system to escape.
4. Fully open the cold water inlet pipe valve allowing the heater and piping to be filled.
5. and piping to be filled.
6. Close the hot water faucet as water starts to flow. The heater is now ready for STARTUP and TEMPERATURE REGULATION.

INITIAL START UP

The following checks should be made by the installer when the heater is placed into operation for the first time.

1. Turn off the electrical disconnect switch.
2. Open the front panel, check all water and electrical connections for tightness. Also check connections on top and side of heater. Repair water leaks and tighten electrical connections as necessary.
3. Depress the red manual reset button on each Thermostat/ECO combination control (Surface Mount Control Models only).
4. Turn on the electrical disconnect switch.
5. Observe the operation of the electrical components during the first heating cycle. Use care as the electrical circuits are energized.
6. Close the front panel.

Temperature control and contactor operation should be checked by allowing heater to come up to temperature and shut off automatically. Use care as the electrical circuits are energized.


DRAINING THE WATER HEATER

The water heater must be drained if it is to be shut down and exposed to freezing temperatures. Maintenance and service procedures may also require draining the heater.

1. Turn off the electrical disconnect switch.
2. Close the supply water inlet valve to heater.
3. Attach hose to outlet opening of drain valve and direct end to drain.
4. Open a nearby hot water faucet and the heater drain valve.
5. If the heater is being drained for an extended shutdown, it is suggested the drain valve be left open during this period. The hose may be removed.

Follow FILLING instructions when restoring hot water service.

⚠ DANGER



- Burn hazard
- Hot water discharge.
- Keep clear of relief valve/drain valve discharge outlet.

TEMPERATURE REGULATION

HIGH TEMPERATURE LIMIT CONTROLS (ECO)

Both the ELECTRONIC CONTROL and SURFACE MOUNT CONTROL model water heaters are equipped with one or more ECO (energy cut off) non adjustable high temperature limit control(s). An ECO is a normally closed switch that opens (activates) on a rise in temperature. If the ECO switch contacts open (activate) due to abnormally high water temperatures it will lock-out and disable further heating element operation. It is important that a qualified service agent be contacted to determine the reason for the ECO activation before resetting the ECO. Once the reason has been determined and corrected the ECO(s) can be reset as follows:

CAUTION

Controls may become hot during normal operation.
Care should be taken to prevent burns.

Surface Mount Control Models

Surface Mount Control models have multiple surface mounted Thermostat/ECO combination controls. One for each installed heating element - see the Surface Mount Control wiring diagrams in this manual. The ECO high temperature limit switch contacts on each control will open when the tank temperature reaches approximately 200°F/93°C. If activated, the ECO reset button will be slightly extended and stiff to the touch. When the ECO switch contacts open (activate) voltage to ONE heating element ONLY is terminated to prevent further heating operation of that element. Voltage may still be present at other heating elements and they may still be heating the water.

The ECO is a manual reset switch. Should one or more ECO activate, the tank temperature must drop below 120°F/49°C before an ECO can be reset. To manually reset an ECO:

1. Disconnect the power supply to the water heater.
2. Allow the tank temperature to cool below 120°F/49°C.
3. Remove the front control cover from the effected control(s).
4. Press the manual reset button on each of the effected controls.
5. Once the control(s) has been reset the control cover should be replaced prior to restoring power to the water heater.

Electronic Control Models

The ECO high temperature limit switch is located inside the immersion Temperature Probe (two red wires) on ELECTRONIC CONTROL models. The ECO switch contacts will open when the water temperature reaches approximately 202°F/94°C. When the ECO switch contacts open (activate) the electronic control system locks out and displays a Fault message. Voltage to the contactor coils and heating elements is terminated to prevent further heating operation.

Should the ECO activate, the water temperature must drop below 140°F/60°C before the control system can be reset. Once the water temperature has cooled below this point the power supply to the water heater must be turned off and on again to reset the control system.

THERMOSTAT CONTROLS


The water heaters covered in this instruction manual are equipped with adjustable thermostat controls to control water temperature. Hot water temperatures required for automatic dishwasher and laundry use can cause scald burns resulting in serious personal injury and/or death. The temperature at which injury occurs varies with the persons age and duration of exposure. The slower response time of children, the elderly or disabled persons increases the hazards to them. Never allow small children to use a hot water tap or draw their own bath water. Never leave a child or disabled person unattended in a bathtub or shower.

The water heater should be located in an area where the general public does not have access to set temperatures.

Setting water heater temperatures at 120°F (49°C) will reduce risk of scalds. Some areas require settings at specific lower temperatures.

THERMOSTAT SETTINGS - SURFACE MOUNT CONTROL

Adjustment of temperature controls on surface mounted controls is to be performed by a qualified service agent at initial start-up.

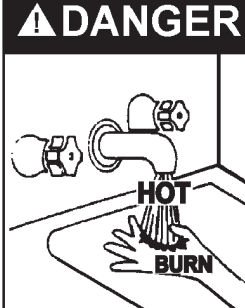

⚠ DANGER

Water temperature over 125°F (52°C) can cause severe burns resulting in severe injury or death.

Children, the elderly, and the physically or mentally disabled are at highest risk for scald injury.

Feel water before bathing or showering.

Temperature limiting valves are available.

Read instruction manual for safe temperature setting.

These models have multiple thermostat/ECO combination controls one for each heating element installed. These thermostats are set from the factory at 140°F/60°C. Set the thermostat dial at the lowest setting which produces an acceptable hot water supply. This will always give the most energy efficient operation.

The water heater is supplied with thermostats that may come from different manufactures and have different temperature indications as described below.

Thermodisc

Thermodisc thermostats are adjustable from approximately 120°F (49°C) (lowest setting) to 180°F (82°C) (highest setting) see figure 7A. These thermostats are set from the factory at approximately the 140°F (60°C) setting. The over temperature device (ECO high limit) attached to each thermostat has a manual reset.

APCOM Thermostats

Apcom thermostats have three designated set points; LO, MED and HI. See figure 7B. The approximate equivalent temperatures for these three settings are: LO = 140°F (60°C), MED = 160°F (71°C) and HI = 180°F (82°C). These thermostats are set from the factory at the LO 140°F (60°C) setting. The over temperature device (ECO high limit) attached to each thermostat has a manual reset.

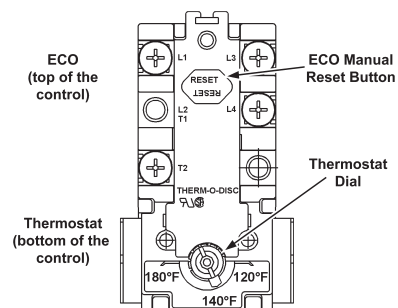


FIGURE 7A.

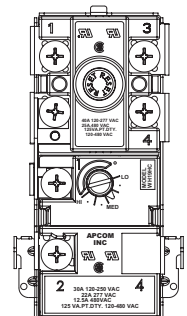


FIGURE 7B.


Table 7 shows the approximate time-to-burn relationship for normal adult skin.

TABLE 7.

Water Temperature	Time to Produce 2nd & 3rd Degree Burns on Adult Skin
180°F (82°C)	Nearly Instantaneous
160°F (71°C)	About 1/2 second
150°F (66°C)	About 1-1/2 seconds
140°F (60°C)	Less than 5 seconds
130°F (54°C)	About 30 seconds
120°F (49°C)	More than 5 minutes
80°F (27°C)	-----

MAINTENANCE

GENERAL

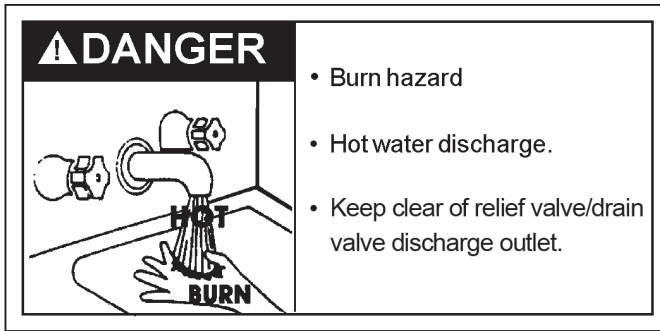

Periodically the drain valve should be opened and the water allowed to run until it flows clean. This will help to prevent sediment buildup in the tank bottom.

Periodically check the temperature and pressure relief valve to ensure that it is in operating condition. Lift the lever at the top of the valve several times until the valve seats properly and operates freely.

Water heater maintenance includes periodic tank flushing and cleaning, and removal of lime scale from the heating element.

The heater tank is equipped with an anode rod to aid in corrosion control.

ANODE INSPECTION AND REPLACEMENT

Inspection of the sacrificial anode every 6 to 12 months allows you to identify a spent anode and replace it. Replace the anode when its diameter is 3/8" (1 cm) of an inch, or annually whichever is first. Aggressive, very hot and softened water causes rapid consumption of the anode requiring frequent inspections. Call the toll free number on the back cover of this manual for information on obtaining replacement anode rods.

TABLE 8.

MAINTENANCE SCHEDULE			
Component	Operation	Interval	Required
Tank	Flushing	Periodically	
Elements	Lime Scale Removal	As needed	Un•Lime® delimer & element gaskets, Part

Tank flushing should be performed in accordance with the above schedule. Tank sediment removal and element lime scale removal must be performed as needed as determined by periodic inspection. Following are the instructions for performing recommended maintenance.

FLUSHING

The water heater drain valve should be opened periodically to help prevent sediment buildup on the tank bottom.

1. Turn off the electrical disconnect switch.
2. Attach hose to outlet opening of drain valve and direct end to drain.
 - Open the drain valve by turning the hand wheel to the left (counterclockwise). Allow water to flow until it runs clean.
 - If water does not flow from opened drain valve, follow instructions for sediment removal.
3. When finished flushing:
 - Close heater drain valve and remove hose.
 - Turn on electricity.

SEDIMENT REMOVAL

Water borne impurities consist of fine particles of soil and sand which settle out and form a layer of sediment on the bottom of the tank. In time, if not removed, the level of sediment might reach the heating elements and cause their failure.

For convenience, sediment removal and element lime scale removal should be performed at the same time as follows.

LIME SCALE REMOVAL

Lime scale accumulations on the heating elements is a normal condition, common to all immersion type elements. Factors which affect the amounts of this formation are:

1. Amount of hot water used. As the volume of water heated increases, more scale results.
 2. Water temperature. As the temperature of the water is increased, more scale is deposited on the elements.
 3. Characteristics of water supply.
- Regardless of water treatment, examine elements regularly.

Lime scale accumulations may cause noises to occur during operation.

It is recommended that a heating element be removed periodically for examination. If it is scaled, all of the elements should be removed and cleaned. If the tank bottom has an accumulation of sediment it should be cleaned.

Lime scale should be removed by dissolving the accumulation in UN•LIME® delimer. Do not use muriatic or hydrochloric acid base deliming solutions to remove lime scale from the elements.

THE PROCESS FOR LIME SCALE REMOVAL IS AS FOLLOWS:

1. Turn off electrical disconnect switch.
2. Drain the heater following DRAINING instructions.
3. Open front panel.
4. Disconnect the element wiring. Try not to disturb the wiring unnecessarily and reconnection will be easier.
5. Unscrew each element.
6. Remove the elements and gaskets from the openings.
 - Use a twisting, pulling action to remove elements scaled beyond the size of the tank openings.
 - Brush loose scale from elements.
7. Lime scale removal:
 - Place limed ends of heating elements into UN•LIME delimer and allow scale to dissolve. Do not permit delimer or water to contact heating element electrical terminals.
 - Silicates, sulfates and aluminates must be removed by scraping or other mechanical means. Lime scale dissolvents will not remove these types of scale occasionally encountered.

Call the toll free phone number on the back cover of this Instruction Manual to purchase UN•LIME and heating element gaskets.

OTHER SCALE REMOVAL:

1. Flush cleaned ends of elements with water when deliming or cleaning is completed.
2. Remove sediment and scale from the tank bottom through access provided by the element openings or drain valve opening.
 - The cold water inlet valve and drain valve may be opened to aid the cleanout process.
3. Clean remaining gasket material from tank and element flanges. Do not reuse original element gaskets.
4. Put new gaskets on elements and install into tank openings.
 - Uniformly tighten element bolts. Torque to approximately 32 ft./lbs.
5. Attach element wires to connection points from which they were removed.
6. Follow FILLING instructions to restore hot water service.
 - Check for water leaks around elements and proper operation when heater is filled.
 - Close the front panel.

TROUBLESHOOTING CHECKLIST

CHECKLIST

	⚠ WARNING • Before removing any access panels or servicing the water heater, make sure the electrical supply to the water heater is turned "OFF." • Failure to do this could result in death, serious bodily injury, or property damage.
---	--

NOT ENOUGH OR NO HOT WATER

1. Be certain the electrical disconnect switch serving the water heater is in the ON position.
2. Check the fuses.
 - The electrical disconnect switch usually contains fuses.
 - The heater has fusing.
3. If the water was excessively hot, and is now cold, the high limit switch may have activated.
 - See the Temperature Regulation section of this manual for more information on how to reset the ECO high limit controls.
4. The capacity of the heater may have been exceeded by a large demand for hot water.
 - Large demands require a recovery period to restore water temperature.
5. Cooler incoming water temperature will lengthen the time required to heat water to the desired temperature.
6. Look for hot water leakage.
7. Sediment or pipe scale may be affecting water heater operation.

ABNORMAL SOUNDS

1. Sediment or lime scale accumulations on the elements causes sizzling and hissing noises when the heater is operating.
 - The sounds are normal, however, tank bottom and elements should be cleaned. See Maintenance section of this manual.
2. Some of the electrical components of the water heater make sounds which are normal.
 - Contactors will "click" or snap as the heater starts and stops.
 - Transformers and contacts often hum.

WATER LEAKAGE IS SUSPECTED

Refer to Leakage Checkpoint on the following page.

1. Check to see if the heater drain valve is tightly closed.
2. If the outlet of the relief valve is leaking it may represent:
 - Excessive water temperature.
 - Faulty relief valve.
 - Excessive water pressure.
3. Excessive water pressure is the most common cause of relief valve leakage. It is often caused by a "closed system". See "Closed Water Systems" and "Thermal Expansion" in the Installation section of this manual for more information.
4. Examine the area around the element for gasket leakage.
 - Tighten elements or, if necessary, follow WATER AND LIME SCALE REMOVAL procedure to replace gaskets.

IF YOU CANNOT IDENTIFY OR CORRECT THE SOURCE OF MALFUNCTION

1. Turn the power supply to the water heater off.
2. Close the supply water inlet valve to the heater.
3. Contact a Qualified Service Agency in your area. Call the toll free phone number on the back cover of this Instruction Manual for assistance in locating a service agency in your area.

REPLACEMENT PARTS

Call the toll free phone number on the back cover of this Instruction Manual for assistance in locating replacement parts. When ordering parts, specify the complete model number, serial number, (see rating plate), quantity and name of the part desired. Standard hardware items should be purchased locally.

LEAKAGE CHECKPOINTS

INSTRUCTIONS: USE THIS ILLUSTRATION AS A GUIDE WHEN CHECKING FOR SOURCES OF WATER LEAKAGE

All water which appears at the heater bottom or on the surrounding floor may be caused by condensation, loose connections or relief valve operation and leakage. Do not replace the heater until a full inspection of all potential leak points is made and corrective steps taken to stop the leak. Leakage from other appliances, water lines, or ground seepage should also be suspected until proved otherwise.

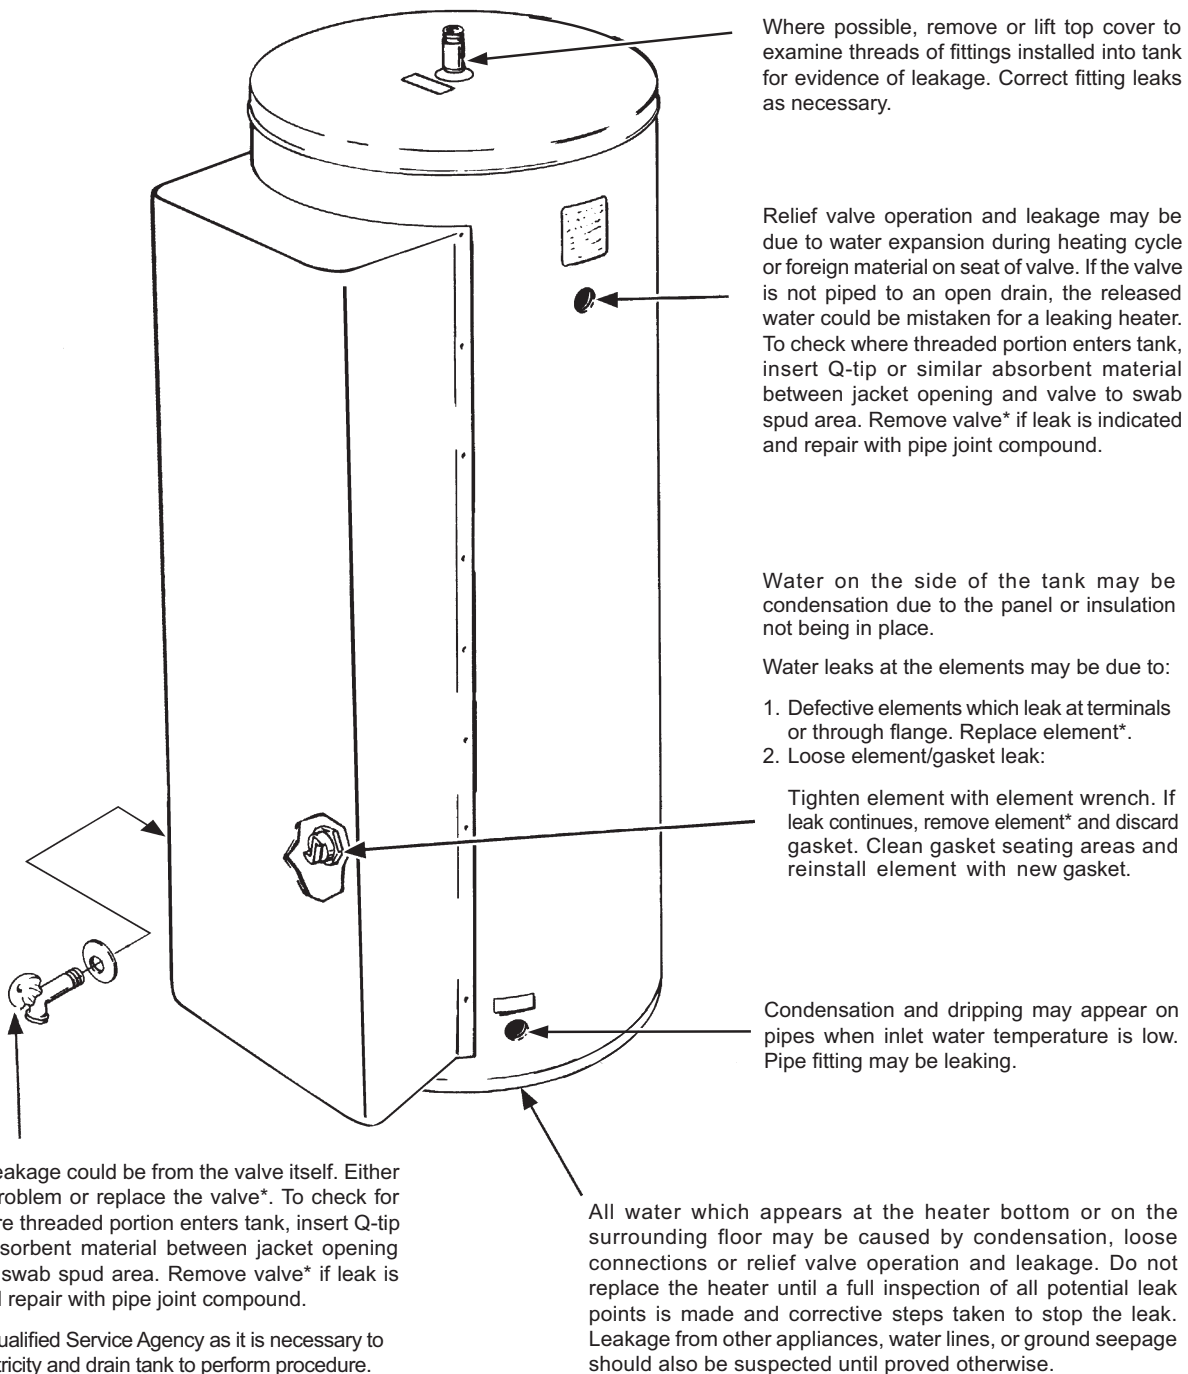


FIGURE 8.

FEATURES AND COMPONENTS

ELECTRONIC CONTROL MODELS

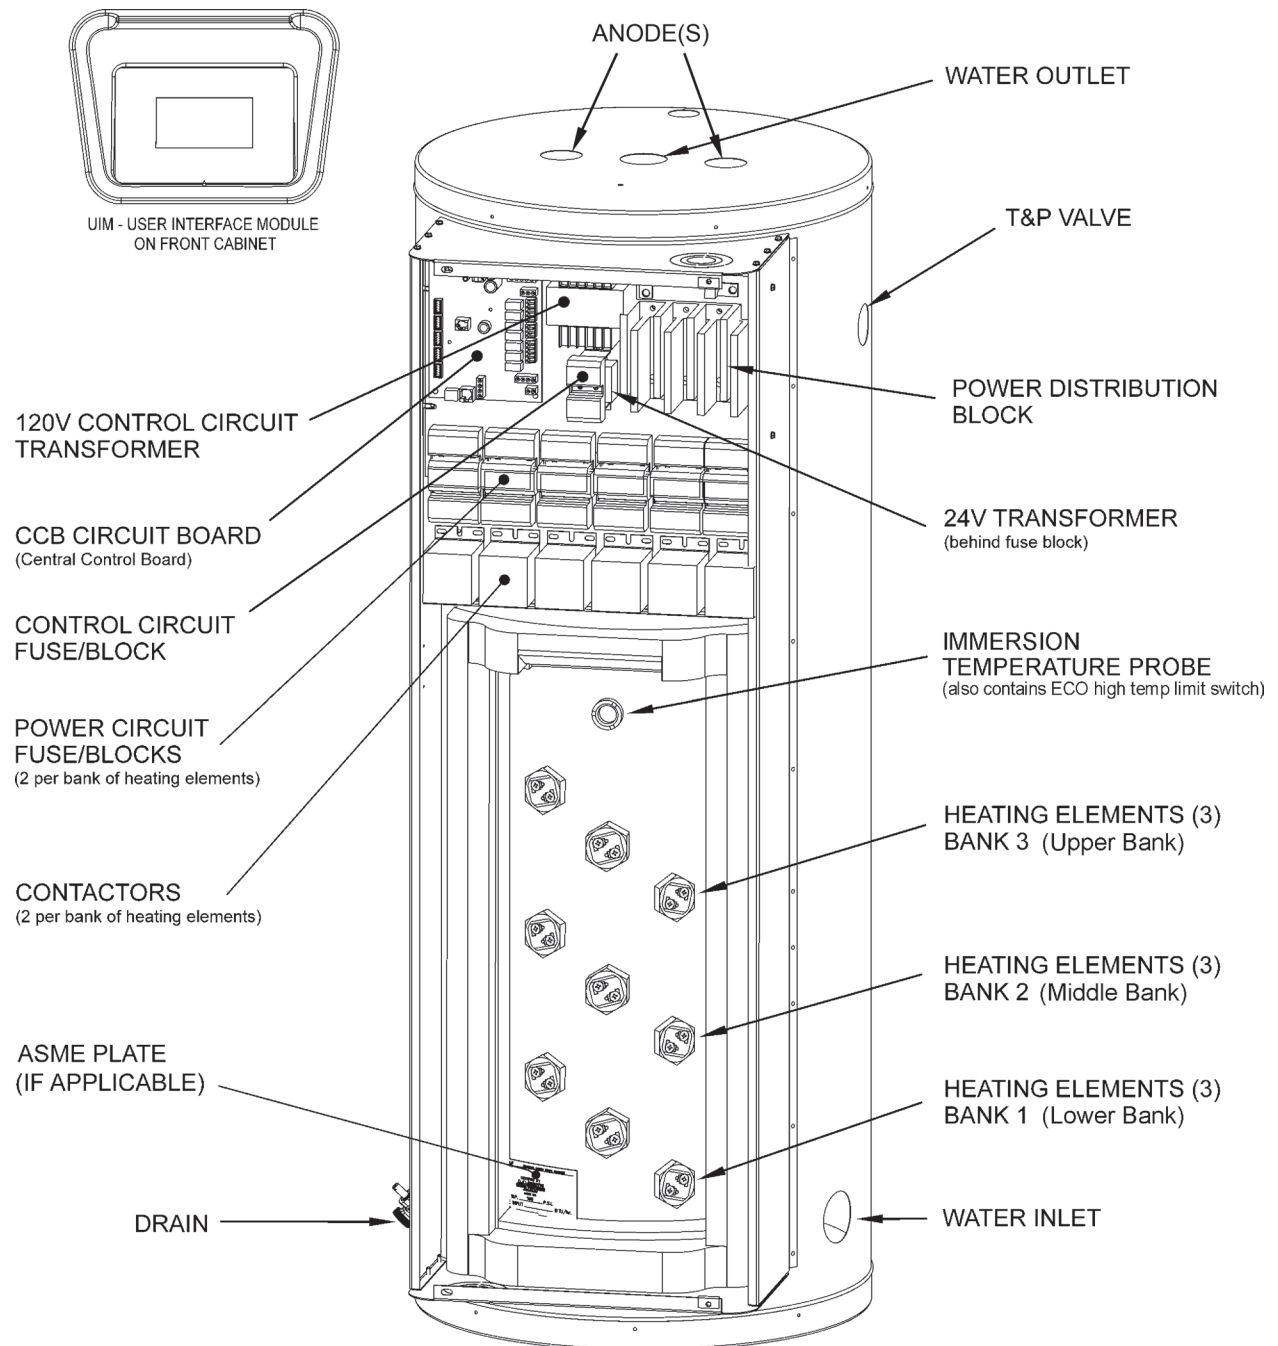


FIGURE 9.

FEATURES AND COMPONENTS

SURFACE MOUNT CONTROL MODELS

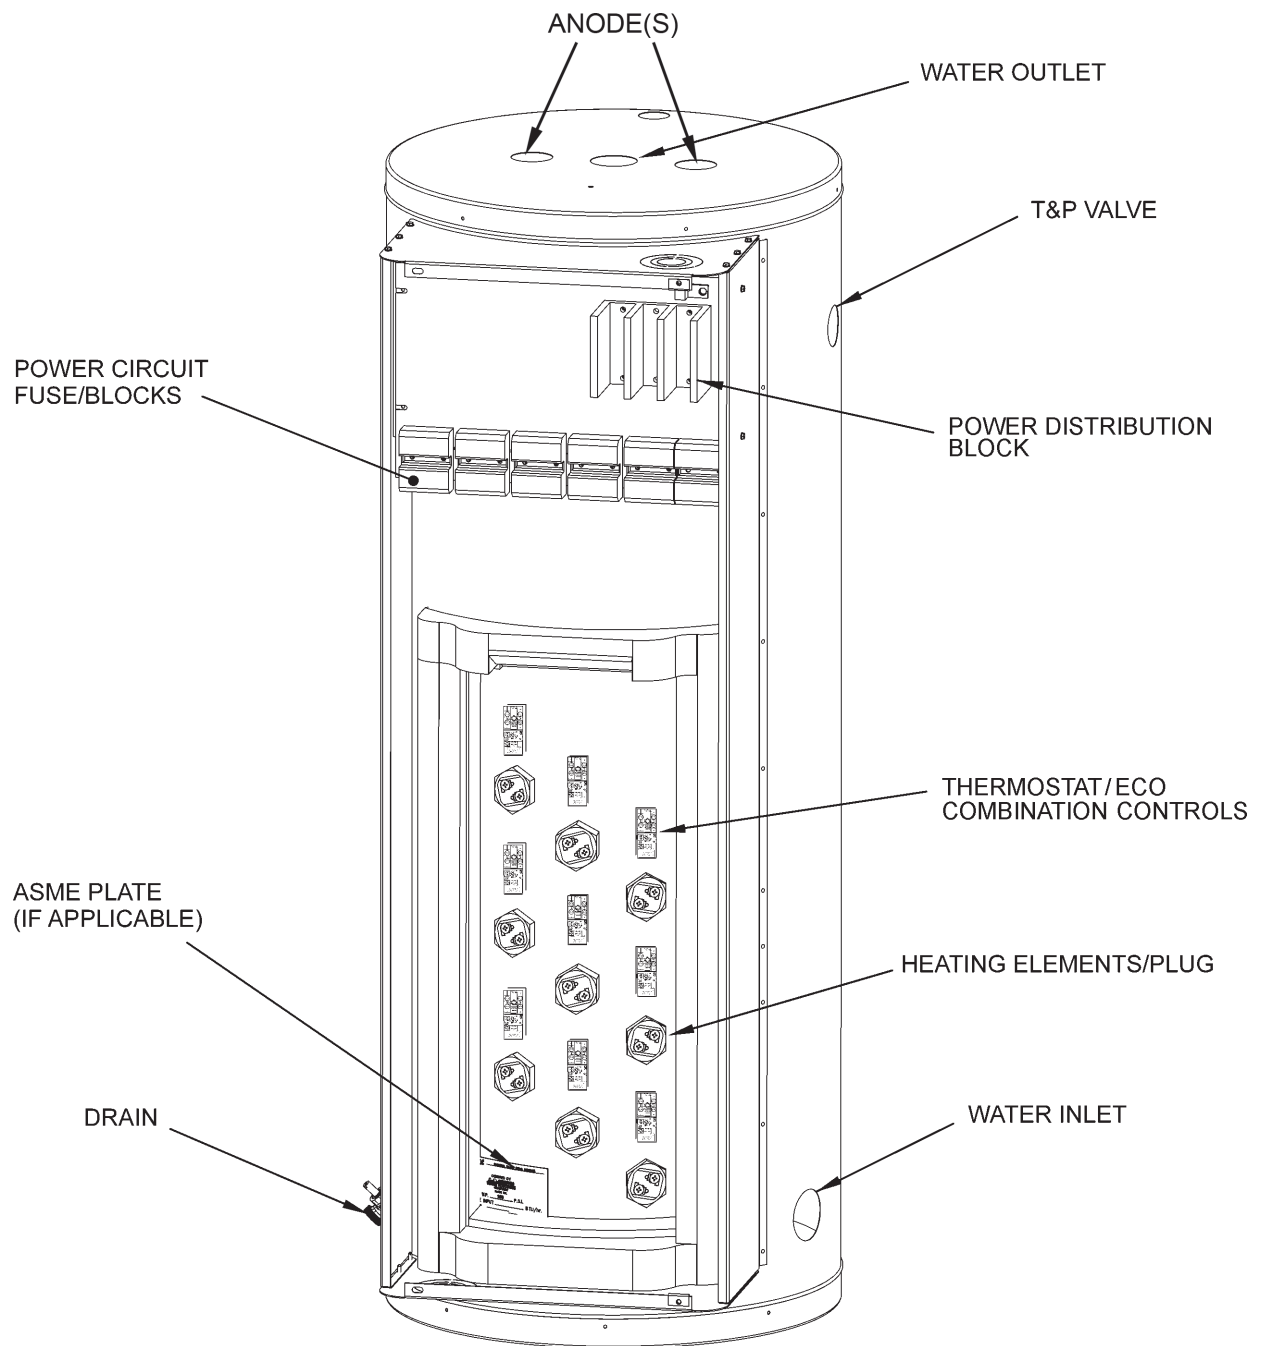



FIGURE 10.


COMMERCIAL ELECTRIC - (1 UNIT) WITH VERTICAL STORAGE TANK

WARNING: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION AND OTHER DEVICES; CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

LEGEND

- | | | | |
|---|-------------------------------------|---|----------------------|
|  | TEMPERATURE & PRESSURE RELIEF VALVE |  | FULL PORT BALL VALVE |
|  | PRESSURE RELIEF VALVE |  | CHECK VALVE |
|  | CIRCULATING PUMP |  | TEMPERATURE GAGE |
|  | TANK TEMPERATURE CONTROL |  | WATER FLOW SWITCH |
|  | DRAIN | | |

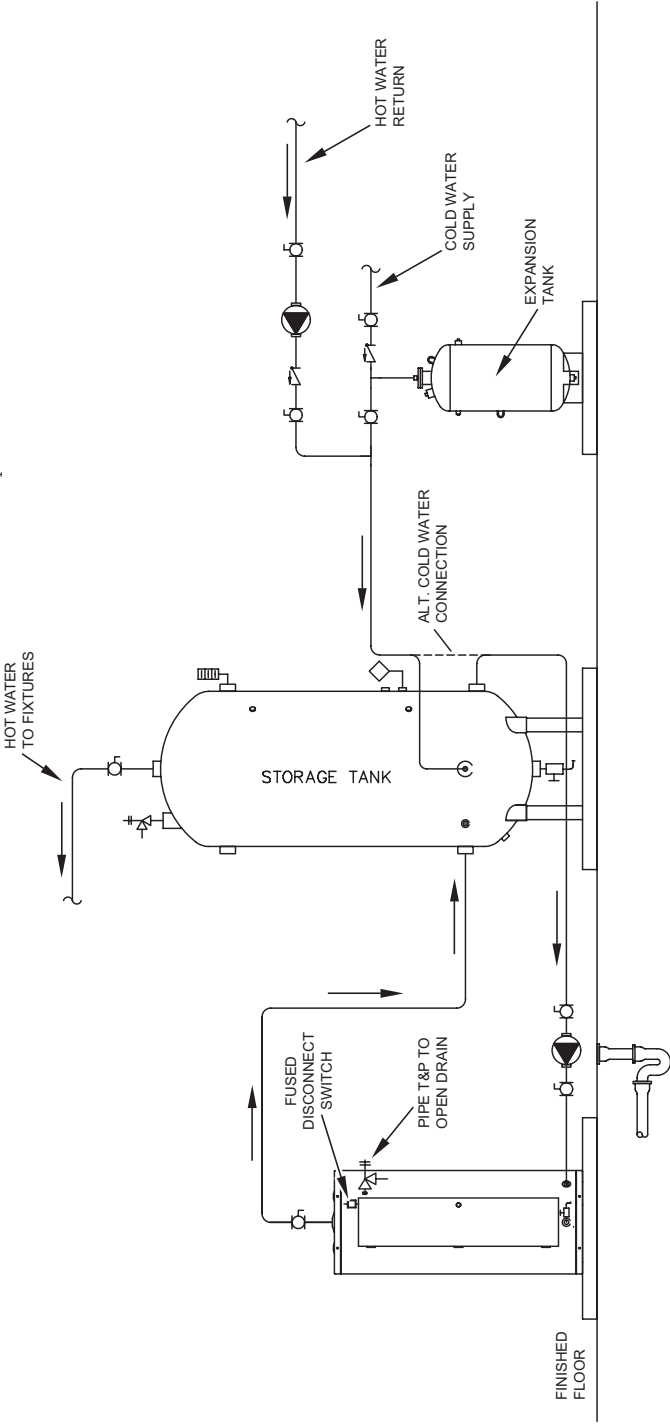

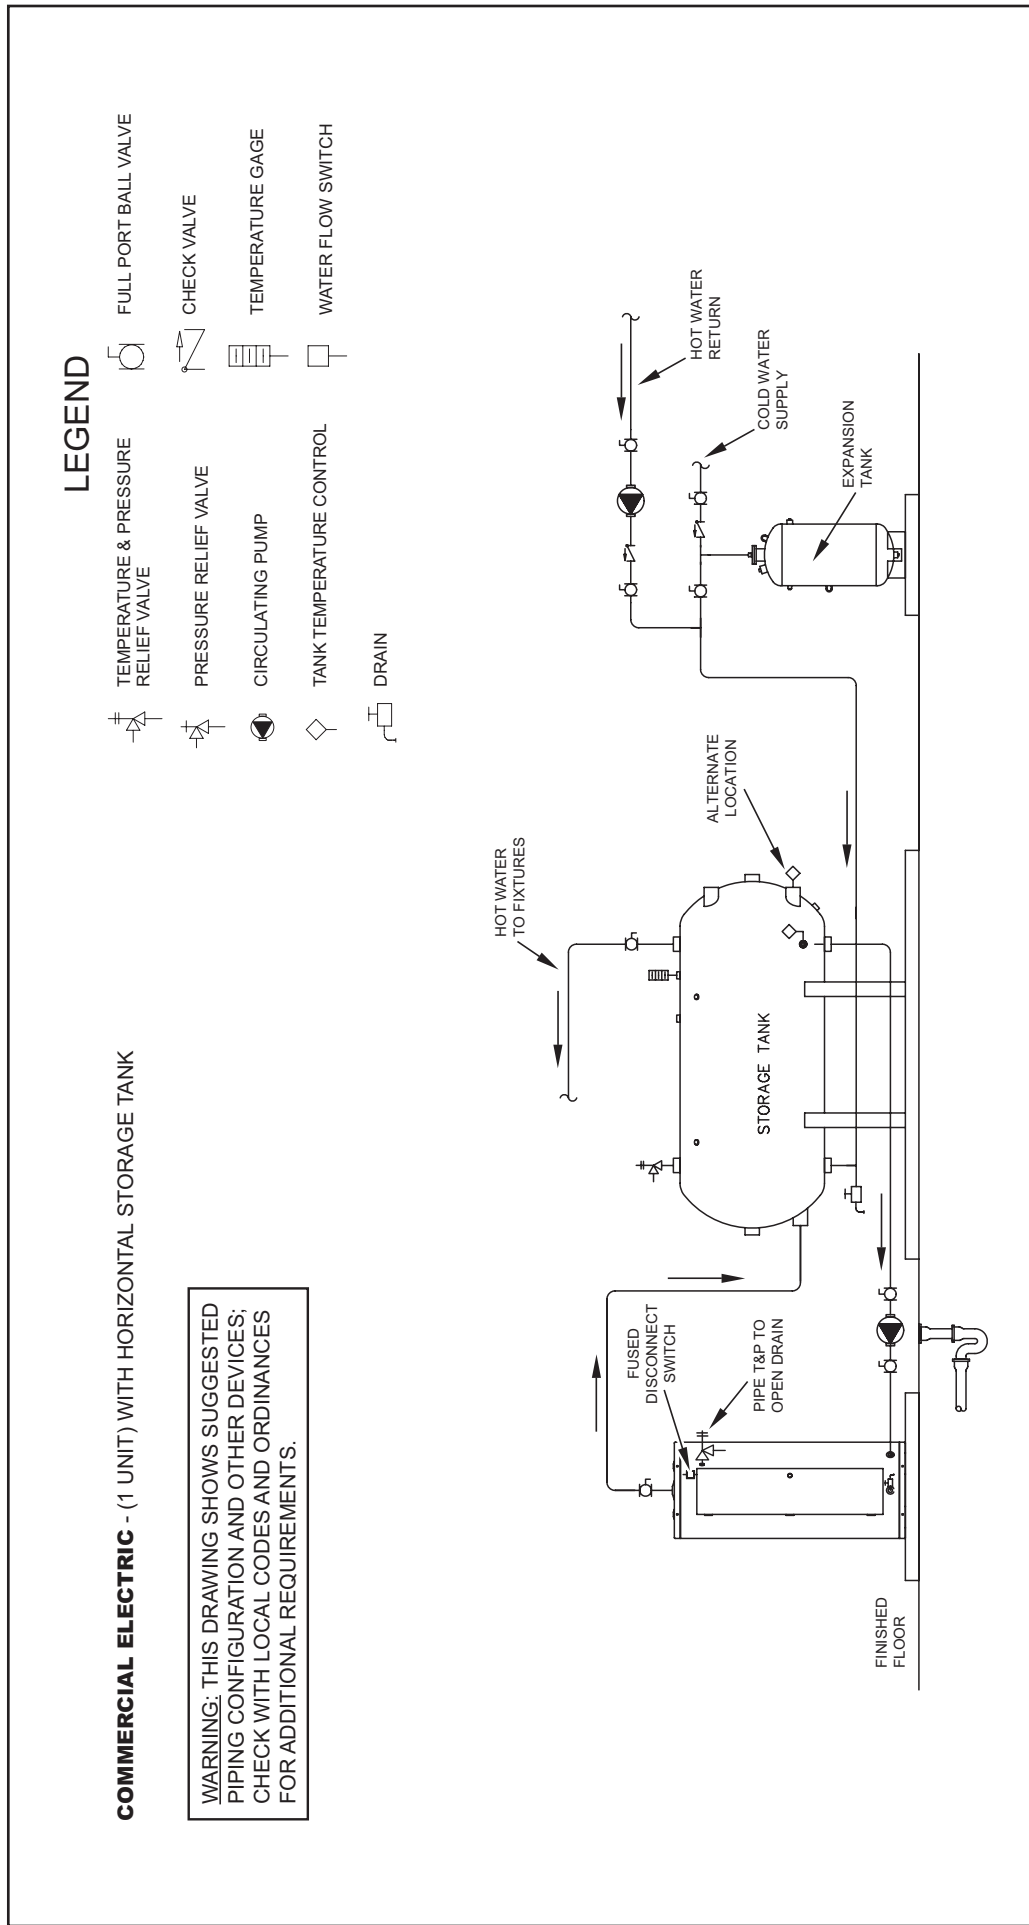


LEGEND

	TEMPERATURE & PRESSURE RELIEF VALVE		FULL PORT BALL VALVE
	PRESSURE RELIEF VALVE		CHECK VALVE
	CIRCULATING PUMP		TEMPERATURE GAGE
	TANK TEMPERATURE CONTROL		WATER FLOW SWITCH
	DRAIN		

COMMERCIAL ELECTRIC - (2 UNITS) WITH VERTICAL STORAGE TANK

WARNING: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION AND OTHER DEVICES; CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

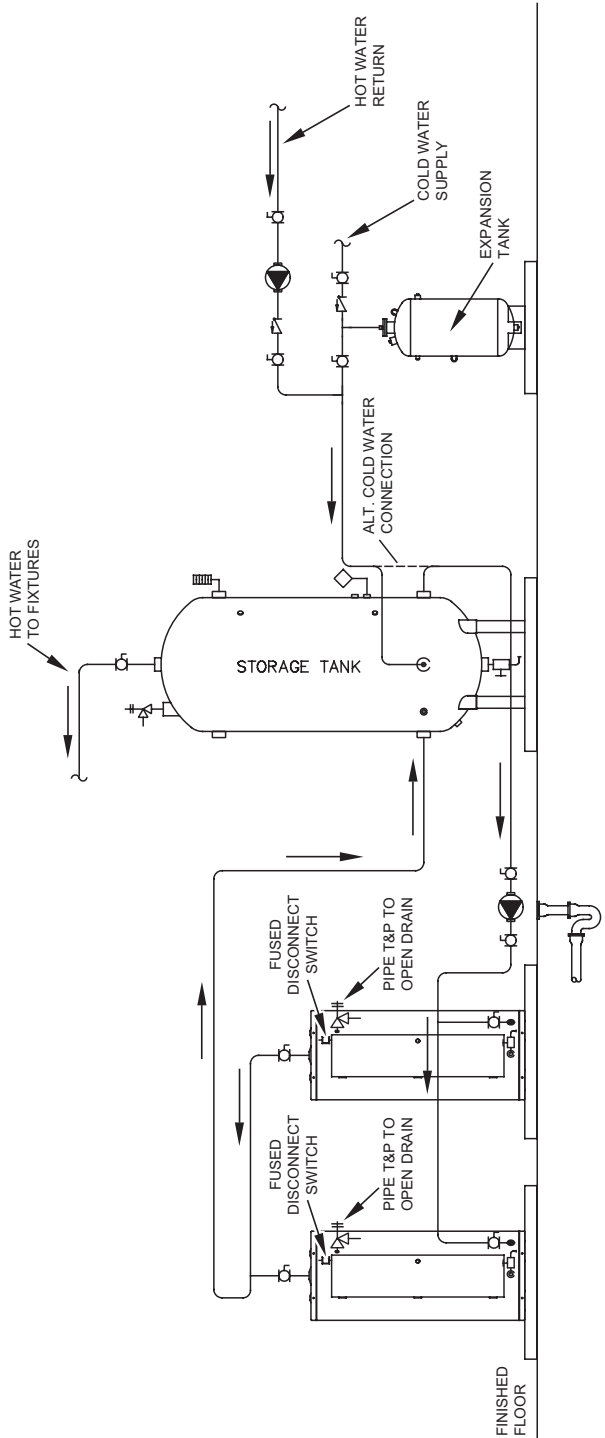



COMMERCIAL ELECTRIC - (2 UNITS) WITH HORIZONTAL STORAGE TANK

WARNING: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION AND OTHER DEVICES; CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

LEGEND

	TEMPERATURE & PRESSURE RELIEF VALVE		FULL PORT BALL VALVE
	PRESSURE RELIEF VALVE		CHECK VALVE
	CIRCULATING PUMP		TEMPERATURE GAGE
	TANK TEMPERATURE CONTROL		WATER FLOW SWITCH
	DRAIN		


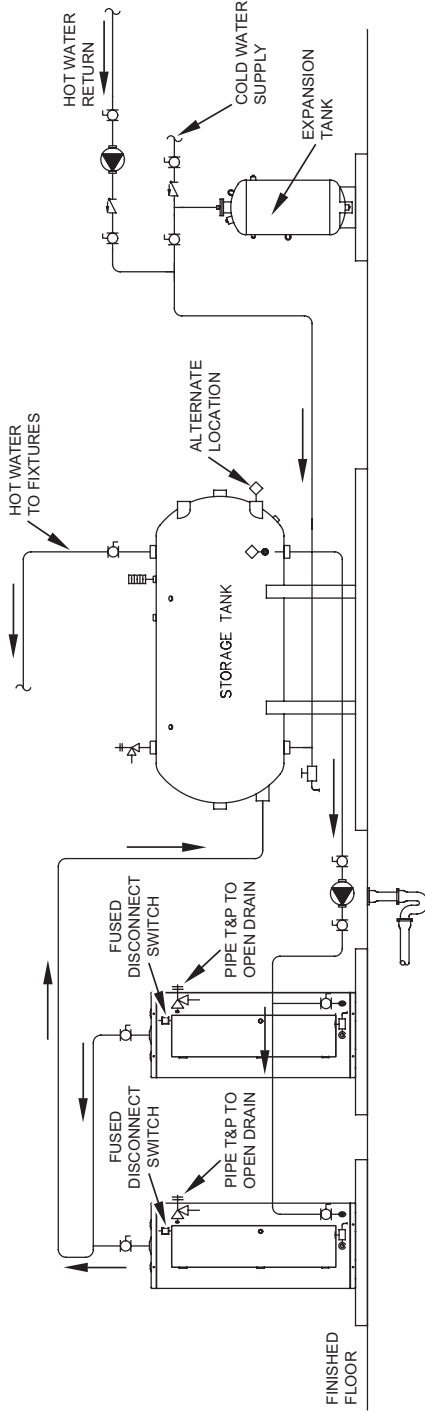


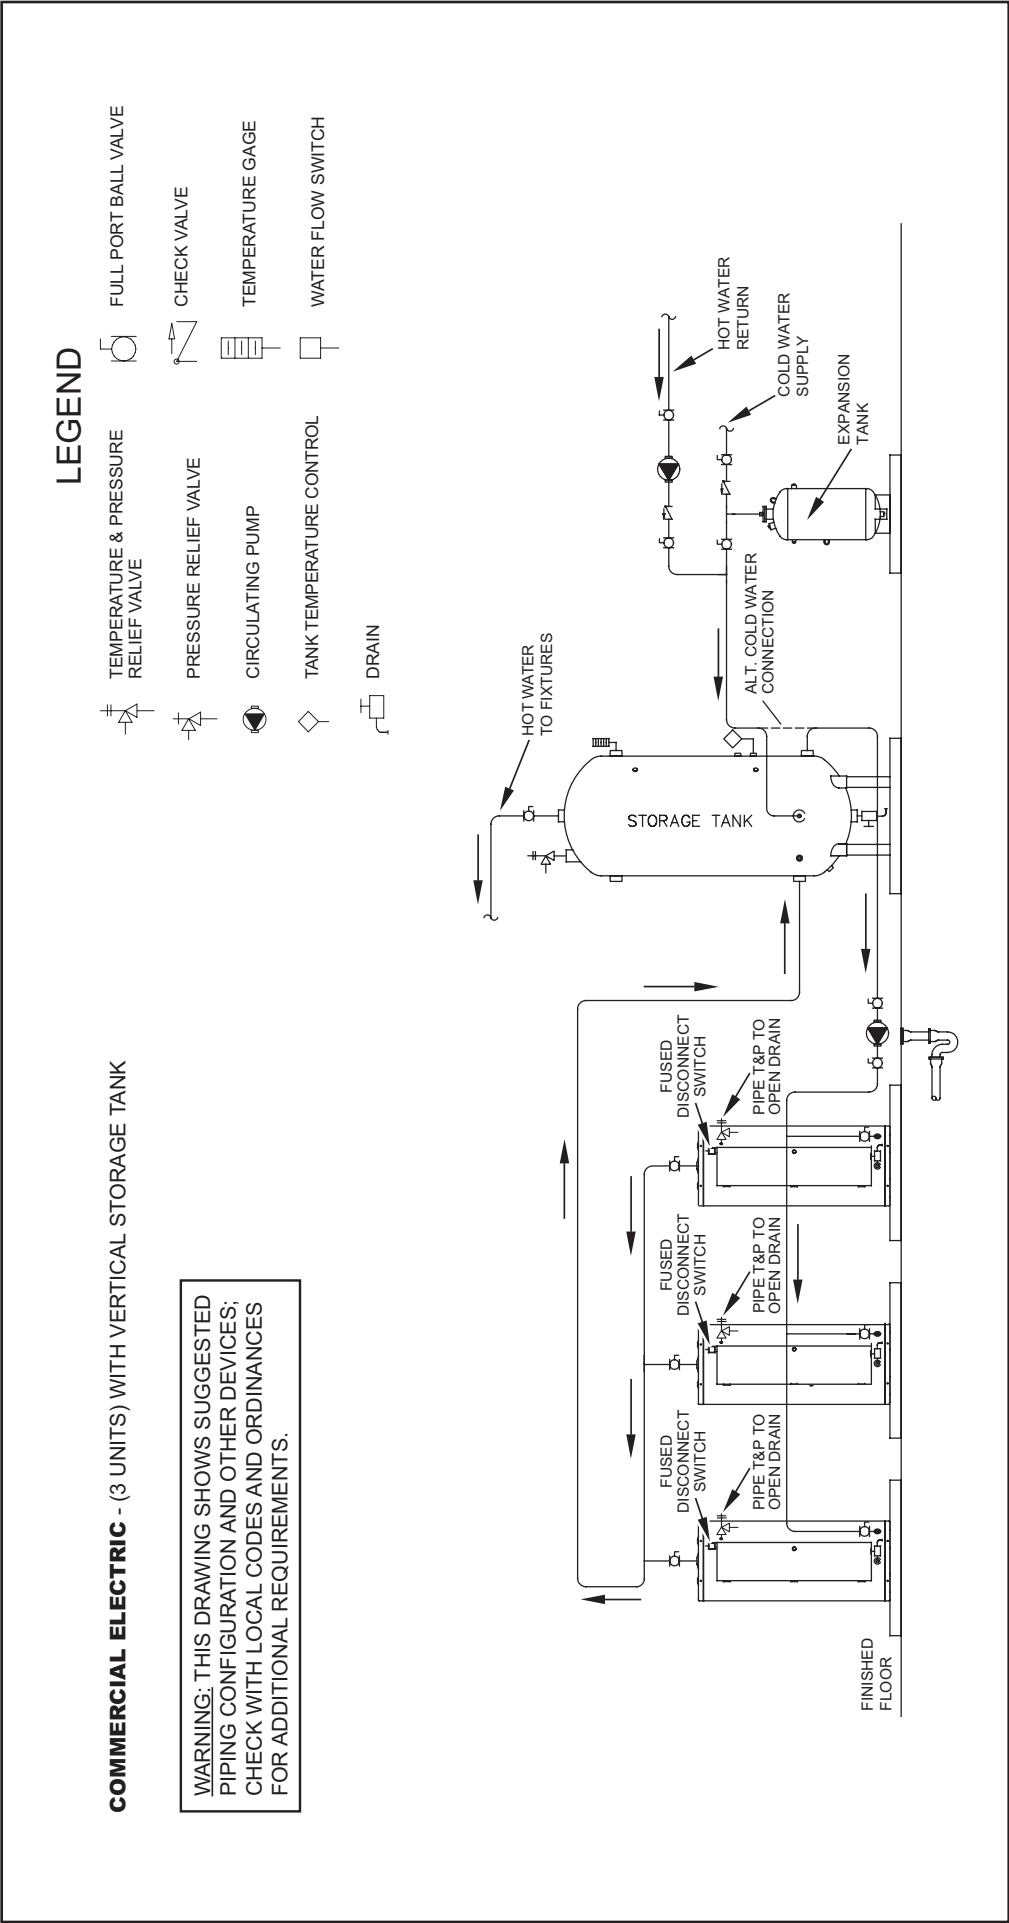

COMMERCIAL ELECTRIC - (3 UNITS) WITH HORIZONTAL STORAGE TANK

WARNING: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION AND OTHER DEVICES; CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

LEGEND

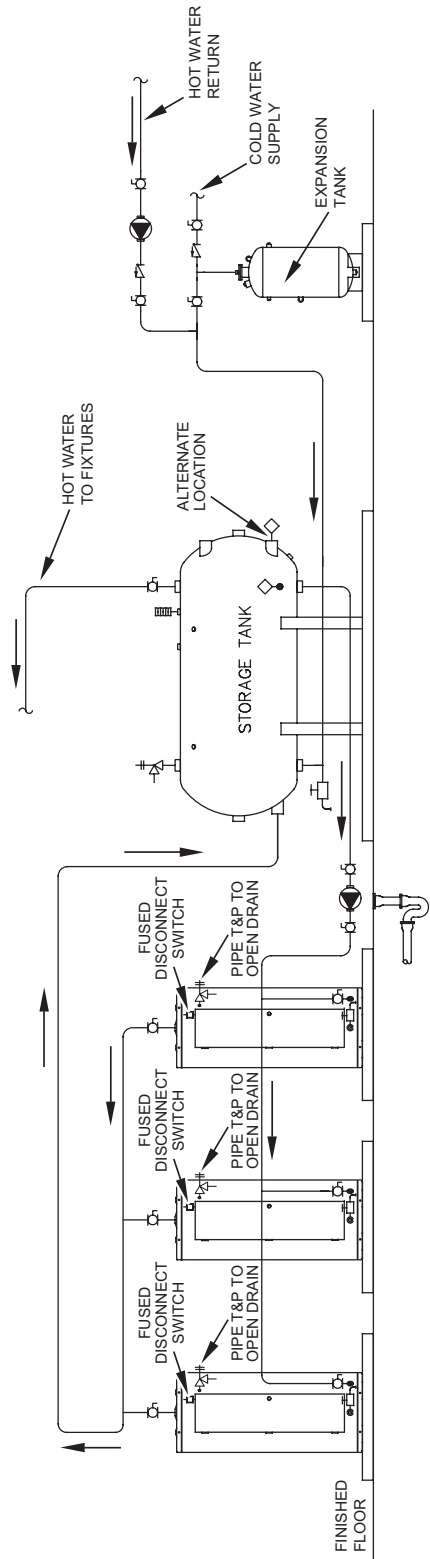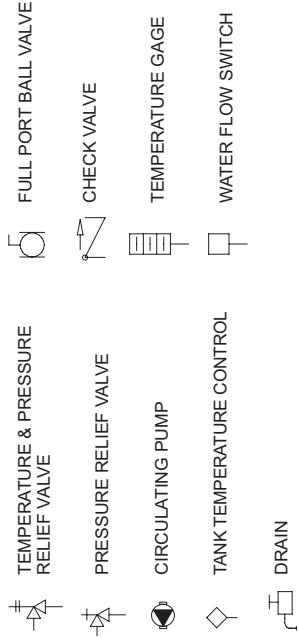


LEGEND

	TEMPERATURE & PRESSURE RELIEF VALVE		FULL PORT BALL VALVE
	PRESSURE RELIEF VALVE		CHECK VALVE
	CIRCULATING PUMP		TEMPERATURE GAGE
	TANK TEMPERATURE CONTROL		WATER FLOW SWITCH
	DRAIN		

COMMERCIAL ELECTRIC - (4 UNITS) WITH VERTICAL STORAGE TANK

WARNING: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION AND OTHER DEVICES; CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

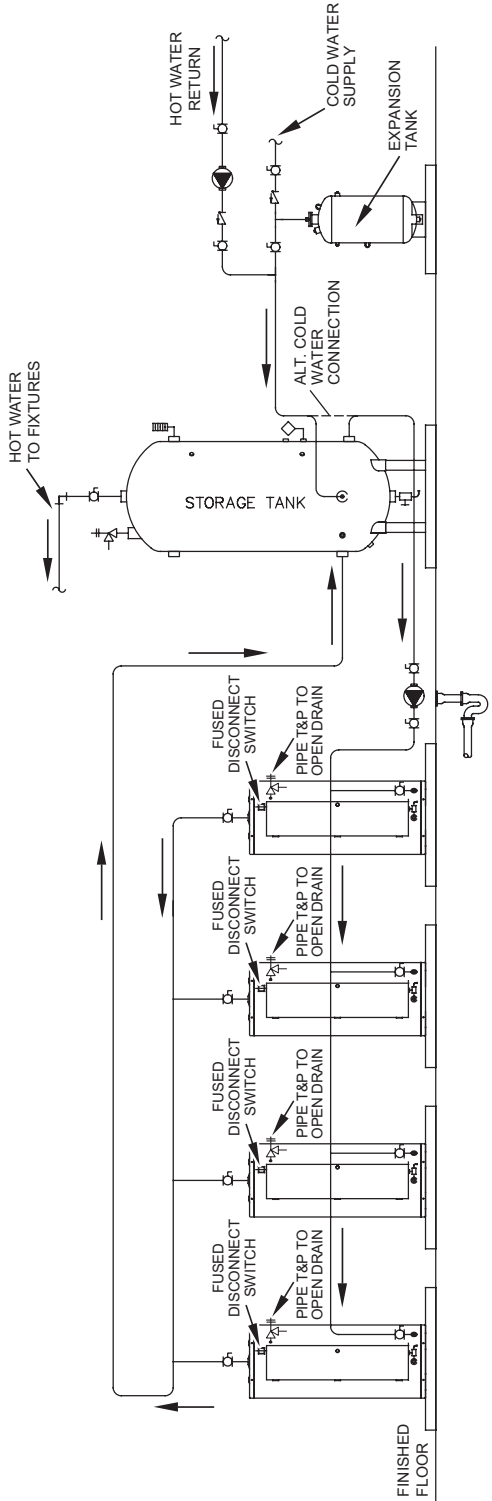


LEGEND

	TEMPERATURE & PRESSURE RELIEF VALVE		FULL PORT BALL VALVE
	PRESSURE RELIEF VALVE		CHECK VALVE
	CIRCULATING PUMP		TEMPERATURE GAGE
	TANK TEMPERATURE CONTROL		WATER FLOW SWITCH
	DRAIN		

COMMERCIAL ELECTRIC - (4 UNITS) WITH HORIZONTAL STORAGE TANK

WARNING: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION AND OTHER DEVICES; CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

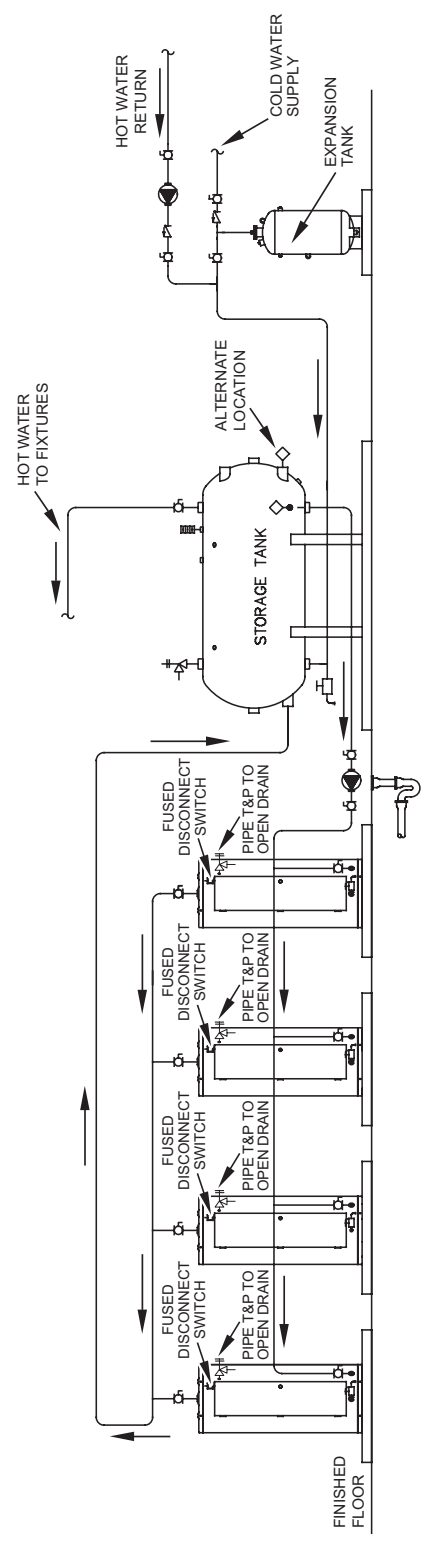


PIPING DIAGRAMS

FIGURE 11 - MANIFOLD KITS

ALL DIMENSIONS IN INCHES (millimeters)

MANIFOLD KITS


TWO HEATERS

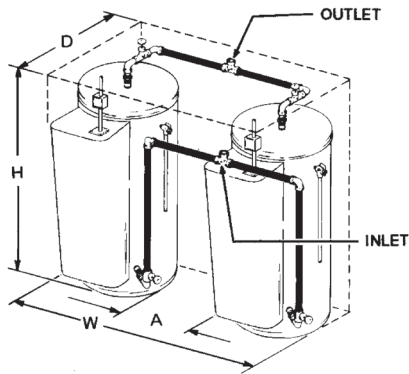

Tank Capacity gallons (liters)	Part Number	H	W	D	A
52 (189.3)	9003429205	66 1/4 (1683)	56 3/4 (1441)	27 1/4 (692)	13 1/4 (337)
80 (302.8)	9003429205	70 1/2 (1791)	60 1/4 (1530)	31 1/4 (794)	9 3/4 (248)
120 (450.5)	9003429205	73 1/4 (1861)	64 1/2 (1638)	35 3/4 (908)	5 1/2 (140)

Inlet and outlet size - 1 1/2


THREE HEATERS

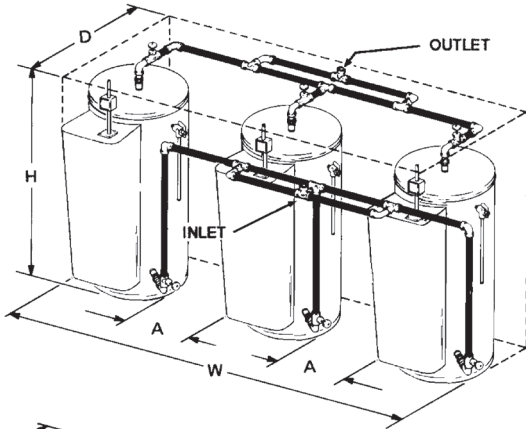

Tank Capacity gallons (liters)	Part Number	H	W	D	A
52 (189.3)	9003430205	66 1/4 (1683)	91 3/4 (2330)	27 1/4 (692)	13 1/4 (337)
80 (302.8)	9003430205	70 1/2 (1791)	95 1/4 (2419)	31 1/4 (794)	9 3/4 (248)
120 (450.5)	9003430205	73 1/4 (1861)	99 1/2 (2527)	35 3/4 (908)	5 1/2 (140)

Inlet and outlet size - 2 1/2

FOUR HEATERS

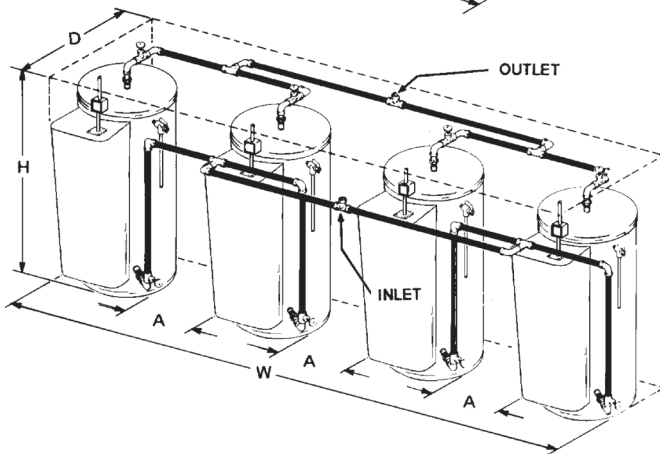

Tank Capacity gallons (liters)	Part Number	H	W	D	A
52 (189.3)	9003431205	66 1/4 (1683)	126 3/4 (3219)	27 1/4 (692)	13 1/4 (337)
80 (302.8)	9003431205	70 1/2 (1791)	130 1/4 (3308)	31 1/4 (794)	9 3/4 (248)
120 (450.5)	9003431205	73 1/4 (1861)	134 1/2 (3416)	35 3/4 (908)	5 1/2 (140)

Inlet and outlet size - 2 1/2

NOTES

NOTES

NOTES

Limited Warranty

State Water Heaters, the warrantor, extends the following LIMITED WARRANTY to the owner of this water heater.

1. THE TANK

If the glass-lined tank in this water heater shall prove upon examination by the warrantor to have leaked due to natural corrosion from potable water therein, during the first THREE years after initial installation, the warrantor will supply a complete new State water heater of equivalent size and current model. Some government agencies are requiring energy efficient standards for water heaters. In the event regulations prohibit sale of a model of equivalent size and construction, State will provide a model which complies with the regulations of your area, in which case the consumer will be charged the difference in price between the like replacement and the energy efficient model required. The warranty on the replacement water heater will be limited to the unexpired term of the original warranty.

2. ALL OTHER PARTS

If within ONE year after initial installation of this water heater, any part or portion shall prove upon examination by the warrantor to be defective in material or workmanship, the warrantor will repair or replace such part or portion at its option.

3. CONDITIONS AND EXCEPTIONS

This warranty shall apply only when the water heater is installed in accordance with local plumbing and building codes, ordinances and regulations, the printed instructions provided with it and good industry practices. In addition, a temperature and pressure relief valve, certified by and officially sanctioned and recognized independent testing agency and approved by the American Society of Mechanical Engineers, must have been installed.

a. This warranty shall apply only when the heater is:

- (1) used at temperatures not exceeding the maximum calibrated setting of its thermostat;
- (2) used at water pressure not exceeding the working pressure shown on the heater;
- (3) filled with potable water, free to circulate at all times and with the tank free of damaging water sediment or scale deposits;
- (4) used in a non-corrosive and non-contaminated atmosphere;
- (5) used with factory approved anode rod(s) installed;
- (6) in its original installation location;
- (7) in the United States, its territories or possessions or Canada;
- (8) sized in accordance with proper sizing techniques for commercial and/or residential water heaters;
- (9) bearing a rating plate which has not been altered, defaced or removed, except as required by the warrantor;
- (10) used in an open system or in a closed system with properly sized and installed thermal expansion tank;
- (11) operated with properly installed sediment trap;
- (12) fired with the fuel for which it was factory built;
- (13) fired at the factory rated input;
- (14) operated with the inner and outer combustion chamber doors in place.

b. Any accident to the water heater, any misuse, abuse (including freezing or thermal expansion damage) or alteration of, any operation in a modified form, or any attempt to repair tank leaks will void this warranty.

c. This warranty is void if a device acting as a backflow prevention device (check valves etc.) is installed in the cold water supply the heater is connected to, unless an effective method of controlling thermal expansion is also installed at the heater(s) and operational at all times. The temperature and pressure relief valve installed on the heater is not an acceptable method.

4. SERVICE AND REPAIR EXPENSES

Under the limited warranty the warrantor will provide only a replacement water heater or part thereof. The owner is responsible for all other costs. Such costs may include but are not limited to:

- a. Labor charges for service removal, repair or reinstallation of the water heater or any component part;
- b. Shipping, delivery, handling, and administrative charges for forwarding the new heater or replacement part from the nearest distributor and returning the claimed defective heater or part to such distributor.
- c. All cost necessary or incidental for any material and/or permits required for installation of the replacement heater or part.

5. LIMITATIONS ON IMPLIED WARRANTIES

Implied warranties, including the warranty of merchantability imposed on the sale of this heater under state law or local code are limited to one (1) year duration for the heater or any of its parts. Some areas do not allow limitation on how long an implied warranty lasts, so the above limitation may not apply to you.

6. CLAIM PROCEDURE

Any claim under the warranty should be initiated with the dealer who sold the heater, or with any other dealer handling the warrantor's products. If this is not practicable, the owner should contact:

U.S. Customers
State Industries, Inc.
500 Tennessee Waltz Parkway
Ashland City, TN 37015
Telephone: (800) 365-0024

- a. The warrantor will only honor replacement with identical or similar water heater or parts thereof which are manufactured or distributed by the warrantor.
- b. Dealer replacements are made subject to in-warranty validation by warrantor.

7. DISCLAIMERS

NO OTHER EXPRESS WARRANTY HAS BEEN OR WILL BE MADE IN BEHALF OF THE WARRANTOR WITH RESPECT TO THE MERCHANTABILITY OF THE HEATER OR THE INSTALLATION, OPERATION, REPAIR OR REPLACEMENT OF THE HEATER. THE WARRANTOR SHALL NOT BE RESPONSIBLE FOR WATER DAMAGE, LOSS OF USE OF THE UNIT, INCONVENIENCE, LOSS OR DAMAGE TO PERSONAL PROPERTY OR OTHER CONSEQUENTIAL DAMAGE. THE WARRANTOR SHALL NOT BE LIABLE BY VIRTUE OF THIS WARRANTY OR OTHERWISE FOR DAMAGE TO ANY PERSONS OR PROPERTY, WHETHER DIRECT OR INDIRECT, AND WHETHER ARISING IN CONTRACT OR IN TORT.

- a. Some areas do not allow the exclusion or limitation of the incidental or consequential damage, so the above limitations or exclusions may not apply to you.
- b. This warranty gives you specific legal rights, and you may also have other rights which vary from area to area.

Fill in the following for your own reference. Keep it. Registration is not a condition of warranty. The model and serial number are found on the heater's rating plate.

Model No. _____ Serial No. _____ Date Installed _____

Dealer's Name _____

Dealer's Address _____ Phone No. _____

City and State _____ Zip _____

KEEP THIS WARRANTY POSTED ADJACENT TO THE HEATER FOR FUTURE REFERENCE.



500 Tennessee Waltz Parkway, Ashland City, TN 37015
Technical Support: 800-365-8170 • Parts: 800-821-2017
www.statewaterheaters.com



500 Tennessee Waltz Parkway, Ashland City, TN 37015
الدعم الفني: ٨٠٠-٣٦٥-٨١٧ • الأجزاء: ٨٠٠-٨٢١-٢٠١٧

www.statewaterheaters.com

جميع الحقوق محفوظة © State Industries, Inc. ٢٠١٢ للشركة


كافة الأبعاد بوحدة المتر (الميلليمتر)

مجموعات المشغبات

سحائين

A	D	W	H	رقم الصنف	سعة الجزان جالون (لتر)
13 1/4	27 1/4	56 3/4	66 1/4	9003429205	52 (189.3)
9 3/4	31 1/4	60 1/4	70 1/2	9003429205	80 (302.8)
(248)	(794)	(1530)	(1791)	9003429205	
5 1/2	35 3/4	64 1/2	73 1/4	9003429205	120 (450.5)
(140)	(908)	(1638)	(1861)		


حجم الإحطال والإجراج - 1-1/2

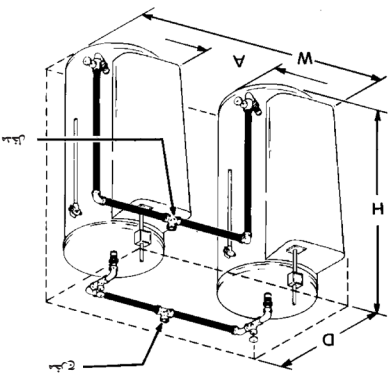

ثلاث سحائات

A	D	W	H	رقم الصنف	سعة الجزان جالون (لتر)
13 1/4	27 1/4	91 3/4	66 1/4	9003430205	52 (189.3)
9 3/4	31 1/4	95 1/4	70 1/2	9003430205	80 (302.8)
(248)	(794)	(2419)	(1791)	9003430205	
5 1/2	35 3/4	99 1/2	73 1/4	9003430205	120 (450.5)
(140)	(908)	(2527)	(1861)		


حجم الإحطال والإجراج - 2-1/2

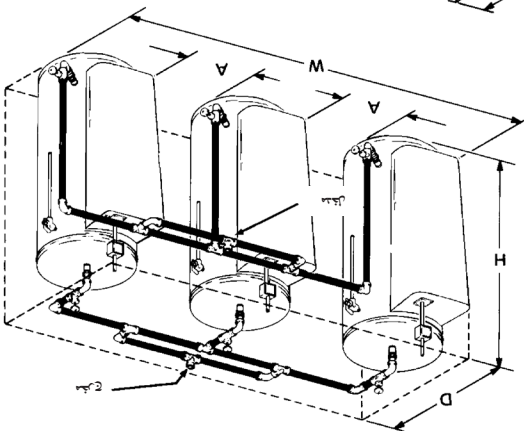

أربعة سحائات

A	D	W	H	رقم الصنف	سعة الجزان جالون (لتر)
13 1/4	27 1/4	126 3/4	66 1/4	9003431205	52 (189.3)
9 3/4	31 1/4	130 1/4	70 1/2	9003431205	80 (302.8)
(248)	(794)	(3308)	(1791)	9003431205	
5 1/2	35 3/4	134 1/2	73 1/4	9003431205	120 (450.5)
(140)	(908)	(3416)	(1861)		

حجم الإحطال والإجراج - 2-1/2

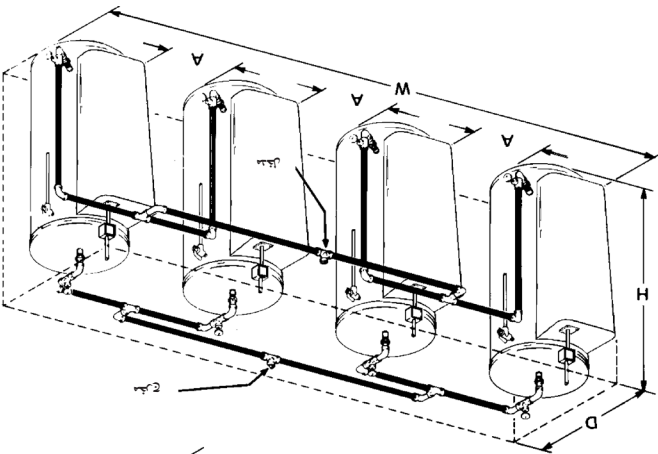


السخان الكهربائي التجاري - (4 وحدة) بخزان أفقي

تحذير: يوضح هذا الرسم تكوينات المواسير المقترحة والأجهزة الأخرى؛ راجع القوانين المحلية والتنظيمات للتعرف على المتطلبات الإضافية

المفتاح

	محبس تنقيس الحرارة والضغط		محبس كروي بالمنفذ بالكامل
	محبس تنقيس الضغط		محبس فحص
	مضخة التوزيع		عداد الحرارة
	وحدة التحكم في حرارة الخزان		مفتاح تدفق الماء
	الصرف		

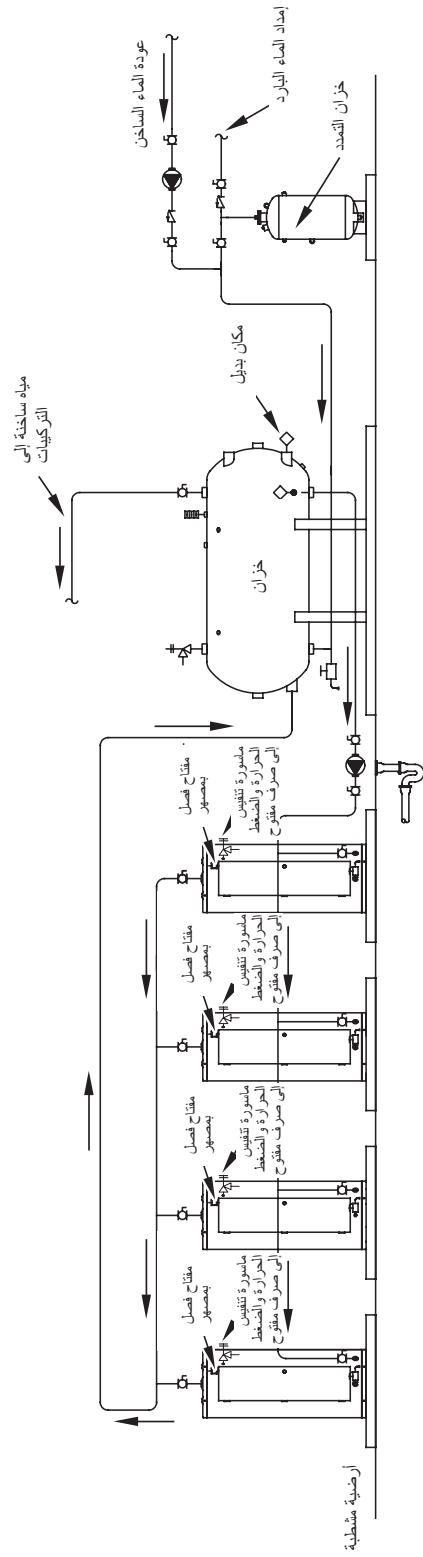


السخان الكهربائي التجاري - (4 وحدات) بخزان رأسي

تحذير: يوضح هذا الرسم تكوينات المواسير المقترحة والأجهزة الأخرى؛ راجع القوانين المحلية والتنظيمات للتعرف على المتطلبات الإضافية

المفتاح

	مياه سائخة إلى التركيبات		محبس تنقيس الحرارة والضغط		محبس كروري للمنفذ بالكامل
	محبس تنقيس الضغط		محبس تنقيس الضغط		محبس فحص
	مضخة التدوير		مضخة التدوير		عداد الحرارة
	وحدة التحكم في حرارة الخزان		وحدة التحكم في حرارة الخزان		مفتاح تدفق الماء
	الصرف		الصرف		

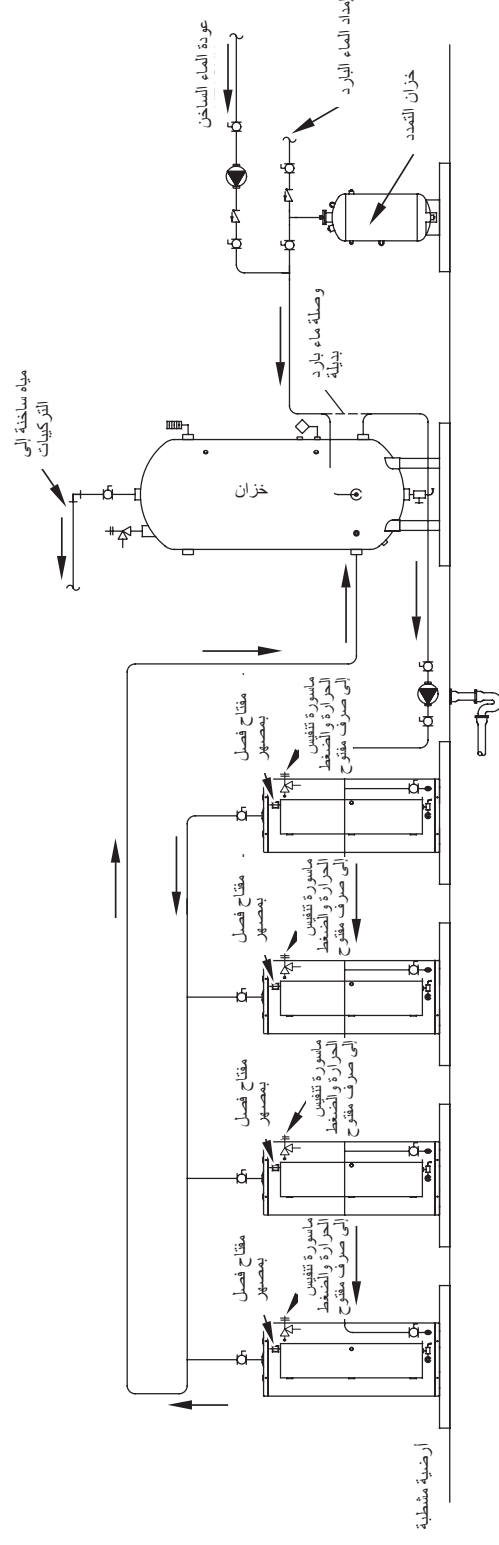


السخان الكهربائي التجاري - (3 وحدات) بخزان أفقي

تحذير: يوضح هذا الرسم تكوينات المواسير المقترحة والأجهزة الأخرى؛ راجع القوانين المحلية والتنظيمات للتعرف على المتطلبات الإضافية

المفتاح



	محبس تنقيس الحرارة والضغط		محبس كروي للمنفذ بالكامل
	محبس تنقيس الضغط		محبس فحص
	مضخة التدوير		عداد الحرارة
	وحدة التحكم في حرارة الخزان		مفتاح تنفّج الماء
	الصرف		

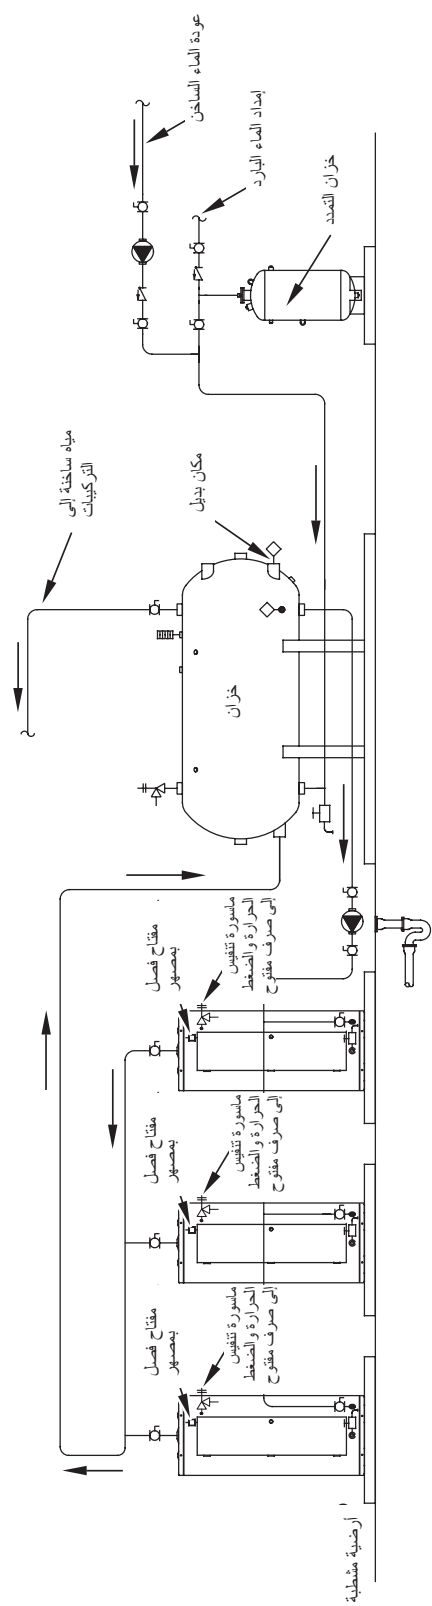

السخان الكهربائي التجاري - (3 وحدات) بخزان رأسي

تحذير: يوضح هذا الرسم تكوينات المواسير المقترحة والأجهزة الأخرى؛ راجع القوانين المحلية والتنظيمات للتعرف على المتطلبات الإضافية



المفتاح

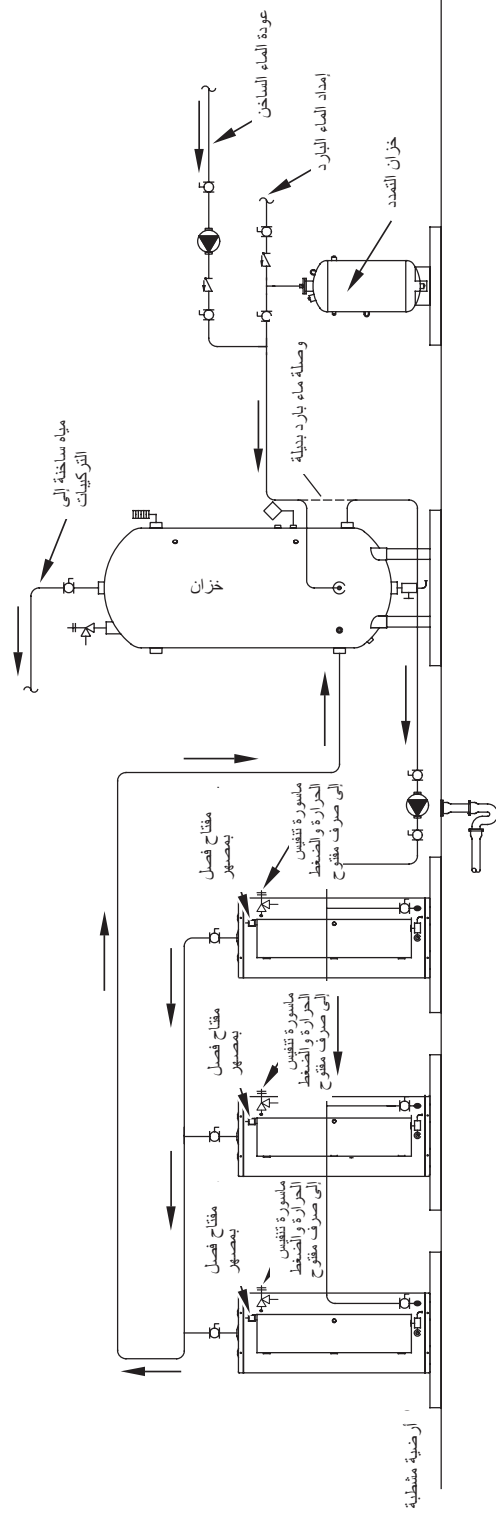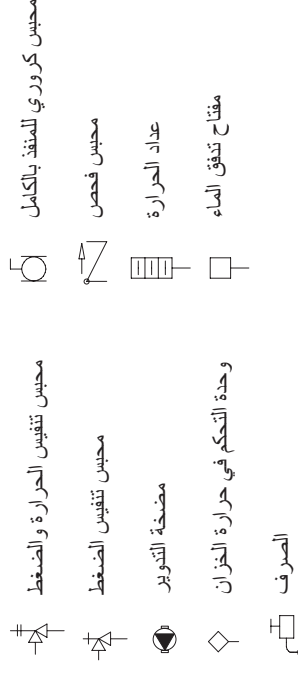

السخان الكهربائي التجاري - (2 وحدة) بخزان أفقي

تحذير: يوضح هذا الرسم تكوينات المسار المقترحة والأجهزة الأخرى، راجع القوانين المحلية والتنظيمات للتعرف على المتطلبات الإضافية



المفتاح

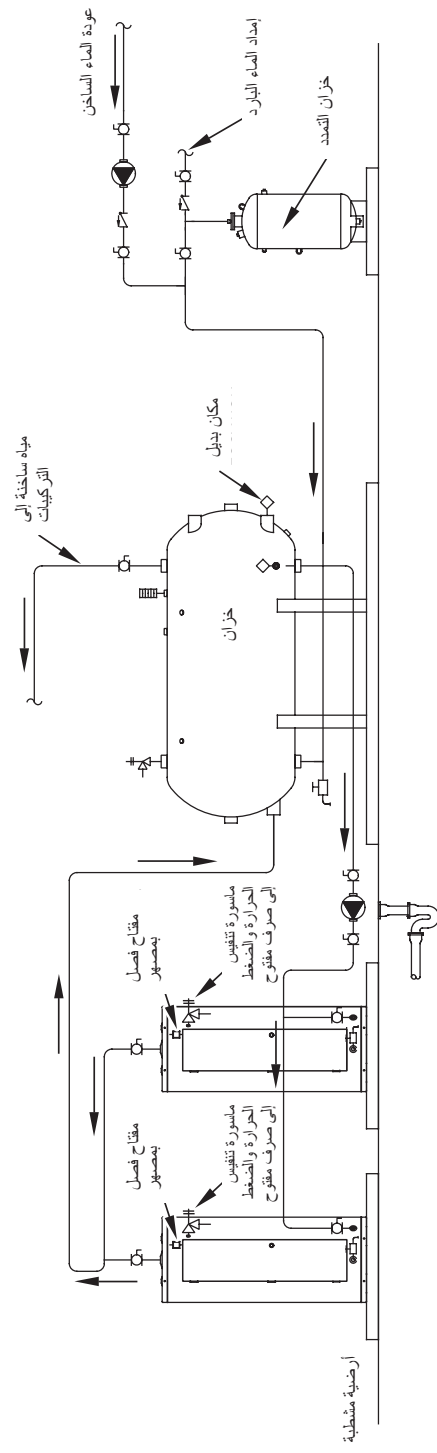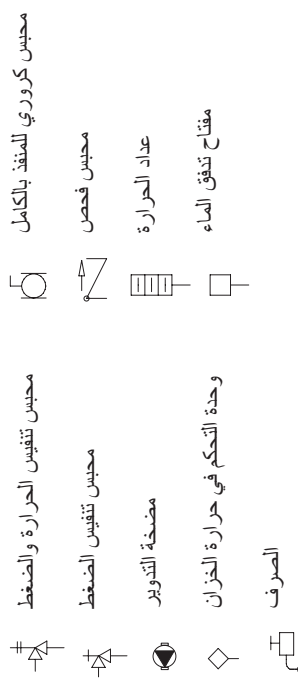

السخان الكهربائي التجاري - (2 وحدة) بخزان رأسي

تحذير: يوضح هذا الرسم تكوينات المسابير المقترحة والأجهزة الأخرى؛ راجع القوانين المحلية والتنظيمات للتعرف على المتطلبات الإضافية



المفتاح

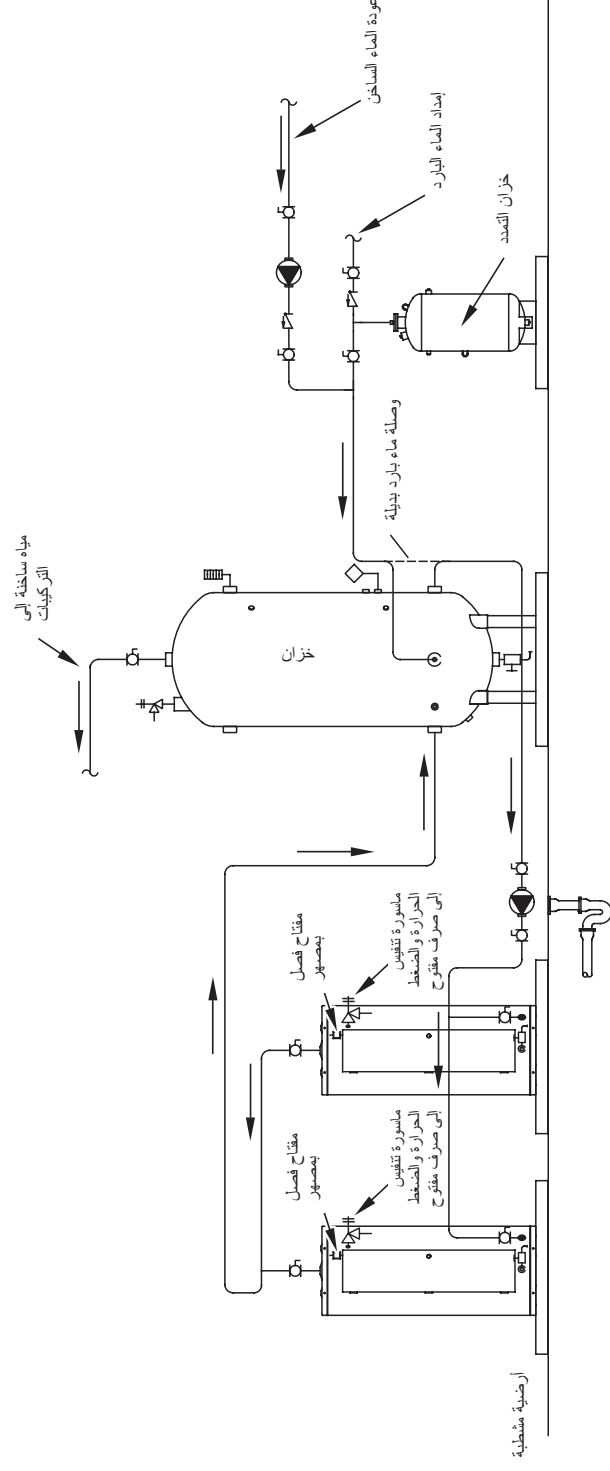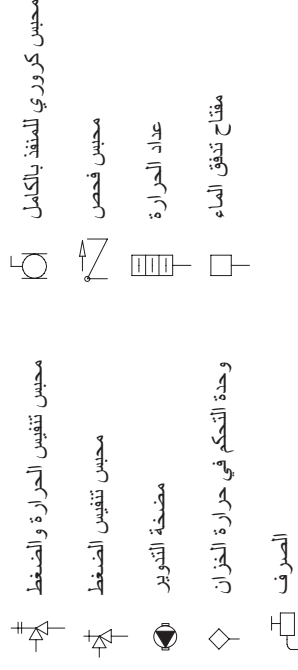

السخان الكهربائي التجاري - (1 وحدة) بخزان أفقي

تحذير: يوضح هذا الرسم تكوينات المواسير المقترحة والأجهزة الأخرى؛ راجع القوانين المحلية والتنظيمات للتعرف على المتطلبات الإضافية



المفتاح

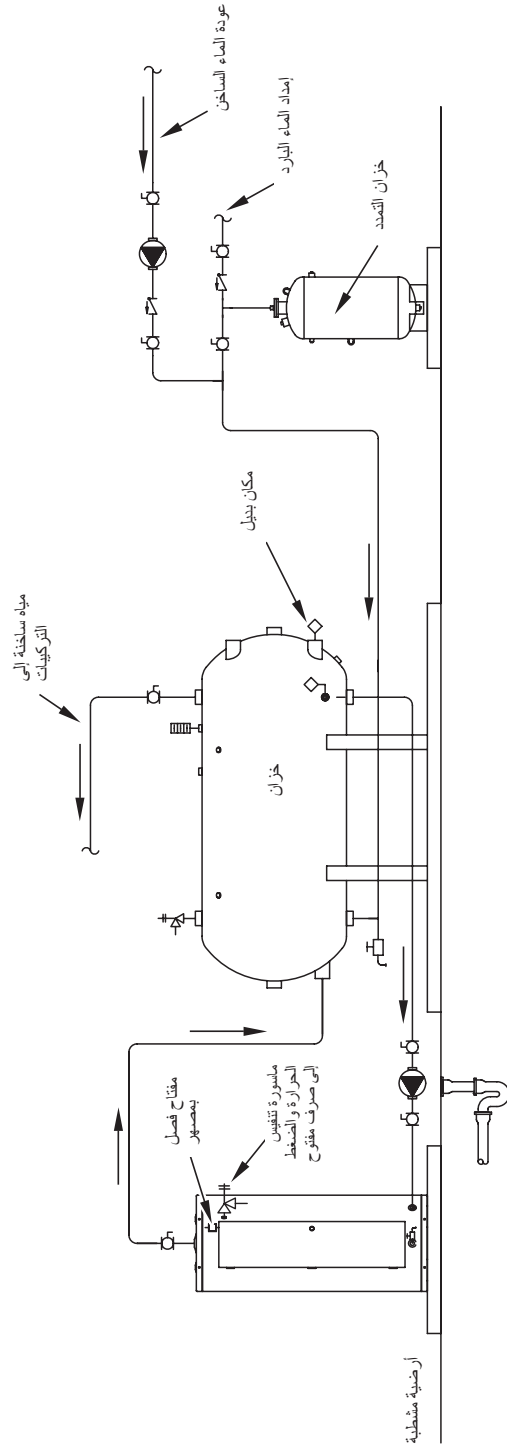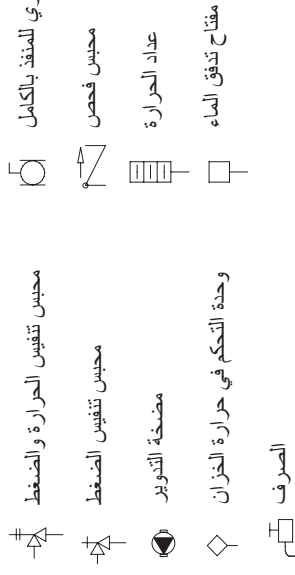


السخان الكهربائي التجاري - (1 وحدة) بخزان رأسي

تحذير: يوضح هذا الرسم تكوينات المواسير المقترحة والأجهزة الأخرى؛ راجع القوانين المحلية والتنظيمات للتعرف على المتطلبات الإضافية.

المفتاح

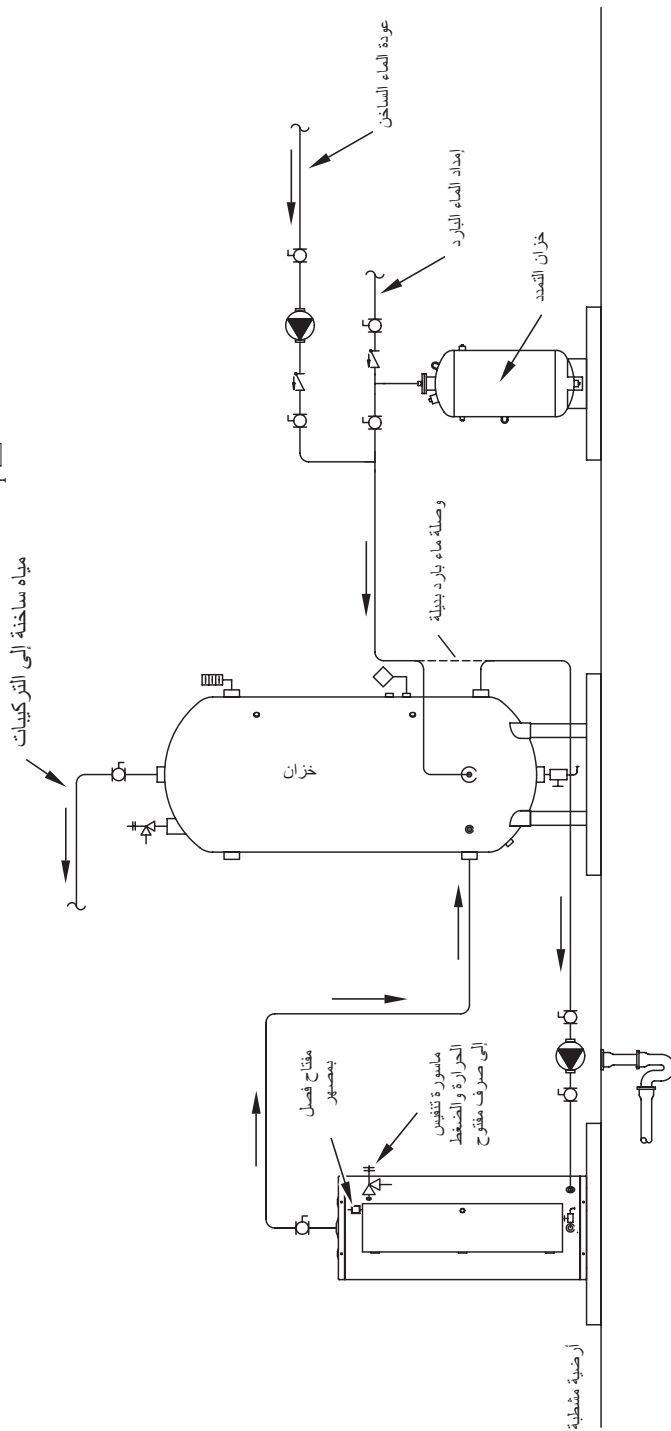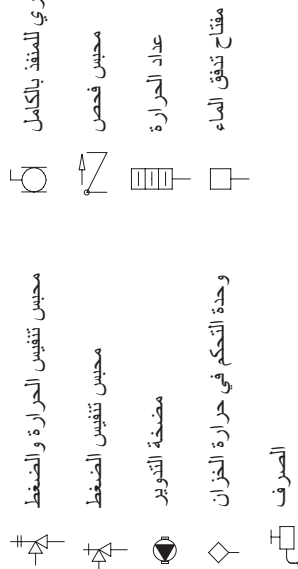


الطعن 10.

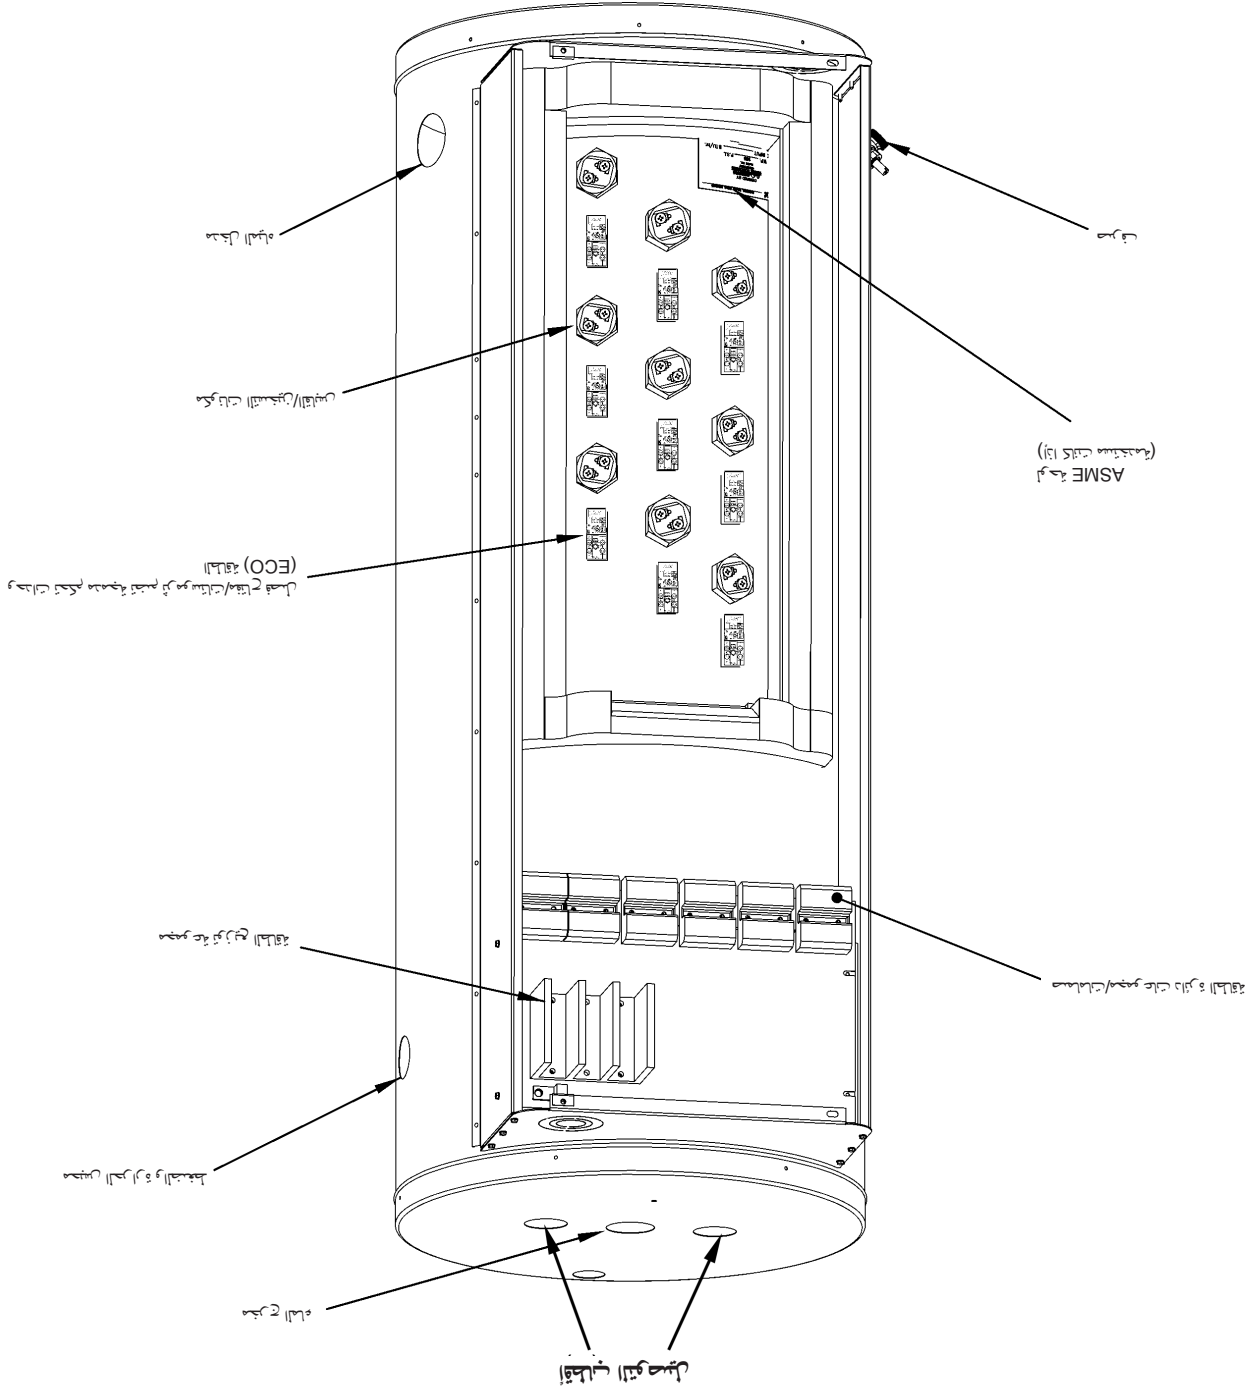

الطرازات ذات تحكم ميكانيكي على السطح

الطرازات ذات تحكم إلكتروني

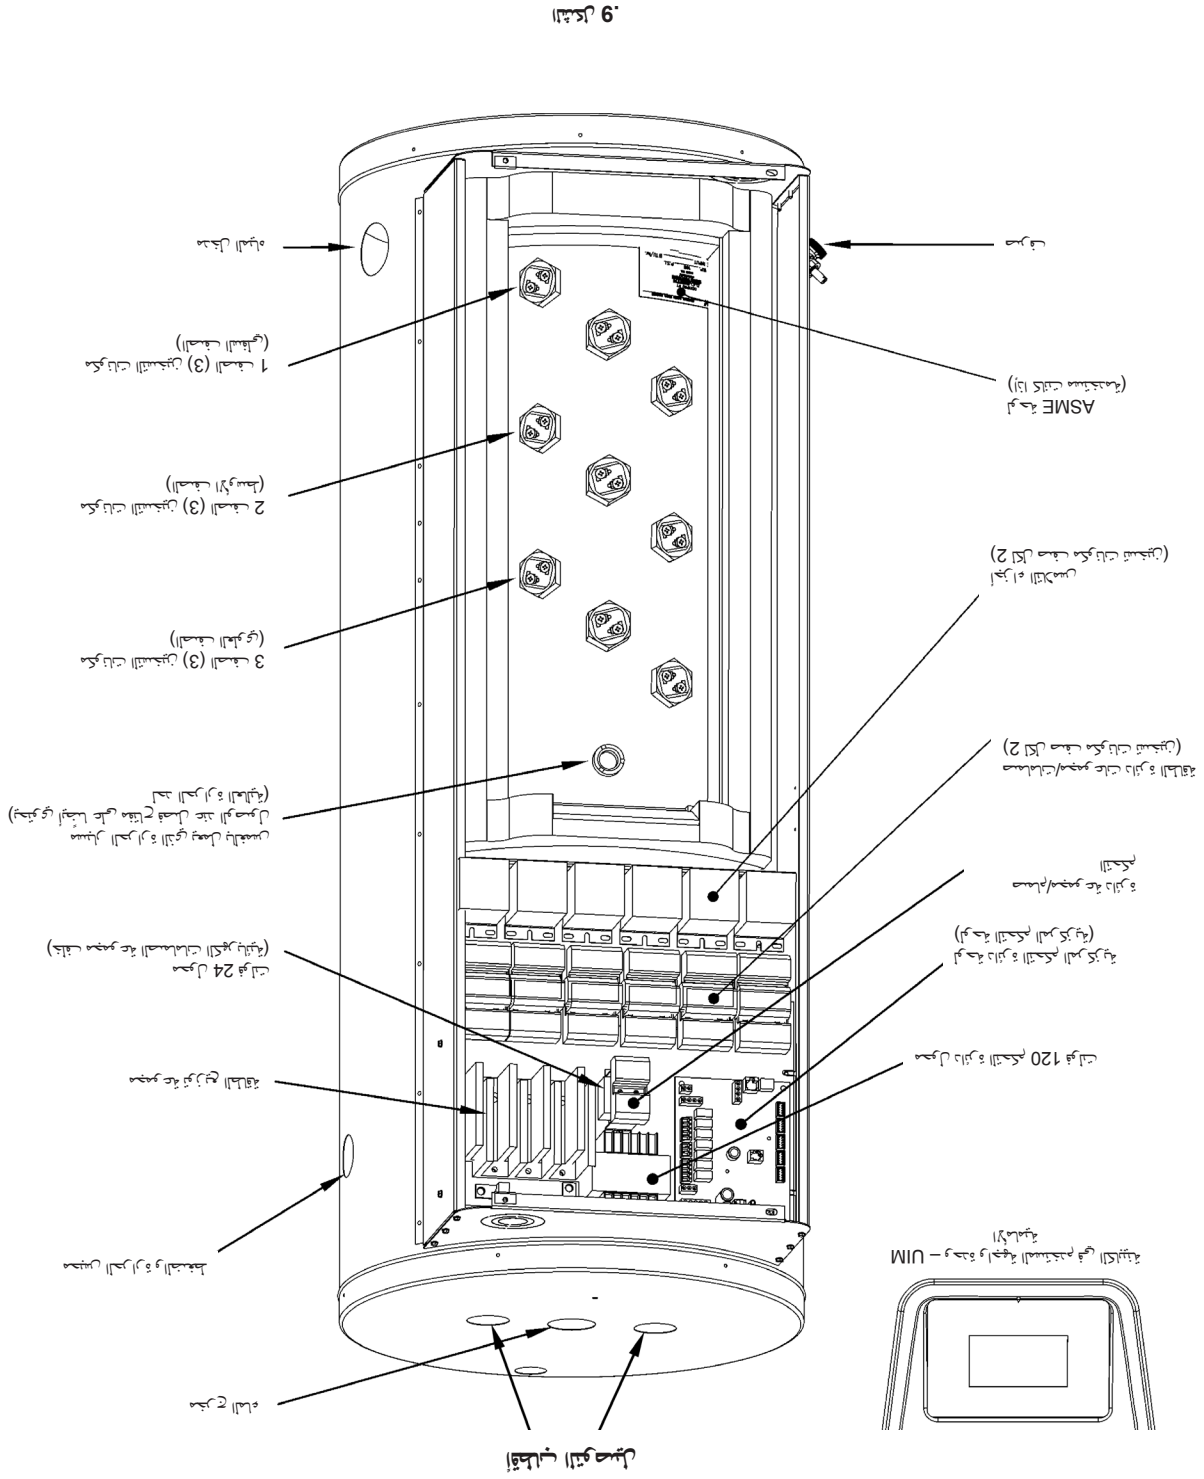

* اتصل بوالده صبيته في يومه الذي كان فيه في السجن.

የፌዴራል ሚኒስትር

[illegible][illegible]

تريكتيرات المواتير.
حرارة المياه المنجزة. ربما يكون تسريب في
يحتل ظهور على المواتير. ربما يكون تسريب في

[illegible]

2. المكوي غير المحكم/يسري الخوان:

1. المكونات المعنوية التي تحدث بها تسيروب من
المكونات أو غير الحاقية. استيند المكون*.

ج: نعم، انما نأخذ ما نحتاجه من الكتاب، ونترك ما لا نحتاجه.

١٠٠٠

او حوالا ۱۱ کتابت ۱۲ عدم ۱۳ بیخه ۱۴ ان ۱۵ الجان ۱۶ بخت ۱۷ الما ۱۸ بیخه ۱۹

٢٠٠٠

[illegible]

وَبَشِّرِ الصَّالِحِينَ الَّذِينَ إِذَا أُتُوا بِالْحَبْرِ قَالُوا هَذَا عَمَلٌ قَدْ سَبَقَ لَنَا مِنْ قَبْلُ وَهِيَ الْفِعْلُ الْكَلِمَةُ الَّتِي نُسَبِّحُ بِهَا اللَّهَ الْعَظِيمَ وَمَنْ لَمْ يَفْعَلْ ذَلِكَ مَعَ آيَاتِنَا أُولَٰئِكَ سَيُعَذِّبُ اللَّهُ النَّاسَ فِي الْعِلْمِ وَأُولَٰئِكَ هُمُ الْكَافِرُونَ ۝


[illegible][illegible]

॥ अथ श्रीगणेशाय नमः ॥

[illegible]

الحرارة إلا أنه يمكن إطفاء الحريق بدرجة حرارة 125° مئوية (52° فهرنهايت) في وقت قصير جداً. في الواقع، يمكن أن تكون المياه الباردة بدرجة حرارة 125° مئوية كافية لإحداث جرح حاد على الجلد. إن التعرض للحرارة على نطاق واسع يمكن أن يؤدي إلى فقدان الجلد، مما قد يؤدي إلى الإصابة بصدمة. إن التعرض للحرارة على نطاق واسع يمكن أن يؤدي إلى فقدان الجلد، مما قد يؤدي إلى الإصابة بصدمة.

יֵאָדָה וְיִשְׂרָאֵל לְעַמּוּתָא

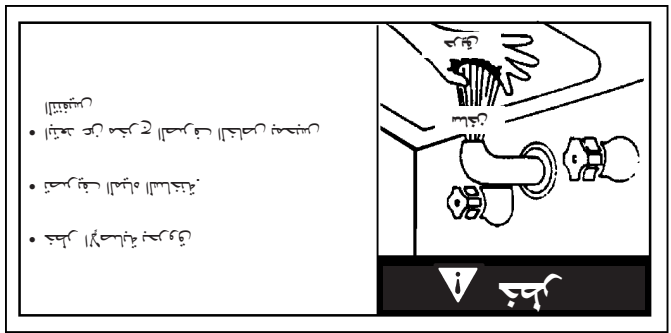

1. قم بإيقاف تشغيل مفتاح الفصل الكهربائي.
2. ألقِ محسب المياه إمداد السخان.
3. قم بتركيب خرطوم في فتحة محسب الصرف لدراسة الحرارة.
4. اقلب صنبور المياه الساخنة للمحسب وتصريف السخان.
5. في حالة تشغيل السخان بغير حرج، فإزالة خرطوم، ويمكن إزالة الخرطوم.
6. اتبع تعليمات المالك عند استعادة خدمة المياه الساخنة.


تفصيل سخان المياه

1. قم بإيقاف تشغيل مفتاح الفصل الكهربائي.
2. ألقِ محسب المياه إمداد السخان.
3. قم بتركيب خرطوم في فتحة محسب الصرف لدراسة الحرارة.
4. اقلب صنبور المياه الساخنة للمحسب وتصريف السخان.
5. في حالة تشغيل السخان بغير حرج، فإزالة خرطوم، ويمكن إزالة الخرطوم.
6. اتبع تعليمات المالك عند استعادة خدمة المياه الساخنة.


يجب إجراء فحص صمامات التثبيت من قبل الفني عند تشغيل السخان لأول مرة.

بدء التشغيل لأول مرة

1. قم بإيقاف تشغيل مفتاح الفصل الكهربائي.
2. ألقِ محسب المياه إمداد السخان.
3. قم بتركيب خرطوم في فتحة محسب الصرف لدراسة الحرارة.
4. اقلب صنبور المياه الساخنة للمحسب وتصريف السخان.
5. في حالة تشغيل السخان بغير حرج، فإزالة خرطوم، ويمكن إزالة الخرطوم.
6. اتبع تعليمات المالك عند استعادة خدمة المياه الساخنة.

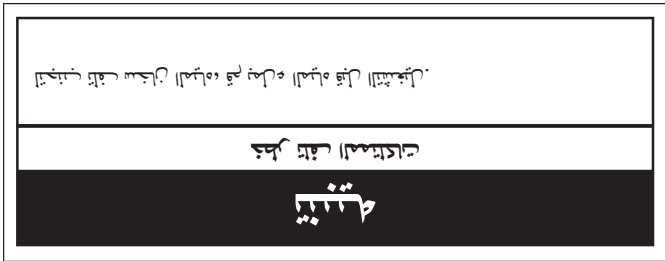


ملء سخان المياه

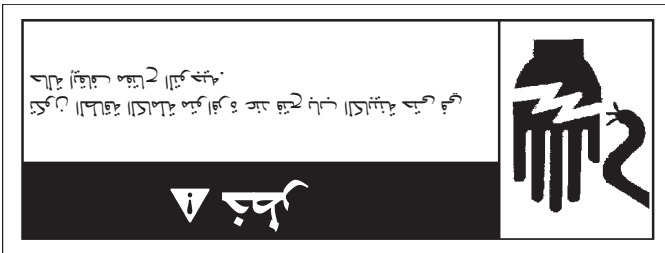


1. قم بإيقاف تشغيل مفتاح الفصل الكهربائي.
2. ألقِ محسب المياه إمداد السخان.
3. قم بتركيب خرطوم في فتحة محسب الصرف لدراسة الحرارة.
4. اقلب صنبور المياه الساخنة للمحسب وتصريف السخان.
5. في حالة تشغيل السخان بغير حرج، فإزالة خرطوم، ويمكن إزالة الخرطوم.
6. اتبع تعليمات المالك عند استعادة خدمة المياه الساخنة.

ملء

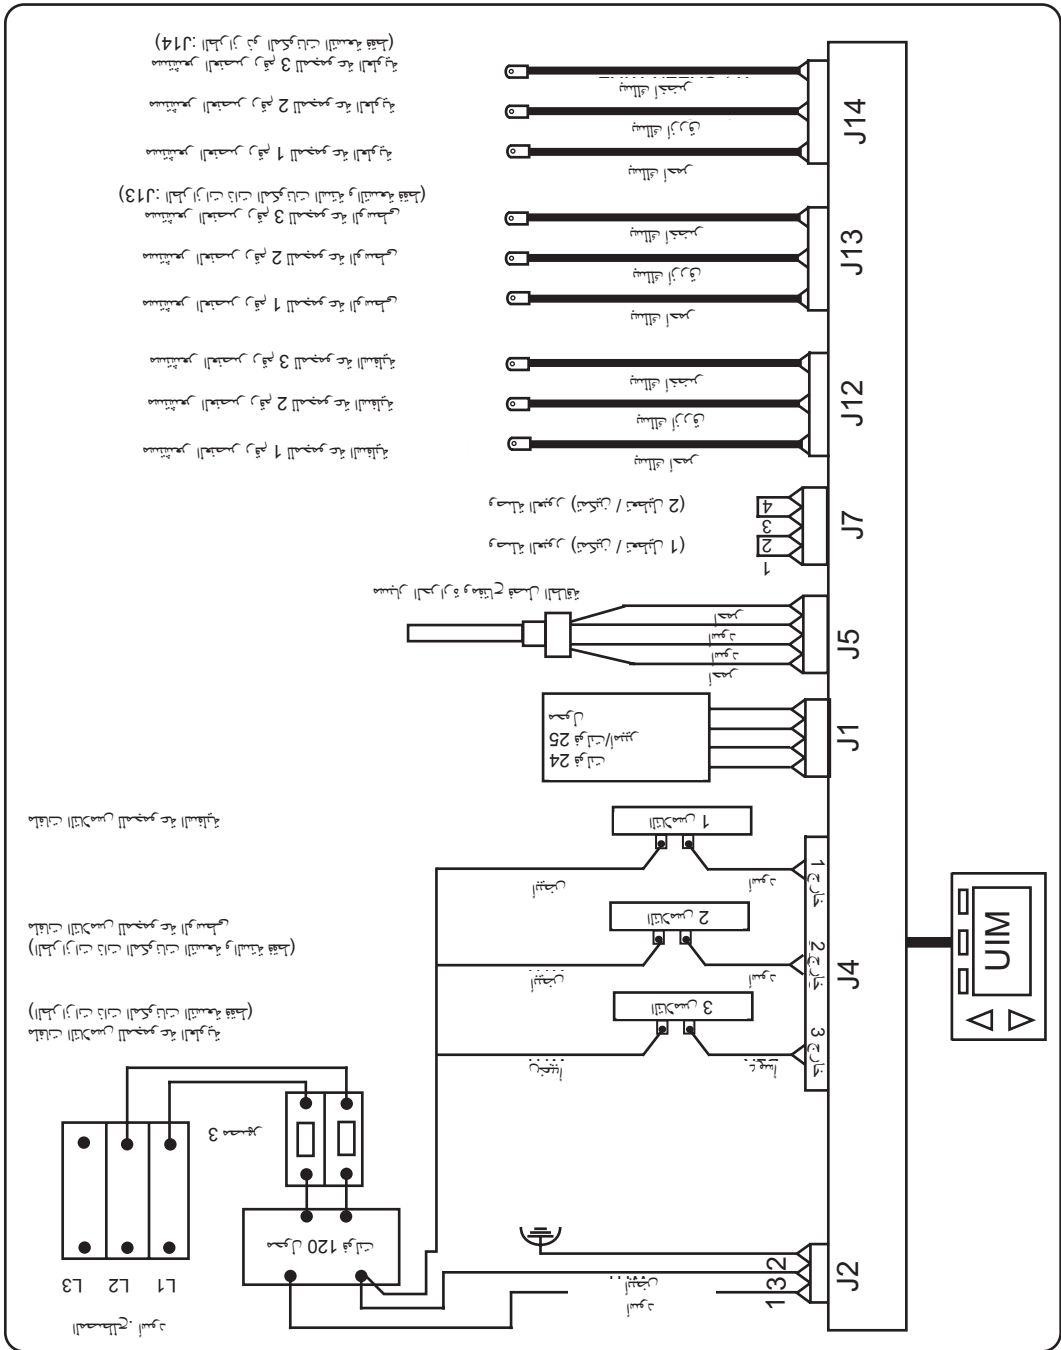

المخطط 7. توصيلات "Y" - الطرازات لوحة - الطرازات بنظام التحكم الإلكتروني

المخطط 6. "Y" المحولات بالنسبة للمحولات وصلات

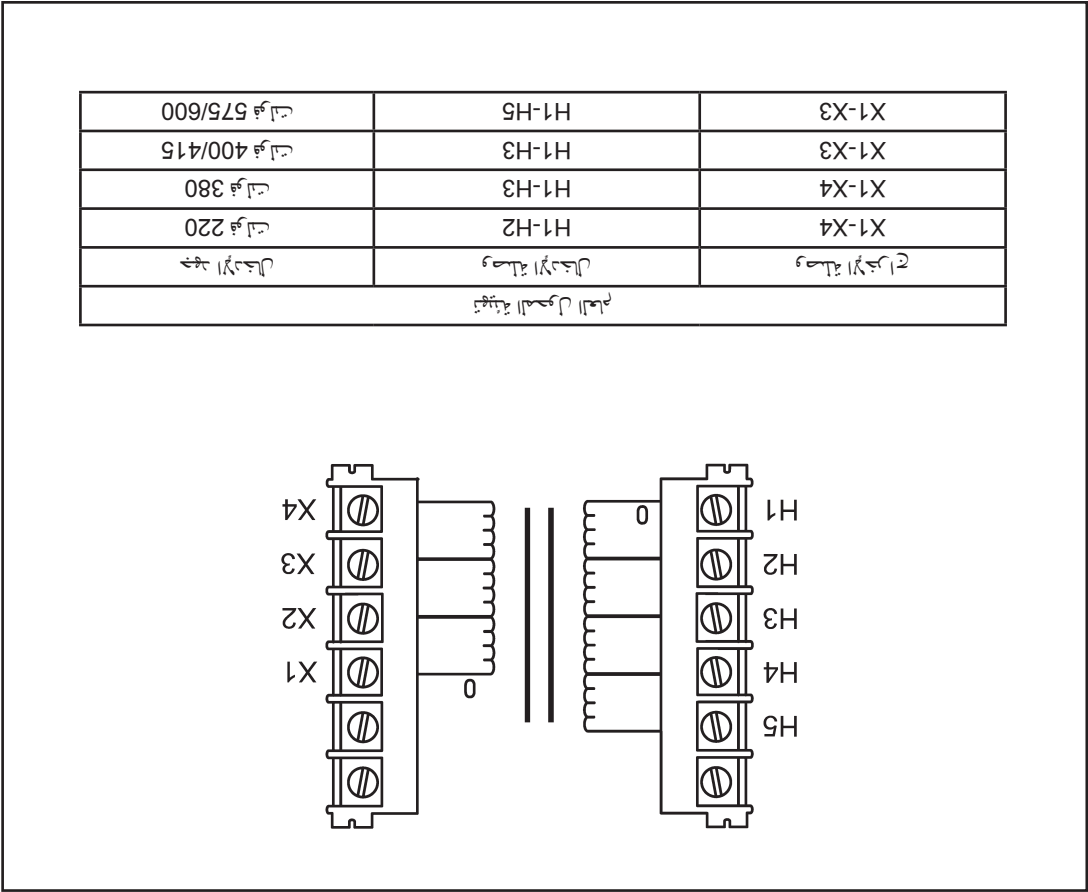

1. فصل الأسلاك الزرقاء من الطرف L1
2. فصل الأسلاك الحمراء من الطرف L2
3. فصل الأسلاك الزرقاء من الطرف L2 (مع L2 الطرف في الأسلاك الزرقاء من الطرف L3)
4. فصل الأسلاك الحمراء من الطرف L3
5. فصل الأسلاك السوداء من الطرف L1 (مع L1 الطرف في الأسلاك السوداء من الطرف L2)

عندما يكون السخان مجهزًا للتوصيل بخدمة كهربائية أحادية الطور، فيمكن توصيله بخدمة

التحويل إلى الطور الثلاثي


1. فصل الأسلاك الزرقاء من الطرف L2
2. فصل الأسلاك الحمراء من الطرف L1
3. فصل الأسلاك السوداء من الطرف L1 (مع L1 الطرف في الأسلاك السوداء من الطرف L2)
4. فصل الأسلاك الزرقاء من الطرف L2
5. فصل الأسلاك السوداء من الطرف L1 (مع L1 الطرف في الأسلاك السوداء من الطرف L2)


عندما يكون السخان مجهزًا للتوصيل بخدمة كهربائية ثلاثية الطور، فيمكن توصيله بخدمة

التحويل إلى الطور أحادي

المخطط 5.


تسعة مكثفات - أحادية الطور وثلاثية الطور

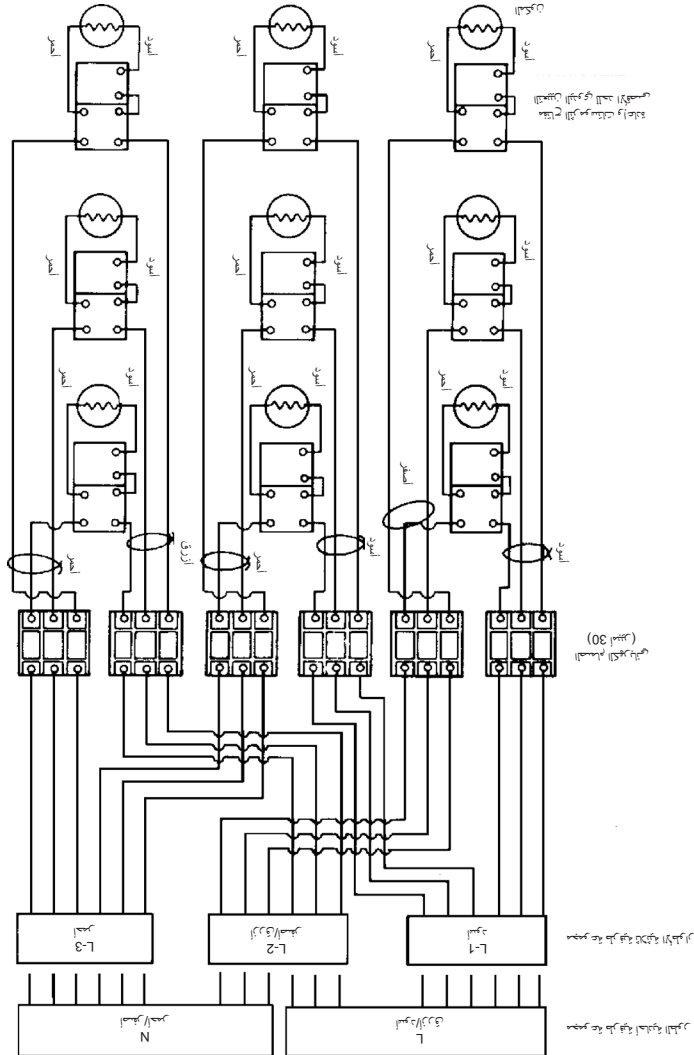

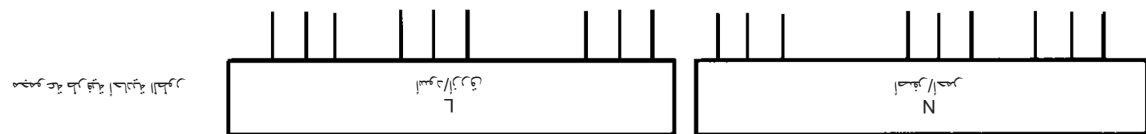

مصابيح كهربائية 30 أمبير (التيار في الطرقات الكنتيك)

جهاز التلدين

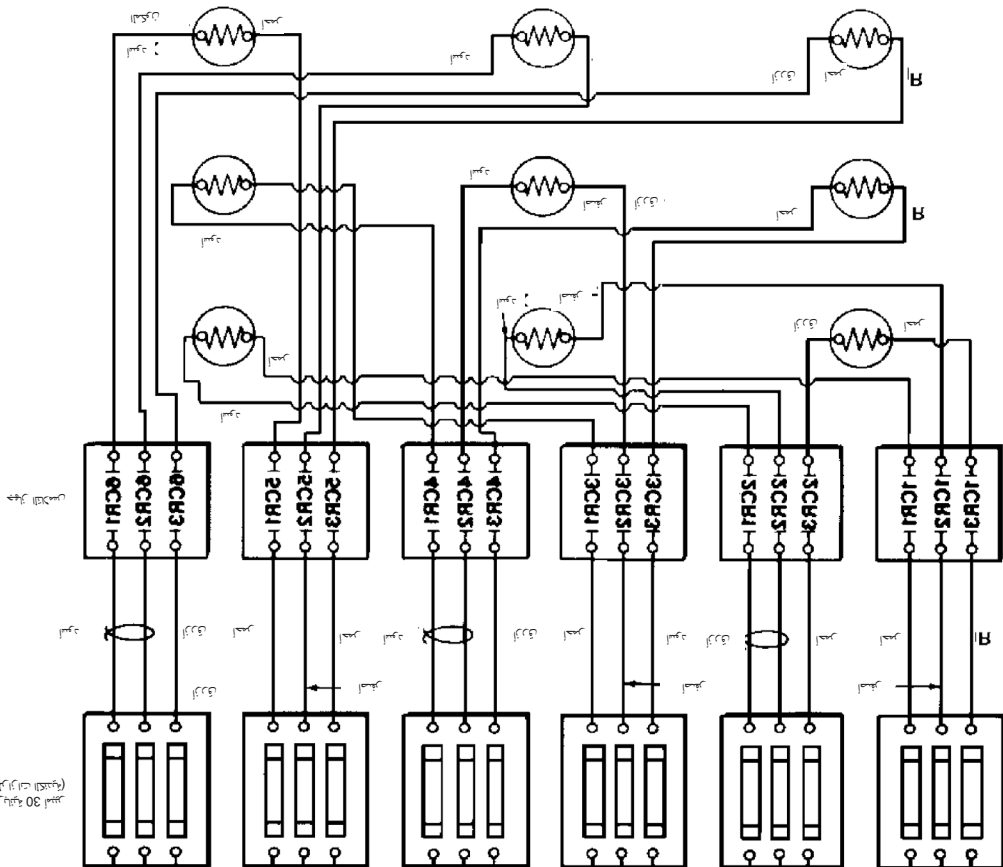

تسعة مكثفات - احادية الطور وثلاثية الطور

المخطط 3.

التحويل إلى الطور الثاني

عندما يكون السخان مجهزاً للتوصيل بخدمة كهربائية أحادية الطور، فيمكن توفيره بخدمة كهربائية ثلاثية الطور بتقسيم الخطوات الأربعة إلى ثلاث خطوات.

1. فصل الأسلاك الزرقاء من الطرف L1.

2. فصل الأسلاك الصفراء من الطرف L2.

3. إعادة توصيل كافة الأسلاك الزرقاء والأسلاك الصفراء إلى الطرف L3.

4. توصيل مصدر الطاقة الزرقاء إلى الطرف L1 و L2 و L3.

عندما يكون السخان مجهزاً للتوصيل بخدمة كهربائية ثلاثية الطور، فيمكن توفيره بخدمة كهربائية أحادية الطور بتقسيم الخطوات الأربعة إلى ثلاث خطوات.

1. فصل الأسلاك الزرقاء والأسلاك الصفراء من الطرف L3.

2. إعادة توصيل كافة الأسلاك الزرقاء إلى الطرف L1 (مع الأسلاك السوداء).

3. إعادة توصيل كافة الأسلاك الصفراء إلى الطرف L2 (مع الأسلاك الحمراء).

4. توصيل مصدر الطاقة الزرقاء إلى الطرف L1 و L2 و L3.


مخططات توصيلات الطاقة - الطرازات ذات تحكم إلكتروني
تهيئة دارة أحادية الطور / ثلاثية الطور

تتم توصيل دوائر الطاقة - الطرازات ذات تحكم إلكتروني / ثلاثية الطور / أحادية الطور
تتم توصيل دوائر الطاقة - الطرازات ذات تحكم إلكتروني / ثلاثية الطور / أحادية الطور
تتم توصيل دوائر الطاقة - الطرازات ذات تحكم إلكتروني / ثلاثية الطور / أحادية الطور

سلسلة محولات - أحادية الطور وثلاثية الطور

سلسلة محولات - أحادية الطور وثلاثية الطور

(لوحة محكمة) لوحة محكمة - (الهيئة القضائية) الهيئة القضائية

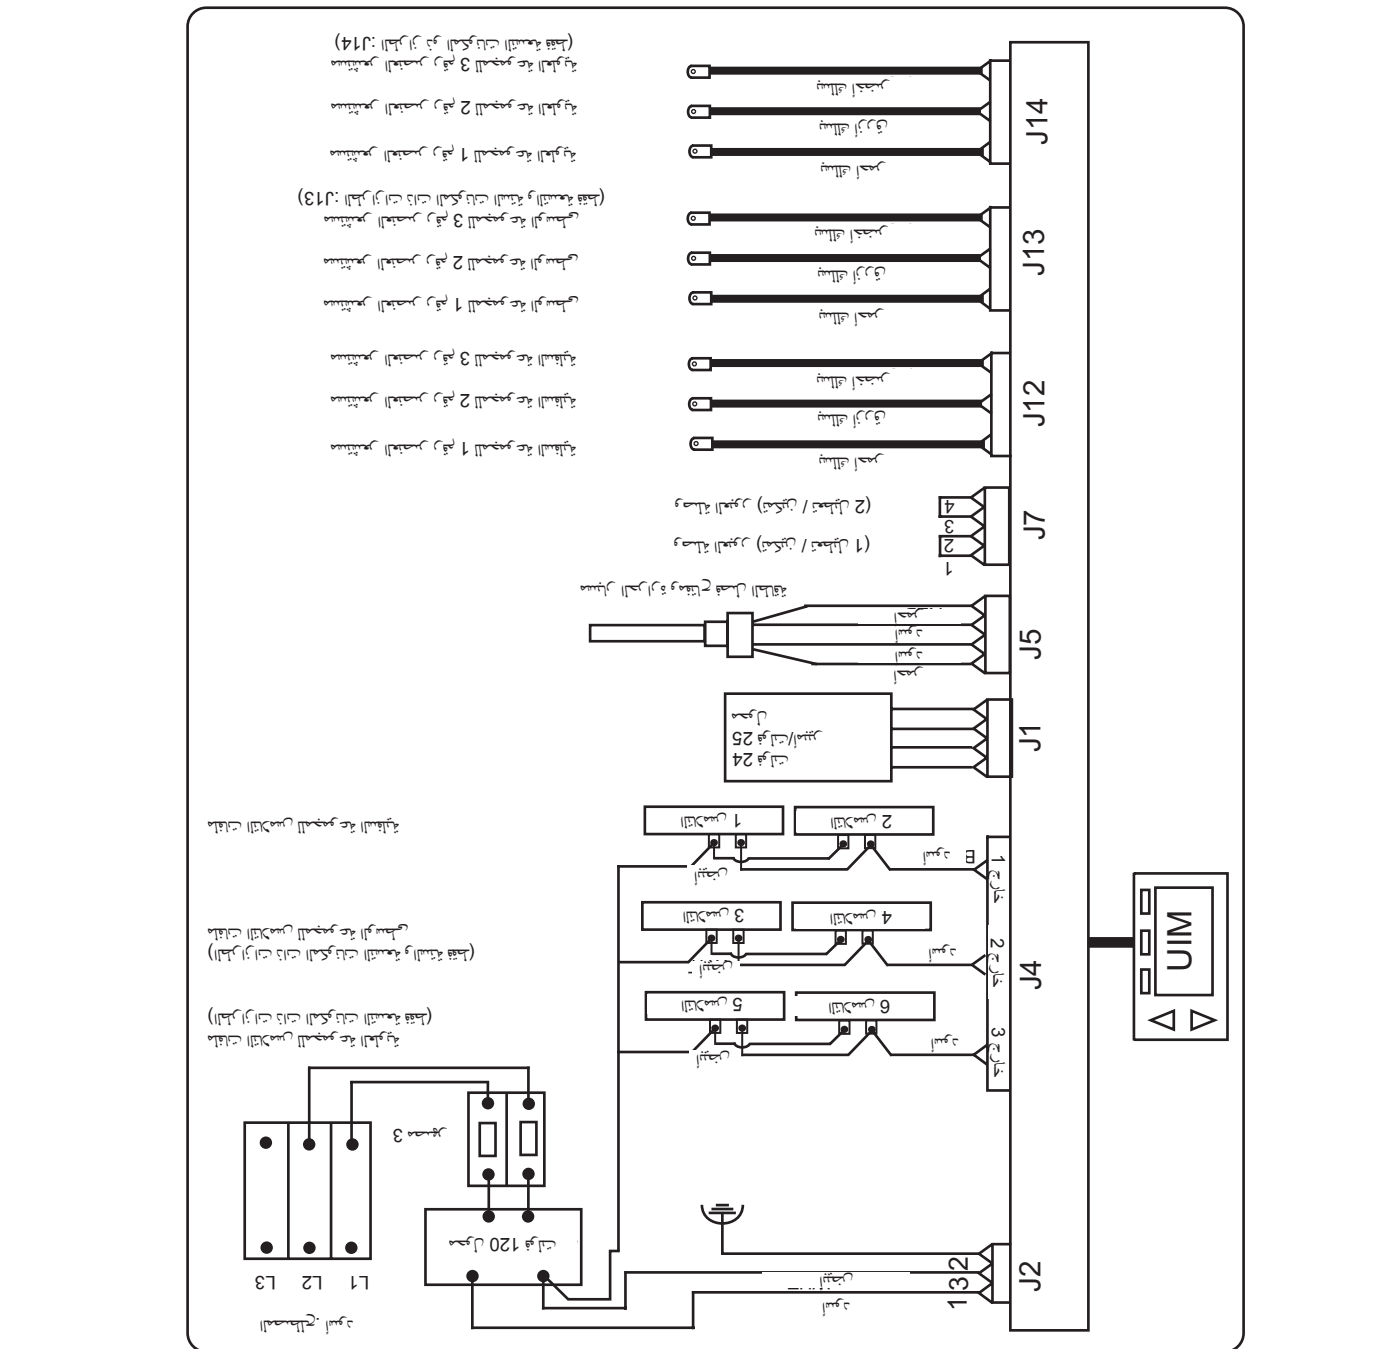

1. الحمد لله

[illegible][illegible]

[illegible]

الحزب والجمهورية الإسلامية

عنه وخوكم المصالح الموقفة منكم منكم العطاء العظمى

- [illegible]

[illegible][illegible]

إِطْلِقُوا

يجب أن يكون مضخات التيريو المركبة في المجال المصنوعة من التيريو بالكامل.

مجلسه


॥५॥

[illegible]

יְהוָה אֱלֹהֵינוּ יִשְׁמְרֵנוּ וְיִשְׁכְּלֵנוּ וְיִשְׁמְרֵנוּ וְיִשְׁכְּלֵנוּ


تسجين تسجيم مع خزان تسجين

יְהוָה אֱלֹהֵינוּ

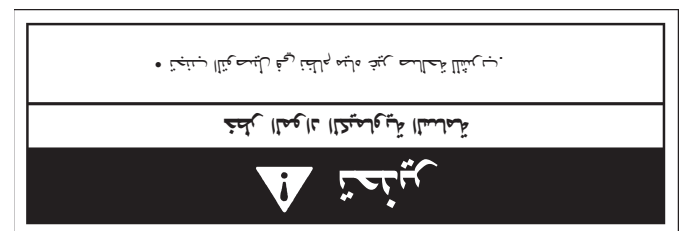

الذليل هذا في راحته الخيرة "تتجلى" في أقواله، واستقامته.

في كتابي المسمى "الدين والسياسة" في كتابي "الدين والسياسة" في كتابي "الدين والسياسة".

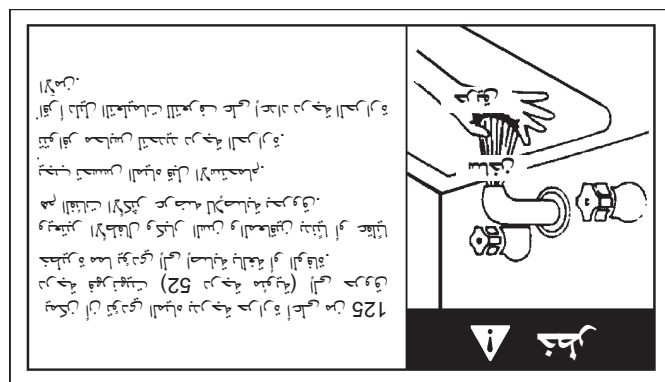[illegible]

37, 38.



[illegible][illegible]


१८

[illegible]


॥ श्रीगणेशाय नमः ॥

يتعلق الصفحات التالية بالتركيب، والخدمات/الصيانة واستكشاف الأخطاء وإصلاحها. يرجى استخدام هذه التعليمات وتثبيتها بحالة وحمل المكونات فقط.

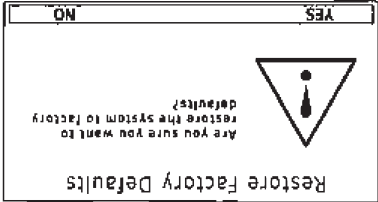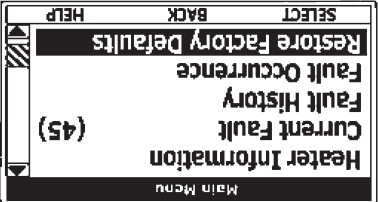النافذة	الأجزاء
	استعادة (استعادة) Restore Factory Defaults قائمة من الخروج (عودة) "BACK" (استعادة) Restore Factory Defaults القائمة من القائمة المصنوع). اضغط زر التشغيل (استعادة) Restore Factory Defaults القائمة من القائمة المصنوع). من قائمة Restore Factory Defaults (استعادة) Restore Factory Defaults القائمة من القائمة المصنوع). اضغط زر التشغيل (استعادة) Restore Factory Defaults القائمة من القائمة المصنوع).
	قائمة (قائمة) Main Menu القائمة المصنوع). استخدم زر (القائمة المصنوع). استعادة (استعادة) Restore Factory Defaults القائمة من القائمة المصنوع). اضغط زر التشغيل (استعادة) Restore Factory Defaults القائمة من القائمة المصنوع).

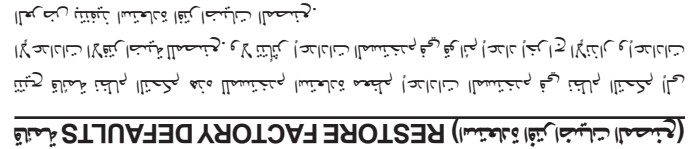

Fault Occurrence	
ECO	1
No Current Detected	3
Tank Temp Probe	1
CCB Hardware	0
Model Faults	0
BACK	
HELP	

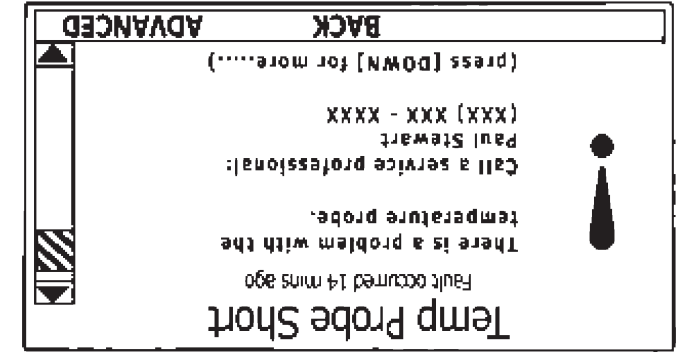[illegible][illegible]

Display Settings

- Temperature Units °F
- Backlight Delay 30s
- Contrast 20%
- Help

قائمة DISPLAY SETTINGS (إعدادات الشاشة)

(وحدات درجة الحرارة) Temperature Units

ملوية (C) او درخه فقه بنهت (F).

الاستخدام متساو بعد ضغط أحد المقادير: Always On (تفصيل (دائمة)).
 10 أ، 30 أ، 60 أ، 90 أ، 120 أ، 144 أ، 168 أ، 192 أ، 216 أ، 240 أ، 288 أ، 360 أ، 480 أ، 576 أ، 720 أ، 864 أ، 1080 أ، 1440 أ، 1728 أ، 2160 أ، 2880 أ، 3600 أ، 4320 أ، 5040 أ، 5760 أ، 6480 أ، 7200 أ، 8640 أ، 10800 أ، 12960 أ، 15120 أ، 17280 أ، 19440 أ، 21600 أ، 24480 أ، 27360 أ، 30240 أ، 33120 أ، 36000 أ، 38880 أ، 41760 أ، 44640 أ، 47520 أ، 50400 أ، 53280 أ، 56160 أ، 59040 أ، 61920 أ، 64800 أ، 67680 أ، 70560 أ، 73440 أ، 76320 أ، 79200 أ، 82080 أ، 84960 أ، 87840 أ، 90720 أ، 93600 أ، 96480 أ، 99360 أ، 102240 أ، 105120 أ، 108000 أ، 110880 أ، 113760 أ، 116640 أ، 119520 أ، 122400 أ، 125280 أ، 128160 أ، 131040 أ، 133920 أ، 136800 أ، 139680 أ، 142560 أ، 145440 أ، 148320 أ، 151200 أ، 154080 أ، 156960 أ، 159840 أ، 162720 أ، 165600 أ، 168480 أ، 171360 أ، 174240 أ، 177120 أ، 180000 أ، 182880 أ، 185760 أ، 188640 أ، 191520 أ، 194400 أ، 197280 أ، 200160 أ، 203040 أ، 205920 أ، 208800 أ، 211680 أ، 214560 أ، 217440 أ، 220320 أ، 223200 أ، 226080 أ، 228960 أ، 231840 أ، 234720 أ، 237600 أ، 240480 أ، 243360 أ، 246240 أ، 249120 أ، 252000 أ، 254880 أ، 257760 أ، 260640 أ، 263520 أ، 266400 أ، 269280 أ، 272160 أ، 275040 أ، 277920 أ، 280800 أ، 283680 أ، 286560 أ، 289440 أ، 292320 أ، 295200 أ، 298080 أ، 300960 أ، 303840 أ، 306720 أ، 309600 أ، 312480 أ، 315360 أ، 318240 أ، 321120 أ، 324000 أ، 326880 أ، 329760 أ، 332640 أ، 335520 أ، 338400 أ، 341280 أ، 344160 أ، 347040 أ، 349920 أ، 352800 أ، 355680 أ، 358560 أ، 361440 أ، 364320 أ، 367200 أ، 370080 أ، 372960 أ، 375840 أ، 378720 أ، 381600 أ، 384480 أ، 387360 أ، 390240 أ، 393120 أ، 396000 أ، 398880 أ، 401760 أ، 404640 أ، 407520 أ، 410400 أ، 413280 أ، 416160 أ، 419040 أ، 421920 أ، 424800 أ، 427680 أ، 430560 أ، 433440 أ، 436320 أ، 439200 أ، 442080 أ، 444960 أ، 447840 أ، 450720 أ، 453600 أ، 456480 أ، 459360 أ، 462240 أ، 465120 أ، 468000 أ، 470880 أ، 473760 أ، 476640 أ، 479520 أ، 482400 أ، 485280 أ، 488160 أ، 491040 أ، 493920 أ، 496800 أ، 499680 أ، 502560 أ، 505440 أ، 508320 أ، 511200 أ، 514080 أ، 516960 أ، 519840 أ، 522720 أ، 525600 أ، 528480 أ، 531360 أ، 534240 أ، 537120 أ، 540000 أ، 542880 أ، 545760 أ، 548640 أ، 551520 أ، 554400 أ، 557280 أ، 560160 أ، 563040 أ، 565920 أ، 568800 أ، 571680 أ، 574560 أ، 577440 أ، 580320 أ، 583200 أ، 586080 أ، 588960 أ، 591840 أ، 594720 أ، 597600 أ، 600480 أ، 603360 أ، 606240 أ، 609120 أ، 612000 أ، 614880 أ، 617760 أ، 620640 أ، 623520 أ، 626400 أ، 629280 أ، 632160 أ، 635040 أ، 637920 أ، 640800 أ، 643680 أ، 646560 أ، 649440 أ، 652320 أ، 655200 أ، 658080 أ، 660960 أ، 663840 أ، 666720 أ، 669600 أ، 672480 أ، 675360 أ، 678240 أ، 681120 أ، 684000 أ، 686880 أ، 689760 أ، 692640 أ، 695520 أ، 698400 أ، 701280 أ، 704160 أ، 707040 أ، 709920 أ، 712800 أ، 715680 أ، 718560 أ، 721440 أ، 724320 أ، 727200 أ، 730080 أ، 732960 أ، 735840 أ، 738720 أ، 741600 أ، 744480 أ، 747360 أ، 750240 أ، 753120 أ، 756000 أ، 758880 أ، 761760 أ، 764640 أ، 767520 أ، 770400 أ، 773280 أ، 776160 أ، 779040 أ، 781920 أ، 784800 أ، 787680 أ، 790560 أ، 793440 أ، 796320 أ، 799200 أ، 802080 أ، 804960 أ، 807840 أ، 810720 أ، 813600 أ، 816480 أ، 819360 أ، 822240 أ، 825120 أ، 828000 أ، 830880 أ، 833760 أ، 836640 أ، 839520 أ، 842400 أ، 845280 أ، 848160 أ، 851040 أ، 853920 أ، 856800 أ، 859680 أ، 862560 أ، 865440 أ، 868320 أ، 871200 أ، 874080 أ، 876960 أ، 879840 أ، 882720 أ، 885600 أ، 888480 أ، 891360 أ، 894240 أ، 897120 أ، 900000 أ، 902880 أ، 905760 أ، 908640 أ، 911520 أ، 914400 أ، 917280 أ، 920160 أ، 923040 أ، 925920 أ، 928800 أ، 931680 أ، 934560 أ، 937440 أ، 940320 أ، 943200 أ، 946080 أ، 948960 أ، 951840 أ، 954720 أ، 957600 أ، 960480 أ، 963360 أ، 966240 أ، 969120 أ، 972000 أ، 974880 أ، 977760 أ، 980640 أ، 983520 أ، 986400 أ، 989280 أ، 992160 أ، 995040 أ، 997920 أ، 1000800 أ، 1003680 أ، 1006560 أ، 1009440 أ، 1012320 أ، 1015200 أ، 1018080 أ، 1020960 أ، 1023840 أ، 1026720 أ، 1029600 أ، 1032480 أ، 1035360 أ، 1038240 أ، 1041120 أ، 1044000 أ، 1046880 أ، 1049760 أ، 1052640 أ، 1055520 أ، 1058400 أ، 1061280 أ، 1064160 أ، 1067040 أ، 1069920 أ، 1072800 أ، 1075680 أ، 1078560 أ، 1081440 أ، 1084320 أ، 1087200 أ، 1090080 أ، 1092960 أ، 1095840 أ، 1098720 أ، 1101600 أ، 1104480 أ، 1107360 أ، 1110240 أ، 1113120 أ، 1116000 أ، 1118880 أ، 1121760 أ، 1124640 أ، 1127520 أ، 1130400 أ، 1133280 أ، 1136160 أ، 1139040 أ، 1141920 أ، 1144800 أ، 1147680 أ، 1150560 أ، 1153440 أ، 1156320 أ، 1159200 أ، 1162080 أ، 1164960 أ، 1167840 أ، 1170720 أ، 1173600 أ، 1176480 أ، 1179360 أ، 1182240 أ، 1185120 أ، 1188000 أ، 1190880 أ، 1193760 أ، 1196640 أ، 1199520 أ، 1202400 أ، 1205280 أ، 1208160 أ، 1211040 أ، 1213920 أ، 1216800 أ، 1219680 أ، 1222560 أ، 1225440 أ، 1228320 أ، 1231200 أ،

(الفريق) Contrast
إعداد قابل للتكيف بواسطة المستخدم LCD شاشة ثلاثية اللون المستخدمة في
النفس والذخيرة.

(إعدادات العرض) Display Settings

ملحقه الصلابة
Display Settings) قائمة في القائمة الرئيسية بواسطة الضغط على أيقونة القائمة العلوية (التي تظهر في أعلى الشاشة).
الرجوع إلى إعدادات الصوت.

بِسْمِ اللَّهِ الرَّحْمَنِ الرَّحِيمِ

Heater Information	
Elapsed Time	7 days 18 hrs 35 mins
Total Heating Time	2 days 46 mins
Cycle Count	00000042
Bank 1 Cycles	00000035
Bank 1 On Time	
BACK	HELP

۱۰۸

Heater Information	
Bank 2 On Time	1 day 4 hrs 44 mins
Bank 3 Cycles	00000025
Bank 3 On Time	8 hrs 30 mins
CGB Version	0.00
UIM Version	0.00
BACK	
HELP	

اسماء القائل

قسم (أجزاء) ALARM OUTPUT SETUP

Figure 10-1 shows the Alarm Output Setup screen. The title bar at the top reads "Alarm Output Setup". Below the title bar, there are three buttons: "CHANGE", "BACK", and "HELP". The main display area shows "Output Function" set to "Fault" and "Alarm SP" set to "120°F". A vertical scroll bar is visible on the left side of the screen.

Figure 10 shows the Alarm Output Setup screen. The screen displays the title "Alarm Output Setup" at the top. Below the title, the "Output Function" is set to "Temp > Alarm SP". The "Alarm SP" is set to "120°F". At the bottom of the screen, there are three buttons: "CHANGE", "BACK", and "HELP".

التسجين

[illegible]

عندما تنخفض الحرارة الحالية للجران دون نقطة التثقيب المقررة.

عندما يتجهض الجنين في المرحلة الجنينية الأولى (Temp < Alarm SP) يتم إيقاف الجهاز.






یہ سچ ہے۔

١٢٠٠ م ٢٠٠٠ م : (مطابق) Disabled

ॐ नमो भगवते वासुदेवाय ॥ २ ॥

يؤثر على من وظايف الجراح الإلتزام **Alarm Output Settings** (إعدادات إنذار): يتم تغيير الإعدادات المستندة في **Alarm Output Settings** (إعدادات الإنذار) لتغيير نقطة التحول المنطقية في التغيير في الحالة المنطقية.

• تصنيع المضخات (إعداد أجزاء) (إعداد أجزاء) Setup

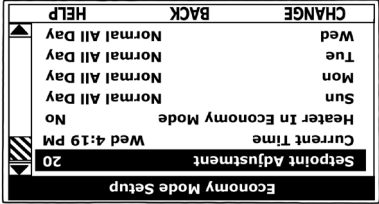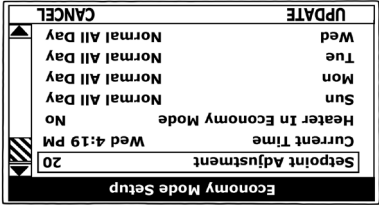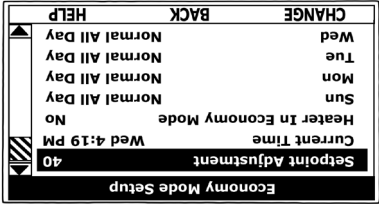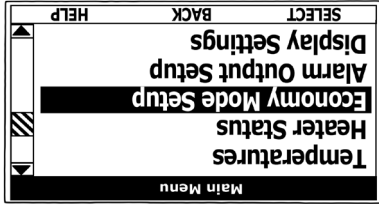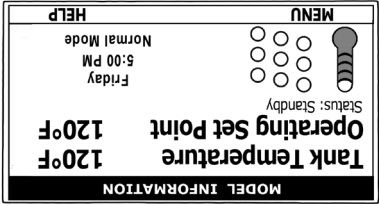	القيمة الحالية. بحسب الأثر على
	القيمة الحالية. بحسب الأثر على
	القيمة الحالية. بحسب الأثر على
	القيمة الحالية. بحسب الأثر على
	القيمة الحالية. بحسب الأثر على
المشاهدة	الأجزاء

القيمة الحالية

إعدادات الوضع الاقتصادي

القيمة الحالية.

القيمة الحالية.

القيمة الحالية.

القيمة الحالية.

القيمة الحالية.

القيمة الحالية.

القيمة الحالية.

Normal Operation All "قائمة تشغيل" في قائمة تشغيل
Economy Mode Setup (إعداد الوضع)
(الجمعة - السبت) - (الجمعة - السبت) - (الجمعة - السبت)
(الأحد - الاثنين - الثلاثاء - الأربعاء - الخميس - الجمعة - السبت)
Daily Operating Mode (Sun - Mon - Tue - Wed - Thu - Fri - Sat)
عروض ما إذا كان يعمل التحكم حاليًا في الوضع الاقتصادي أم لا.

[illegible][illegible]

Economy Mode Setup	
Setpoint Adjustment	20
Current Time	Mon 5:00 PM
Heater In Economy Mode	No
Sun	Economy Mode All Day
Mon	Normal 7:30 AM to 8:00 PM
Tue	Normal All Day
Wed	Normal All Day
CHANGE	BACK
HELP	

(الإعداد الوظيفي) Economy Mode Setup قائمة

MODEL INFORMATION

Tank Temperature 120°F

Economy Set Point 100°F

Status: Standby

MENU

Friday 5:00 PM

Economy Mode

HELP

[illegible]

(اقتصادی) سب سے زیادہ (جدید) ECONOMY MODE SETUP

[illegible]

Yes = تفعيل، No = تعطيل. التفعيل التام: تفعيل كل صف من صفات المكون. التفعيل الجزئي: تفعيل بعض الصفات من صفات المكون. التفعيل الجزئي: تفعيل بعض الصفات من صفات المكون. التفعيل الجزئي: تفعيل بعض الصفات من صفات المكون.

المشاكل التي تواجهها في العمل، فكل من يعاني من مشاكل صحية أو نفسية يجب أن يتوجه إلى الطبيب النفسي للحصول على العلاج المناسب. كما يجب أن تكون هناك وعي مجتمعي أكبر تجاه هذه المشاكل، وأن يكون الدعم الاجتماعي متاحاً للجميع.

في الختام، فإن التعامل مع المشاكل النفسية يتطلب فهماً شاملاً ودعماً متكاملاً. من خلال التعاون بين الأطباء النفسيين والمهنيين الاجتماعيين والعائلة، يمكننا تحقيق أفضل النتائج للمرضى. إن الاهتمام بالصحة النفسية ليس رفاهية، بل ضرورة حياتية لكل فرد يسعى لتحقيق جودة حياة أفضل.

دكتور أحمد محمد علي
أخصائي نفسي عام / استشاري في الطب النفسي

2) Enable / Disable / تعطيل / تفعيل (تحتوي)

يعمل بالاعتماد على مفتاحين أحمر وأخضر.

[illegible][illegible]

Heater Status	
Enable / Disable 1	Closed
Enable / Disable 2	Closed
Element Bank 1 On	Yes
Element Bank 2 On	No
Element Bank 3 On	No
Alarm Condition	No
Alarm Relay Output	Open
BACK	
HELP	

أسفل القائمة

Heater Status	
	Status
	Element Banks On
	1
	ECO Contact
	Closed
	Closed
	Enable / Disable 1
	Enable / Disable 2
	Element Bank 1 On
	Element Bank 2 On
	No
	Yes
	Closed
	Heating
BACK	
HELP	

ایمانی علی

التي لا يمكن استخدامها في أي شيء آخر. يمكن استخدامها في أي شيء آخر.

[illegible][illegible][illegible][illegible][illegible][illegible]


الحكم. النظام بظالم غير قوي، والبيئة والبيئة هذه المستحقة هذه أعدادات ضبط ضيقة كقوة كالتالي.

التعليقات: توضح الحركات الواردة في قائمة درجات المقبولات أعداداً والمقروءة والمقبولين اللذين نفيتم تنظيم نقطة المقبولات الواردة في الجدول.

[illegible]

مستلزمات الحرائق (التي يمكن استخدامها في الحرائق).

الشكل 4. UIM - وحدة واجهة المستخدم

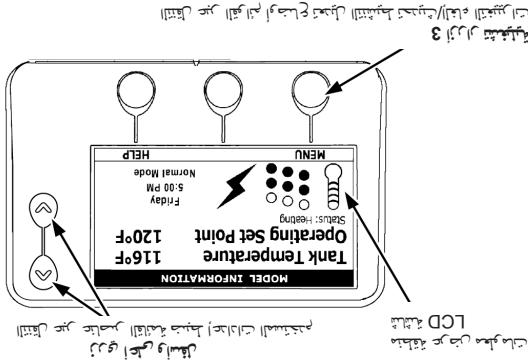

بالضغط (سريعة)؛ وهي زري أعلى وأسفل وأزرار التشغيل. وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل. وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل. وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل.

التحكم عن بعد بنظام التحكم


في الحالة العادية، يتم تشغيل النظام عن بعد بواسطة وحدة واجهة المستخدم (UIM). وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل. وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل.

في الحالة العادية، يتم تشغيل النظام عن بعد بواسطة وحدة واجهة المستخدم (UIM). وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل. وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل.

جهاز التحكم بنظام التحكم

تشغيل الأزرار لتحكم النظام


في الحالة العادية، يتم تشغيل النظام عن بعد بواسطة وحدة واجهة المستخدم (UIM). وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل. وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل.

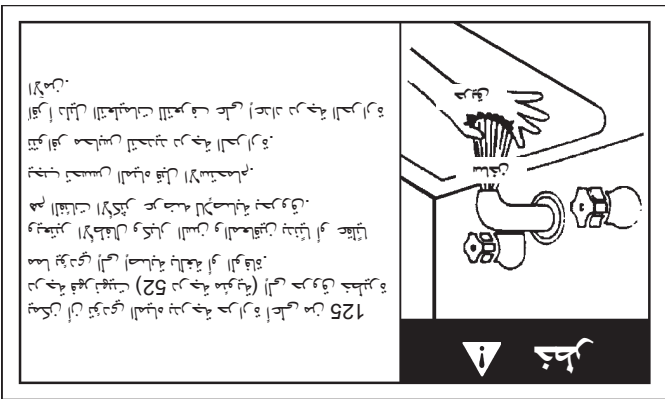

إعدادات التحكم عن بعد

في الحالة العادية، يتم تشغيل النظام عن بعد بواسطة وحدة واجهة المستخدم (UIM). وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل. وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل.

الشكل 5.

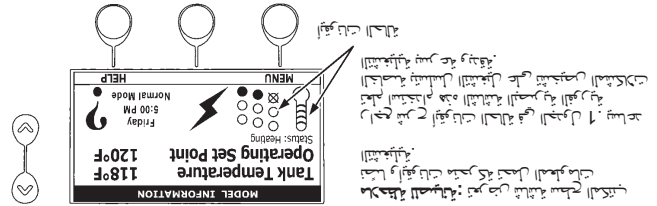

في الحالة العادية، يتم تشغيل النظام عن بعد بواسطة وحدة واجهة المستخدم (UIM). وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل. وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل.

في الحالة العادية، يتم تشغيل النظام عن بعد بواسطة وحدة واجهة المستخدم (UIM). وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل. وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل.

التحكم عن بعد بنظام التحكم


في الحالة العادية، يتم تشغيل النظام عن بعد بواسطة وحدة واجهة المستخدم (UIM). وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل. وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل.

في الحالة العادية، يتم تشغيل النظام عن بعد بواسطة وحدة واجهة المستخدم (UIM). وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل. وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل.

جهاز التحكم بنظام التحكم

تشغيل الأزرار لتحكم النظام


في الحالة العادية، يتم تشغيل النظام عن بعد بواسطة وحدة واجهة المستخدم (UIM). وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل. وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل.

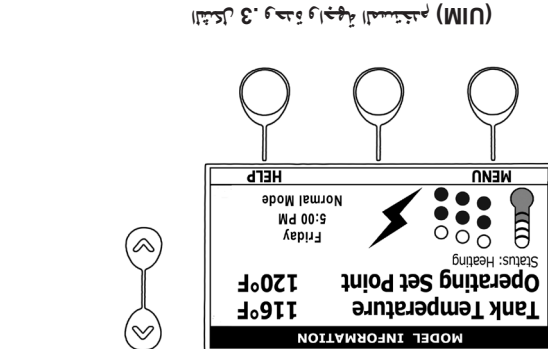

في الحالة العادية، يتم تشغيل النظام عن بعد بواسطة وحدة واجهة المستخدم (UIM). وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل. وحدة واجهة المستخدم (UIM) تستجيب لأزرار إشارات المستخدم لتعمل.

معلومات المستخدم

1. ارفق شريطاً من القماش الجوتى.
2. اعلق محبساً من الخشب على الحائط.
3. اعلق منديل على الحائط.
4. اعلق منديل على الحائط.
5. اعلق منديل على الحائط.

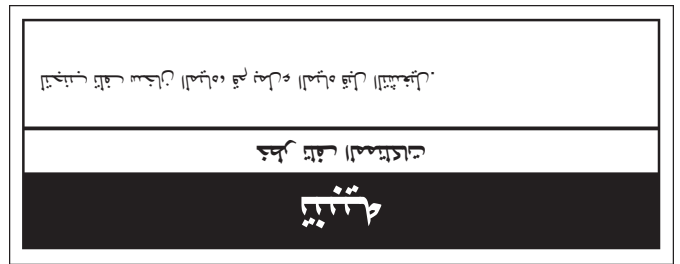


ہفتامہ ہجرت

[illegible]


לְבַיְתָא דְּרַב חֵזְקִיָּהּ בֶּן אֲבִי חֵזְקִיָּהּ

- [illegible]

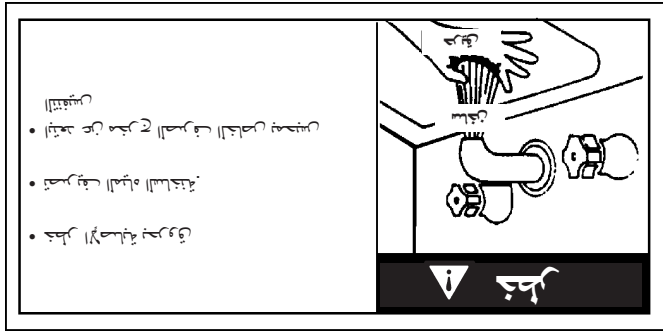

- [illegible]

ہفتم، اجاس ہت یق

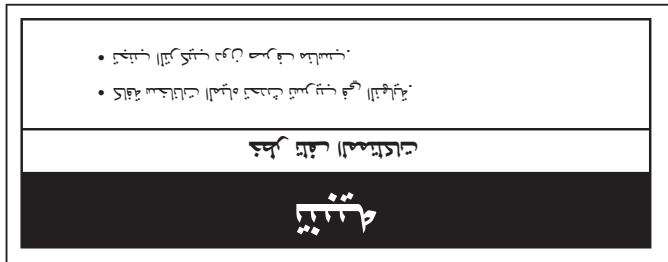[illegible]

لَا تَقْرَأُ الْمَدِينَةَ؟ إِنِّي أَتِيْتُكَ مِنْ مَدِينَةٍ

تَخْرُجُ الْمَاءُ فِي الْجَسَدِ كَمَا تَخْرُجُ



الشكل 2.

COMMERCIAL STORAGE TANK WATER HEATER IPX1							
MODEL NUMBER				SERIAL NUMBER		ITEM ID / PART NUMBER	
XXXXXXXXXXXX				1116M000575		XXXXXXXXXXXX	
Ph	V	Hz	No. of	W (WATTS)	MAXIMUM		
(PHASE)	(VOLTS)	(HERTZ)	ELEMENTS	EACH	TOTAL	PSI	KPa
3	220-240	50-60	6	6000	36000	150	1034
CAPACITY							
US GAL				L (LITERS)			
119.0				450.5			

الداخل/الخارج	(NP) 1 1/4 سن إلى اسبوع	(NP) 1 1/4 سن إلى اسبوع	(NP) 1 1/4 سن إلى اسبوع	(NP) 1 1/4 سن إلى اسبوع	(NP) 1 1/4 سن إلى اسبوع
A - بوصة (إلم)	27 (685)	25 1/2 (648)	62 1/4 (1581)	35 (889)	29 1/2 (749)
B - بوصة (إلم)	31 (787)	60 1/4 (1350)	60 1/4 (1350)	31 (787)	25 1/2 (648)
C - بوصة (إلم)	50 (1270)	55 3/4 (1416)	55 3/4 (1416)	50 (1270)	21 3/4 (552)
D - بوصة (إلم)	80 (2032)	80 (2032)	80 (2032)	80 (2032)	80 (2032)
E - بوصة (إلم)	119 (3018)	119 (3018)	119 (3018)	119 (3018)	119 (3018)

[illegible]

יִשְׂרָאֵל בְּהַתְּלֵךְ זָהָב

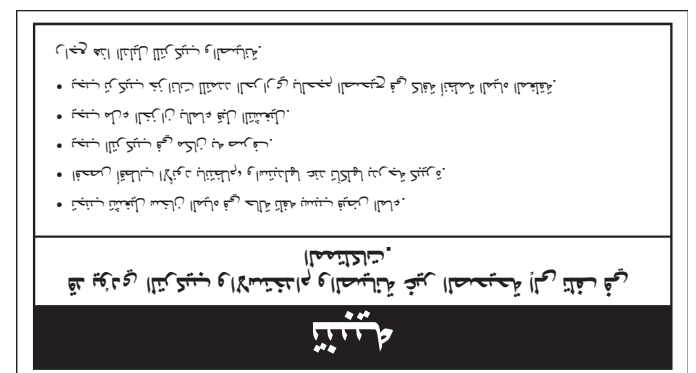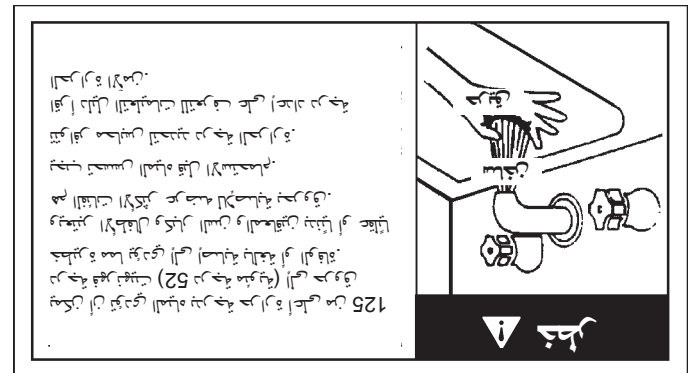

الخطر. الاحتراق. قد تؤدي المياه المبللة المبالغ في استخدامها إلى انفجار البخار. يجب تركيب محابس تنقيس الحرارة والاحتفاظ بالمحابس في الموضع المخصص.



الخطر. الاحتراق. قد تؤدي المياه المبللة المبالغ في استخدامها إلى انفجار البخار. يجب تركيب محابس تنقيس الحرارة والاحتفاظ بالمحابس في الموضع المخصص.

[illegible][illegible][illegible][illegible]

الإصغاء الخفي خطب خفية، وكتيبة الإسلام رسالة، وما يمكن أن يحدث في حالة عدم اتباع الإسلام رسالة الخطر، وما يمكن أن يحدث في حالة عدم اتباع الإسلام رسالة الخطر، وما يمكن أن يحدث في حالة عدم اتباع الإسلام رسالة الخطر.

	يُمنع من دخول المنطقة المحيطة بالمسجد أو من دخول المسجد نفسه، ويمنع من دخول المنطقة المحيطة بالمسجد أو من دخول المسجد نفسه، ويمنع من دخول المنطقة المحيطة بالمسجد أو من دخول المسجد نفسه.
	يُمنع من دخول المنطقة المحيطة بالمسجد أو من دخول المسجد نفسه، ويمنع من دخول المنطقة المحيطة بالمسجد أو من دخول المسجد نفسه، ويمنع من دخول المنطقة المحيطة بالمسجد أو من دخول المسجد نفسه.
	يُمنع من دخول المنطقة المحيطة بالمسجد أو من دخول المسجد نفسه، ويمنع من دخول المنطقة المحيطة بالمسجد أو من دخول المسجد نفسه، ويمنع من دخول المنطقة المحيطة بالمسجد أو من دخول المسجد نفسه.
	يُمنع من دخول المنطقة المحيطة بالمسجد أو من دخول المسجد نفسه، ويمنع من دخول المنطقة المحيطة بالمسجد أو من دخول المسجد نفسه، ويمنع من دخول المنطقة المحيطة بالمسجد أو من دخول المسجد نفسه.

[illegible]

מִתְחַלֵּץ מִתְחַלֵּץ לְאֶבְרָהָם וְלִיִּצְחָק וְלִיִּשְׂרָאֵל וְלִיִּשְׂרָאֵל

[illegible][illegible][illegible]

- الضمان الاجتماعي - الأيتام
- الخدماء - الأيتام

יֵשׁוּעַ אֶלְעָזָר וְיֵשׁוּעַ אֶלְעָזָר וְיֵשׁוּעַ אֶלְעָזָר

(100) (المجموعة) CSBS-52/80/120 الطرازات
(100) (المجموعة) CSBI-52/80/120 و

יְהִירָחַם יִתְּיָה אֶצְלוֹ שׁוֹמֵן יִהְיֶה

יְהוֹשֻׁעַ וְיִשְׁרָאֵל



state

WATER HEATERS

500 Tennessee Waltz Parkway
Ashland City, TN 37015