



Instruction Sheet

ZVC404-EXP Zone Valve Control


102-109

SUPERSEDES: October 23, 2000

EFFECTIVE: March 1, 2006

Plant ID# 9300-1068

Wiring Diagram

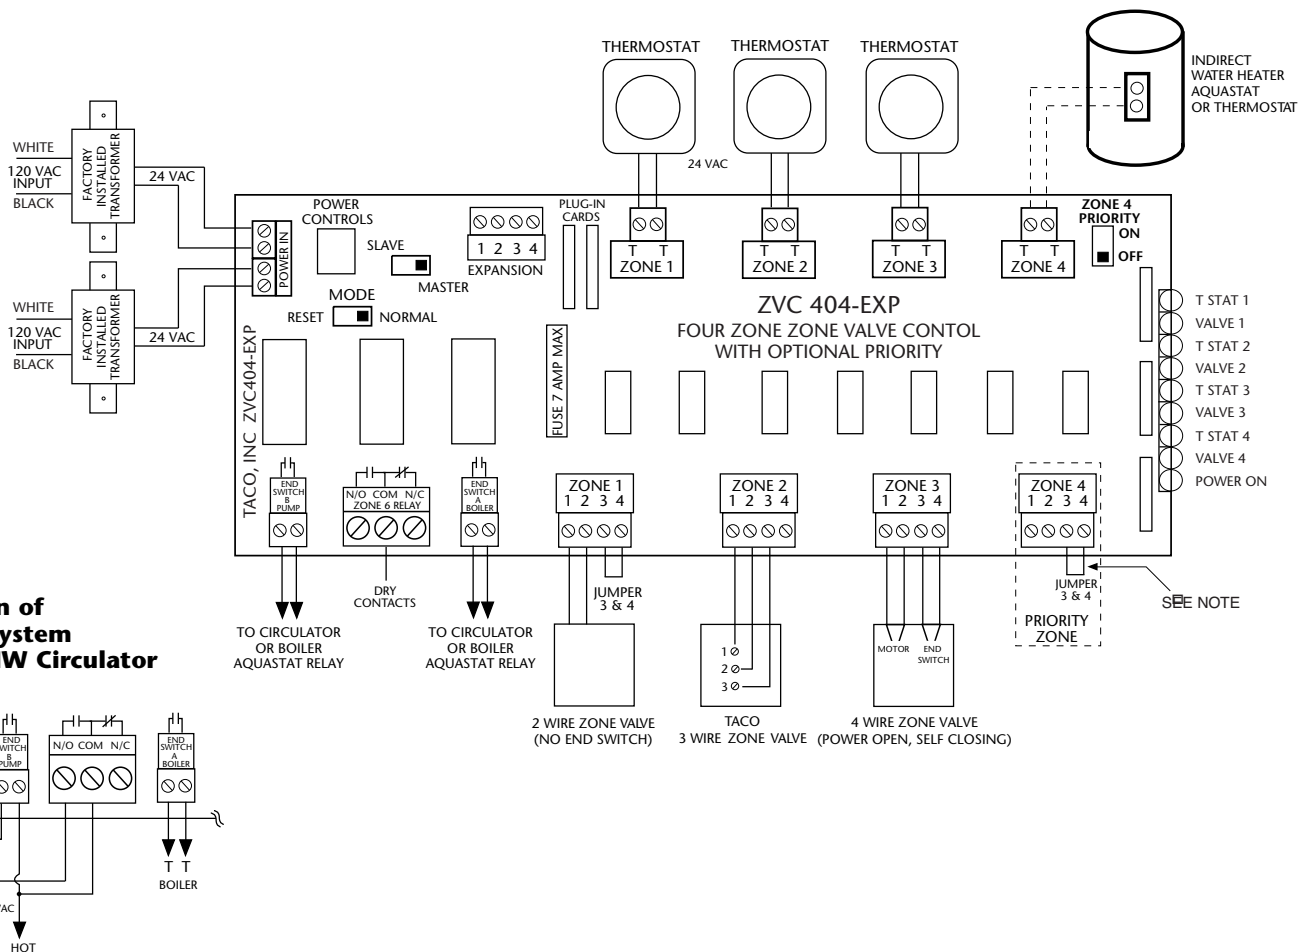

Operation/External Diagnostics: When any thermostat calls for heat, the appropriate zone valve is energized and the yellow light goes on. When the zone valve is fully open, the red light goes on and energizes the end switch relays. The green light should always be on, indicating that power is connected.

Priority Operation: When zone 4 is switched to the priority setting and is actuated, all other zones will stop operation until zone 4 is satisfied. When zone 4 is not switched to priority, all zones will operate independently. **Note:** When a circulator is used on the priority zone instead of a zone valve, jumper 3 and 4 of the priority zone.

Mode Operation: When the mode switch is set to NORMAL, both end switch relays will be energized if any zone is in operation. When the mode switch is set to RESET, the end switch relay "A" will only be energized when the priority zone is in operation. The end switch relay "B" will be energized when any zone is in operation.

Power Input: Connect 120 volt ac power input to leads on transformer. Neutral to white wire. Hot to black wire.

Expansion Connections: Set the expansion switch to MASTER on the zone valve control that has the designated priority zone or is utilizing the PowerPort options. Set all other daisy chained controls to SLAVE. Connect thermostat wire (18-22 gauge) between terminals 1, 2, 3, 4 on the master control to the corresponding 1, 2, 3, 4 on the SLAVE control(s). Controls may be daisy chained up to 20 zones using any combination of Switching Relay -EXP or Zone Valve -EXP controls.

The Taco Connection: Combine the reliability of the Taco Zone Valves, Priority Zoning Circulators, Thermostats, and the "00" family of circulators with the advanced features of the Taco Zone Controls to achieve total system integration. No matter the application, Taco now provides the products to maximize system performance while simplifying both installation and service.

Specifications:

PRODUCT NUMBER	NUMBER OF ZONES	TRANSFORMER VOLTAGE	MAX OUTPUT AT 24 VAC	DIMENSIONS OF ENCLOSURE WIDTH	HEIGHT	DEPTH
ZVC404-EXP	4 with Priority	120 VAC Input	80 VA	11 $\frac{3}{4}$ "	7 $\frac{1}{2}$ "	3"

All Zone Valve Controls are relay type DPDT and have a single phase motor rating per zone of $\frac{1}{6}$ hp (5A) @ 120 VAC.

Features:

External Indicator Lights
Plug-In PowerPort Cards
Switchable Priority
Simplified Wiring
Add-On Power Controls
Works with 2, 3, or 4-Wire
Zone Valves
Compact Design
Fuse Protected
100% Factory Tested

Isolated End Switch
Expandable to 20 Zones
Extra Set of Dry Contacts
Contractor Friendly PC
Board Layout
Universal Thermostat
Compatibility
Sturdy Screw Connections
Extended 3 Year Warranty
Made in the USA

Warning: Wiring connections must be made in accordance with all applicable electrical codes. Use copper wire only with a minimum temperature rating of 60/75°C. Failure to follow this instruction can result in personal injury or death and/or property damage. 12-18 gauge wire recommended for 120 VAC connections, 14-22 gauge wire for thermostat connections, and 14-22 gauge wire for 24 VAC source connections.

Note: When a circulator is used on the priority zone instead of a zone valve, jumper 3 and 4 of the priority zone.



This warranty gives the purchaser specific rights, and the purchaser may have other rights which vary from state to state. Some states do not allow limitations on how long an implied warranty lasts or on the exclusion of incidental or consequential damages, so these limitations or exclusions may not apply to you.

TACO, Inc.