

Vertical Air Handler Unit



For cooling, the unit is designed for R-410A refrigerant (both A/C and Heat Pump) or a chilled water coil. For heating, the unit offers an optional hot water coil or you may use an electric heater (WON 0502 or WON 0752).

Cabinet Construction

The cabinet is fully insulated with 1” closed cell rubber insulation. The cabinet is constructed of 22 gauge (0.7-mm) galvanized steel with removable access panels on the front for ease of service. See dimensional drawing.


Features and Controls

The following table shows a comparison of the various features.

Table 1. Feature Summary and Comparison

Control Box Configuration	EC
Balanced wheels	✓
Direct drive motor	✓
Shaft key connection	✓
Control voltage transformer	✓
Screw terminal connections	✓
Heat pump AFS bypass	✓
Adjustable low airflow mode	✓
Number of modes of operation	6
Requires restrictor plate to adjust air flow	NO
Programmed constant air flow	✓
Heating (boiler) relay	✓
Cooling (chiller) relay	✓
Efficient ventilation mode	✓
ASHRAE 62.2 compliance mode	✓
Point-to-point wiring	✓
Electric heater fan interlock	✓
Electric heater stage 3 lockout protection	✓
EAC, HRV, or ERV relay	✓
Potable water circulation	✓
Humidifier compatibility	✓
Soft-start and soft-stop	✓
Low airflow indicator	✓
Preset customizable airflow settings	✓
Built-in airflow diagnostics	✓
Optimized for zone damper systems	✓

Model Number Key

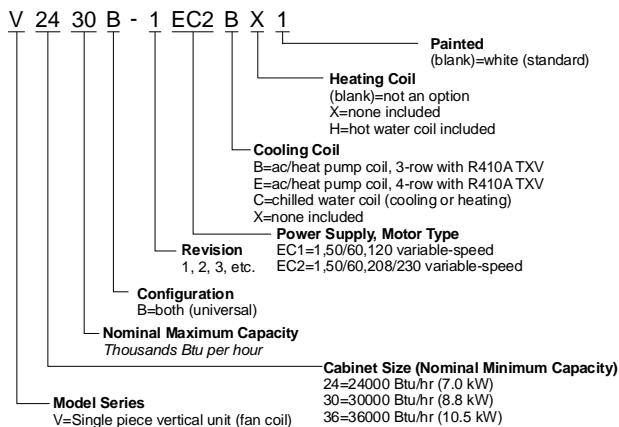

Applications

The Unico System is a complete indoor comfort system that includes an indoor fan coil unit and small duct system. The fan coil unit and duct system were designed to operate together to provide the proper airflow in every installation. The conditioned air is supplied through a series of two-inch diameter ducts as a stream of air that entrains and mixes with the room air. This process of aspiration produces a more even temperature distribution in the room than a conventional system.

The Unico vertical air handler Unit is a single packaged unit in a vertical-upflow configuration.



CERTIFIED TO UL STD 1995
CONFORMS TO CAN/CSA STD
C22.2 NO. 236

Screw terminal connections – terminal blocks with large screws and wire washers to securely connect the control wires.

Heat pump AFS bypass – removes the anti-frost switch (AFS) from the circuit during heat pump heating mode which eliminates nuisance shutdowns during defrost mode.

Boiler relay – The SCB includes a separate dry-contact relay that can be used to turn on the boiler, boiler pump, or hot water coil valve.

Modes of operation –The EC control board has 6 modes (Fan-Only, Low-Cool, High-Cool, Low-Heat, High-Heat, and Emergency-Heat).

Adjustable low airflow mode–The EC board allows the user to program the airflow for each mode.

Point-to-point wiring – The control boards have separate terminals for the thermostat, electric heater, outdoor condenser, and other options for easy wiring and troubleshooting.

Electric heater fan interlock – This is a safety feature that prevents the heater from energizing when there is low or no airflow. This prevents the heating elements from overheating, which can severely reduce their useful life.

Electric heater stage 3 lockout – The control board includes a lockout feature to prevent the third stage of the electric heater from turning on if the heat pump is also on. This prevents nuisance shutdowns from overheating the electric heater.

Chilled water relay – The control box includes a separate dry-contact relay (ColdW) to turn on a chiller or zone pump.

Fan cycling – The control board includes a separate switch to provide periodic cycling of the fan to reduce the chance for water to collect in the ducts if located in a cold space and not used, or to provide periodic fresh air if connected to a fresh air source.

ASHRAE 62.2 Compliant – The ECMconfig software allows the user to specify the required fresh air and percentage being brought in. The control board will monitor and maintain the proper fresh air inventory in compliance with ASHRAE 62.2.

EAC, ERV, or HRV relay – For the optimum in indoor air quality, the control board includes a dry-contact relay to turn on an electronic air cleaner, energy recovery ventilator, or heat recovery ventilator any time the fan is on.

Potable water circulation – For improved health safety, the control board provides a switch-selectable feature to turn on the boiler pump periodically (if installed as part of a domestic water system) to prevent the formation of stagnant water.

Humidifier compatibility – The control board includes the ability to connect a humidistat and a humidifier so that the humidistat turns on the humidifier when needed. The user may choose whether the fan with humidifier operates at high or low HEAT airflow setting.

Soft-start and soft-stop For quieter operation, the unit will slowly ramp the motor from stop to full speed, and vice versa.

Constant airflow – The EC control will deliver the airflow requested without any user adjustments to the duct system, or requiring the user to measure the amperage.

Low airflow indicator – The S.M.A.R.T. control board (SCB) includes an indicator light that signals the user if the desired airflow is not being met. This is usually caused by a restrictive duct system or too few outlets.

Pre-set air flow rate – The SCB is pre-programmed for two different air flow rates for HIGH-COOL that can be selected with a board mounted switch. Each of the six different modes are a fixed percentage of this airflow.


Laptop adjustable – The airflow for each mode of operation is adjustable to any value between the blower minimum and maximum using the ECMconfig software (available for download at www.unicosystem.com) and an ordinary USB cable.

Laptop troubleshooting – The ECMconfig software will also provide the user with feedback indicating the actual airflow, motor speed, communications between the boards and the motor, and the state of various inputs and outputs.

Optimized for zoning with hydronic systems – The ECMconfig software provides an additional feature that allows the user to specify the maximum motor speed so that the motor does not over speed when zone dampers are closed. This prevents the need for bypass loops and pressure switch controls and reduces noise at the outlets caused by the blower trying to maintain a constant airflow with fewer outlets. Setting a maximum airflow to approximate constant static pressure should not be used with a single speed condensing unit. Refer to the Unico Tech Bulletin on zoning for more information.

Optimized for efficiency and sound – The EC control will use the lowest motor speed to achieve the required airflow, which minimizes sound and maximizes electrical efficiency.

Dimensional Data

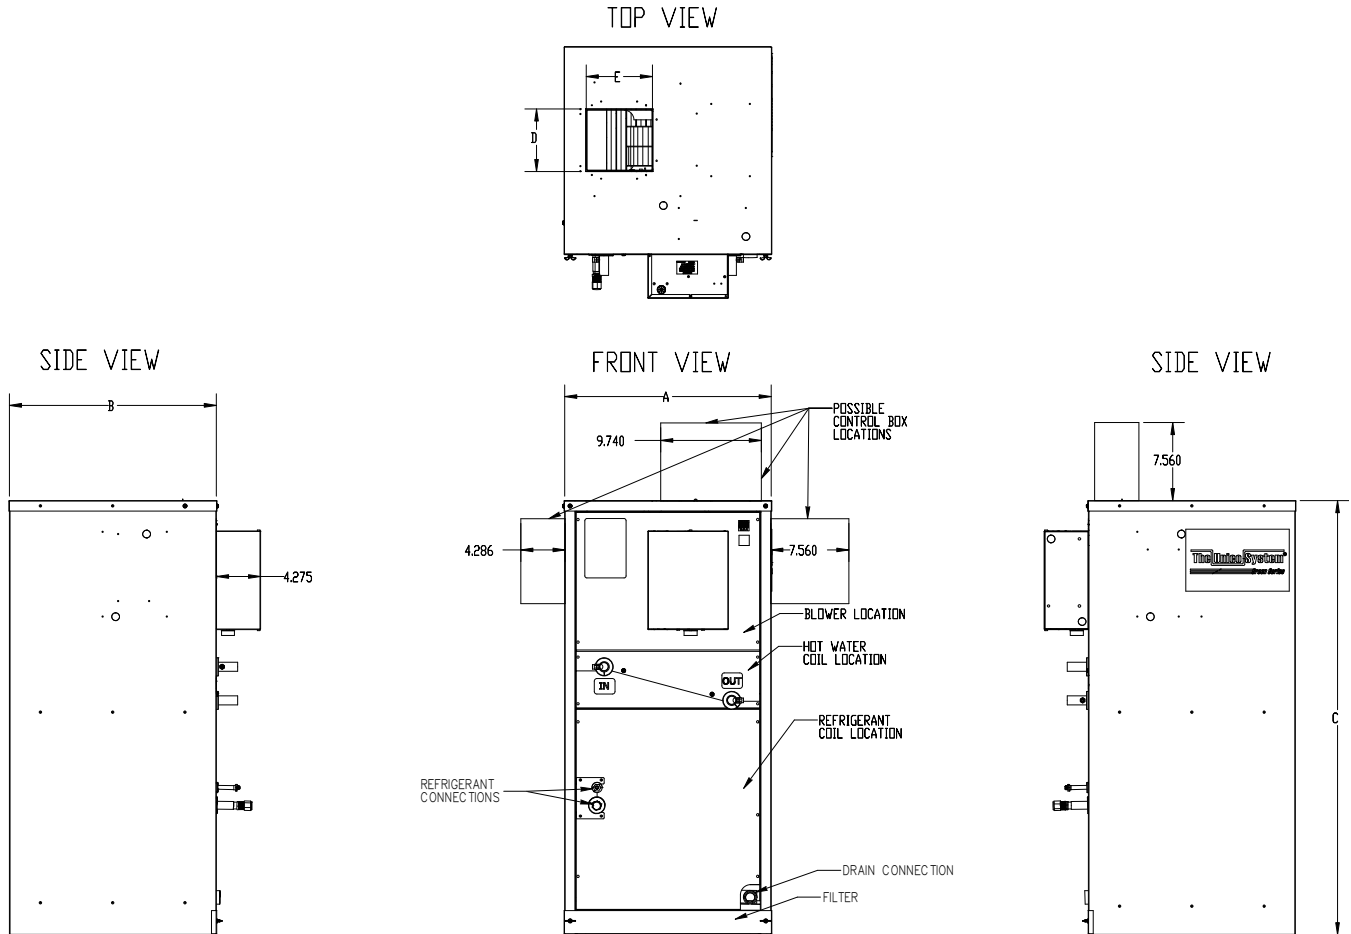

110546.cvx

All dimensions in inches [mm]

Note: The control box and expansion valve ships inside the unit.

Model	A		B		C		D		E	
V2430	20.0	[508]	20.0	[508]	42.0	[1067]	6.0	[152]	6.4	[162]
V3036	20.0	[508]	24.0	[610]	42.0	[1067]	7.1	[179]	6.3	[160]
V3642	23.75	[603]	25.0	[635]	44.0	[1118]	7.16	[182]	6.4	[162]

Weights

Model No.		V2430B-1EC*BX	V2430B-1EC2EX	V3036B-1EC*BX	V3036B-1EC*EX	V3642B-1EC*BX	V3642B-1EC*EX
Weight., lbs. [kg]	Net	117 [53]	109 [50]	138 [63]	129 [59]	151 [68]	163 [74]
	Ship	177 [80]	169 [77]	200 [91]	191 [87]	215 [98]	227 [103]
Shipping Dimensions Inch [mm]	W	27.2 [692]	27.2 [692]	27.2 [692]	27.2 [692]	31.2 [793]	31.2 [793]
	D	21.6 [549]	21.6 [549]	24.6 [625]	24.6 [625]	25.6 [651]	25.6 [651]
	H	44.3 [1125]	44.3 [1125]	44.3 [1125]	44.3 [1125]	46.3 [1176]	46.3 [1176]

Blower and Motor Specifications

Model No.	V2430B-1EC1	V3036B*-1EC1	V3642B-1EC1	V2430B-1EC2*	V3036B*-1EC2	V3642B-1EC2*
Electrical Power Phase, Hz, Volts	1, 50/60, 120-230			1, 50/60, 208-230		
Nominal Motor Size hp (kW)	1/2 (0.37)	1 (0.75)		1/2 (0.37)	1 (0.75)	
Motor Type	EC (variable speed)					
Minimum Circuit Ampacity amps	7.0	12.8		4.0	7.7	
Max. Over Current Protection amps	15	20		15	15	
Motor Full Load Current amps	5.6	10.5		3.2	6.1	
Motor Speed RPM	400 – 1800					
Blower Wheel Nom. Diameter in., (mm)	9.5 (241)					
Blower Wheel Width in., (mm)	3.75 (95)	5.0 (127)	5.0 (127)	3.75 (95)	5.0 (127)	5.0 (127)
Nominal Air Flow Rate* CFM, (L/s)	600 (283)	750 (354)	900 (425)	600 (283)	750 (354)	900 (425)
Plenum Static Pressure* in. w.c., (kPa)	1.5 (0.373)	1.5(0.373)	1.5 (0.373)	1.5 (0.373)	1.5(0.373)	1.5 (0.373)
Minimum Plenum Size, ID in., (mm)	7 (178)	9 (229)	9 (229)	7 (178)	9 (229)	9 (229)
Sound Pressure Level	dB(A)	56	56	56	56	56
	NC	50	47	47	50	47

* Based on full open restrictor and minimum plenum size at 230V.

Refrigerant Coil Specifications

System Type*	AC and Heat Pump			Heat Pump		
Model No.	V2430B-1EC*B	V3036B-1EC*B	V3642B-1EC*B	V2430B-1EC*E	V3036B-1EC*E	V3642B-1EC*E
Part No.	A01948-G01	A01951-G01	A01958-G01	A10914-G01	A01950-G01	A01957-G01
Compatible Condenser Size, ton (kW)	2.0-2.5 (7.0–8.8)	2.5-3.0 (8.8-10.5)	3.0-3.5 (10.5–12.3)	2.0-2.5 (7.0–8.8)	2.5-3.0 (8.8-10.5)	3.0-3.5 (10.5–12.3)
Net Face Area, ft ² (m ²)	2.72 (0.25)	3.50 (0.33)	4.75 (0.44)	2.72 (0.25)	3.50 (0.33)	4.75 (0.44)
Tube diameter, in. (mm)	3/8 (9.52)	3/8 (9.52)	3/8 (9.52)	3/8 (9.52)	3/8 (9.52)	3/8 (9.52)
Fin Density, fins/in. (fins/m)	15 (590)	15 (590)	15 (590)	14 (551)	14 (551)	14 (551)
Number of rows	3	3	3	4	4	4
Number of circuits	4	6	6	6	6	8
Design Pressure, psig (MPa)	500 (3.5)	500 (3.5)	500 (3.5)	500 (3.5)	500 (3.5)	500 (3.5)
Refrigerant Type**	R-22, R-407C, R-410A					
Expansion Device	TXV with internal Check Valve (shipped loose)					
TX Valve Part No.	R-22/R-407C	A00808-002	A00808-004	A00808-004	A00808-002	A00808-004
	R-410A	A00808-013	A00808-014	A00808-014	A00808-013	A00808-014
Suction line	O.D., inch (mm)	5/8 (15.88)	3/4 (19.05)	3/4 (19.05)	5/8 (15.88)	3/4 (19.05)
	Connection, in.	1/2 Male Flare	5/8 Male Flare	3/4 Male Flare	1/2 Male Flare	5/8 Male Flare
Liquid Line	Part No.	A01910-001	A01952-001	A01959-001	A01910-001	A01952-001
	O.D. inch (mm)	3/8 (9.52)	3/8 (9.52)	3/8 (9.52)	3/8 (9.52)	3/8 (9.52)
	Connection, in.	1/4 Male Flare	3/8 Male Flare	3/8 Male Flare	1/4 Male Flare	3/8 Male Flare
Condensate	Connection, in.	3/4 FPT	3/4 FPT	3/4 FPT	3/4 FPT	3/4 FPT

* Heat pump coil selection depends on outdoor unit model. Refer to AHRI directory for proper match.

** Unit ships with R410-A expansion valve. For R-22 and R-407C, order valve separately.

Hot Water Coil Specifications

Model	V2430	V3036	V3642
HWC model	HW-V2430	HW-V3036	HW-V3642
No. Rows	4		
Tube diameter	1/2 [12.7]		
Tube material	Cu		
Fin density	10 [0.40]		
Fin material	Al		
Face Area	199 [0.128]	259 [0.167]	342 [0.221]
No. Circuits	3		
Connections, ODF	7/8 [22.2]		
Weight	Net	Lbs. [kg]	8 [3.6]
	Ship	Lbs. [kg]	12 [5.4]
Dimensions	W	inch [mm]	28.25 [718]
	D	inch [mm]	18.75 [476]
	H	inch [mm]	7.75 [197]

Hot Water Coil Performance

V2430		Airflow, SCFM (m³/h)						Water Pressure Drop	
Entering Water Temp	Water Flow Rate	400 (680)		500 (850)		600 (1020)			
		°F (°C)	GPM (L/s)	Total Capacity					
		MBH (kW)	MBH (kW)	MBH (kW)	MBH (kW)	MBH (kW)	ft. w.c.	(kPa)	
100 (38)	2 (0.13)	8.50 (2.48)	9.70 (2.84)	10.7 (3.13)			0.47	(1.40)	
	4 (0.25)	9.40 (2.74)	10.9 (3.21)	12.4 (3.62)			1.60	(4.78)	
	6 (0.38)	9.70 (2.83)	11.4 (3.34)	13.0 (3.81)			3.29	(9.83)	
120 (49)	2 (0.13)	14.3 (4.18)	16.3 (4.78)	18.0 (5.28)			0.47	(1.40)	
	4 (0.25)	15.7 (4.59)	18.4 (5.38)	20.7 (6.08)			1.60	(4.78)	
	6 (0.38)	16.2 (4.74)	19.1 (5.60)	21.8 (6.38)			3.29	(9.83)	
140 (60)	2 (0.13)	20.1 (5.89)	23.0 (6.74)	25.4 (7.46)			0.47	(1.40)	
	4 (0.25)	22.0 (6.46)	25.8 (7.57)	29.2 (8.56)			1.60	(4.78)	
	6 (0.38)	22.7 (6.65)	26.9 (7.87)	30.6 (8.97)			3.29	(9.83)	
160 (71)	2 (0.13)	26.0 (7.62)	29.8 (8.73)	33.0 (9.66)			0.47	(1.40)	
	4 (0.25)	28.4 (8.33)	33.4 (9.78)	37.8 (11.1)			1.60	(4.78)	
	6 (0.38)	29.3 (8.58)	34.7 (10.2)	39.5 (11.6)			3.29	(9.83)	
180 (82)	2 (0.13)	31.9 (9.36)	36.6 (10.7)	40.6 (11.9)			0.47	(1.40)	
	4 (0.25)	34.9 (10.2)	40.9 (12.0)	46.3 (13.6)			1.60	(4.78)	
	6 (0.38)	35.9 (10.5)	42.5 (12.4)	48.5 (14.2)			3.29	(9.83)	
Recommended No. of Outlets		12		15		18			

Capacities are based on 70°F (21°C) return air temperature (T_{in})

Conversion Factors: MBH = 1000 Btu/hr, 1 kW = 3413 Btu/hr

V3036		Airflow, SCFM (m³/h)						Water Pressure Drop	
Entering Water Temp	Water Flow Rate	450 (760)		625 (1060)		750 (1270)			
		°F (°C)	GPM (L/s)	Total Capacity					
		MBH (kW)	MBH (kW)	MBH (kW)	MBH (kW)	MBH (kW)	ft. w.c.	(kPa)	
100 (38)	2 (0.13)	9.80 (2.86)	11.8 (3.46)	12.9 (3.77)	13.9 (3.79)		0.56	(1.7)	
	4 (0.25)	10.8 (4.07)	13.6 (3.16)	15.3 (3.98)	16.8 (4.45)		1.90	(5.7)	
	6 (0.38)	11.1 (4.48)	14.3 (4.92)	16.2 (3.26)	17.9 (4.18)		3.89	(11.6)	
	8 (0.50)	11.3 (4.70)	14.6 (4.75)	16.7 (5.26)	18.6 (3.32)		6.48	(19.4)	
120 (49)	2 (0.13)	16.4 (4.80)	19.9 (5.82)	21.8 (6.35)	23.4 (6.39)		0.56	(1.7)	
	4 (0.25)	18.1 (6.86)	22.8 (5.29)	25.7 (6.68)	28.2 (7.46)		1.90	(5.7)	
	6 (0.38)	18.6 (7.52)	23.9 (8.27)	27.1 (5.46)	30.1 (6.99)		3.89	(11.6)	
	8 (0.50)	18.9 (7.88)	24.4 (7.95)	27.9 (8.82)	31.1 (5.54)		6.48	(19.4)	
140 (60)	2 (0.13)	23.1 (6.76)	28.0 (8.21)	30.8 (8.98)	33.1 (9.02)		0.56	(1.7)	
	4 (0.25)	25.4 (9.69)	32.1 (7.43)	36.2 (9.40)	39.8 (10.5)		1.90	(5.7)	
	6 (0.38)	26.1 (10.6)	33.5 (11.6)	38.2 (7.66)	42.3 (9.83)		3.89	(11.6)	
	8 (0.50)	26.5 (11.1)	34.3 (11.2)	39.2 (12.4)	43.7 (7.77)		6.48	(19.4)	
160 (71)	2 (0.13)	29.8 (8.74)	36.3 (10.6)	39.8 (11.6)	42.8 (11.7)		0.56	(1.7)	
	4 (0.25)	32.7 (12.6)	41.4 (9.59)	46.7 (12.1)	51.4 (13.6)		1.90	(5.7)	
	6 (0.38)	33.7 (13.7)	43.3 (15.1)	49.2 (9.87)	54.6 (12.7)		3.89	(11.6)	
	8 (0.50)	34.2 (14.3)	44.2 (14.4)	50.5 (16.0)	56.3 (10.0)		6.48	(19.4)	
180 (82)	2 (0.13)	36.6 (10.7)	44.5 (13.1)	49.0 (14.4)	52.7 (15.4)		0.56	(1.7)	
	4 (0.25)	40.1 (11.8)	50.8 (14.9)	57.3 (16.8)	63.1 (18.5)		1.90	(5.7)	
	6 (0.38)	41.3 (12.1)	53.0 (15.5)	60.4 (17.7)	67.0 (19.6)		3.89	(11.6)	
	8 (0.50)	41.8 (12.3)	54.1 (15.9)	61.9 (18.1)	69.1 (20.2)		6.48	(19.4)	
Recommended No. of Outlets		14		19		23		27	

Capacities are based on 70°F (21°C) return air temperature (T_{in})

Conversion Factors: MBH = 1000 Btu/hr, 1 kW = 3413 Btu/hr

Recommended number of outlets is based on 33 CFM (60 m³/h) per outlet for a quiet system.

V3642		Airflow, SCFM (m³/h)								Water Pressure Drop			
Entering Water Temp	Water Flow Rate	500	(850)	750	(1270)	875	(1490)	1000	(1700)				
		Total Capacity											
°F	(°C)	GPM	(L/s)	MBH	(kW)	MBH	(kW)	MBH	(kW)	MBH	(kW)	ft. w.c.	(kPa)
100	(38)	2	(0.13)	11.1	3.26	14.0	4.10	15.1	4.42	16.0	4.68	0.72	(2.2)
		4	(0.25)	12.3	3.61	16.4	4.81	18.1	5.31	19.7	5.76	2.47	(7.4)
		6	(0.38)	12.7	3.72	17.3	5.07	19.3	5.65	21.1	6.18	5.08	(15.2)
		8	(0.50)	12.9	3.78	17.7	5.20	19.9	5.82	21.8	6.40	8.45	(25.3)
		10	(0.63)	13.0	3.82	18.0	5.28	20.2	5.93	22.3	6.53	12.55	(37.5)
120	(49)	2	(0.13)	18.7	5.47	23.5	6.89	25.3	7.43	26.9	7.88	0.72	(2.2)
		4	(0.25)	20.6	6.04	27.5	8.06	30.4	8.91	33.0	9.66	2.47	(7.4)
		6	(0.38)	21.2	6.22	28.9	8.48	32.3	9.46	35.3	10.35	5.08	(15.2)
		8	(0.50)	21.6	6.31	29.7	8.69	33.2	9.74	36.5	10.70	8.45	(25.3)
		10	(0.63)	21.7	6.37	30.1	8.82	33.8	9.91	37.3	10.92	12.55	(37.5)
140	(60)	2	(0.13)	26.2	7.69	33.2	9.71	35.7	10.47	37.9	11.10	0.72	(2.2)
		4	(0.25)	28.9	8.48	38.7	11.34	42.8	12.53	46.4	13.6	2.47	(7.4)
		6	(0.38)	29.8	8.73	40.7	11.91	45.4	13.29	49.6	14.55	5.08	(15.2)
		8	(0.50)	30.2	8.86	41.6	12.20	46.7	13.68	51.3	15.04	8.45	(25.3)
		10	(0.63)	30.5	8.93	42.2	12.38	47.5	13.91	52.3	15.34	12.55	(37.5)
160	(71)	2	(0.13)	33.9	9.93	42.8	12.55	46.2	13.53	49.0	14.36	0.72	(2.2)
		4	(0.25)	37.3	10.92	49.9	14.63	55.2	16.18	59.9	17.56	2.47	(7.4)
		6	(0.38)	38.4	11.25	52.4	15.36	58.5	17.14	64.0	18.77	5.08	(15.2)
		8	(0.50)	38.9	11.40	53.7	15.72	60.2	17.63	66.2	19.39	8.45	(25.3)
		10	(0.63)	39.2	11.50	54.4	15.94	61.2	17.92	67.5	19.77	12.55	(37.5)
180	(82)	2	(0.13)	41.6	12.17	52.6	15.40	56.7	16.61	60.1	17.62	0.72	(2.2)
		4	(0.25)	45.7	13.38	61.2	17.94	67.7	19.84	73.5	21.54	2.47	(7.4)
		6	(0.38)	47.0	13.76	64.2	18.81	71.7	21.00	78.5	23.00	5.08	(15.2)
		8	(0.50)	47.6	13.95	65.7	19.25	73.7	21.59	81.1	23.75	8.45	(25.3)
		10	(0.63)	48.0	14.06	66.6	19.51	74.9	21.94	82.6	24.21	12.55	(37.5)
Recommended No. of Outlets				15		23		27		30			

Capacities are based on 70°F (21°C) return air temperature (T_{in})
 Conversion Factors: MBH = 1000 Btu/hr, 1 kW = 3413 Btu/hr
 Recommended number of outlets is based on 33 CFM (60 m³/h) per outlet for a quiet system.

WARNING!
 To prevent injury or damage from high temperatures, do not install floor outlets when operating with discharge temperature above 160°F (71°C).

Caution
 To prevent damage to the EC motor from overheating, do not operate in the shaded region where discharge temperature is more 150 °F (65 °C).


Hot Water Coil Air Pressure Drop, in. w.c., (Pa)

Air Flow Rate		Hot Water Coil Model					
CFM	(m ³ /h)	HW-V2430		HW-V3036		HW-V3642	
400	(680)	0.11	(26)	0.08	(20)	-	
500	(850)	0.16	(39)	0.10	(25)	0.06	(15)
625	(1060)	0.23	(58)	0.15	(36)	0.09	(22)
750	(1270)	0.32	(80)	0.20	(50)	0.12	(31)
875	(1490)	-		0.27	(66)	0.16	(40)
1000	(1700)	-		0.34	(83)	0.21	(51)
1100	(1870)	-		-		0.24	(60)
1250	(2120)	-		-		-	


Note: Evaluated at 70°F db (21°C)

BLOWER PERFORMANCE


V2430BL-1EC

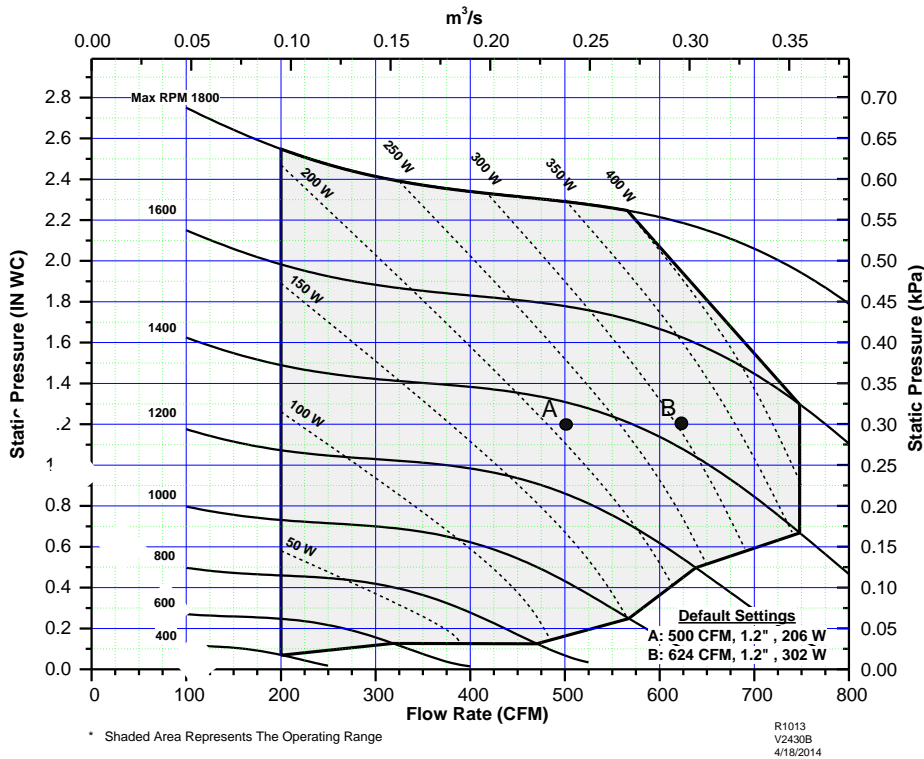

V3036BL-1EC

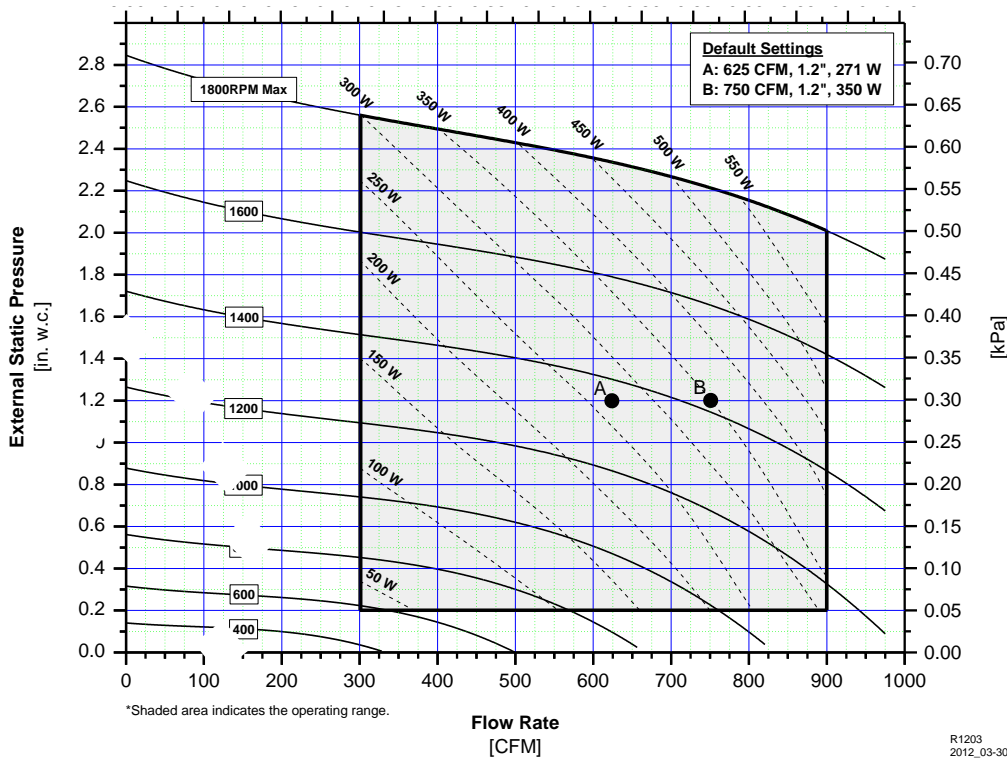

V3642BL-1EC

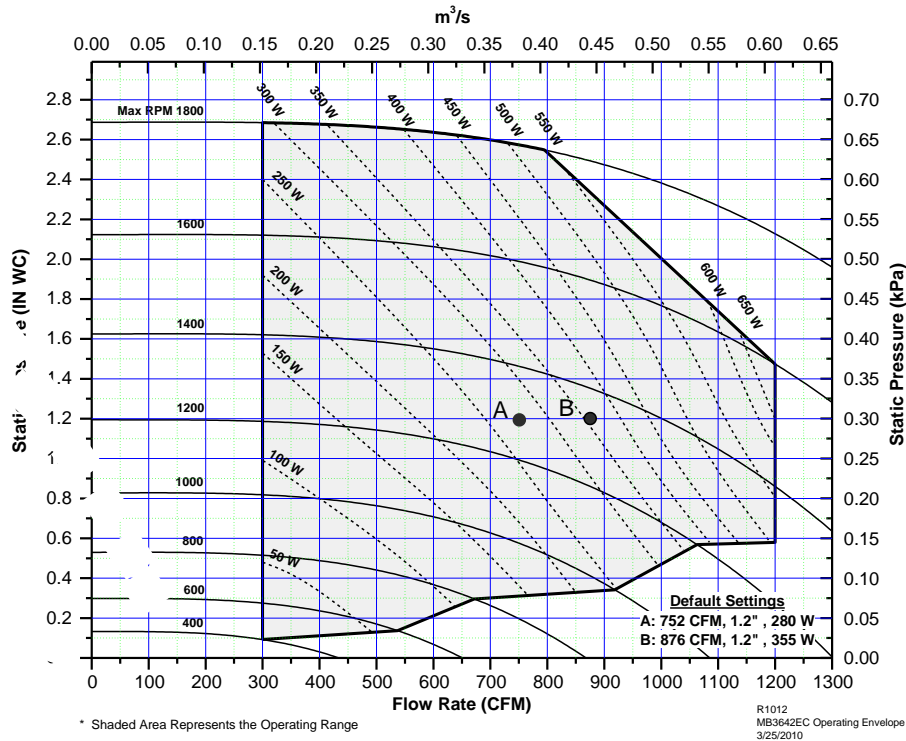

ACOUSTICAL DATA

Sound is always present and is important to comfort. Understanding how sound is defined is essential to understanding how to design a proper Unico System. Sound is defined as a physical disturbance in pressure that is detectable by the human ear. Sound is usually presented as Sound Pressure Level (SPL) in decibels (dB), but can also be presented as Sound Power Level (SWL). Sound pressure is what you hear so it is the only value that is important to the occupant. However, determining the value is difficult because it is dependent on the surroundings and distance from the sound source. For instance, a carpeted room is much quieter than a room with wood floors.

For the Unico System, it is also important to consider sound transmission losses through ceilings and walls. The blower is never placed in the occupied room so the sound is always less than the published value. This reduction in sound level depends on the construction of the ceiling or wall. For instance, a ceiling structure made of gypsum board with insulation above it will have a much greater sound transmission loss (TL) than a dropped ceiling without insulation.

The data shown in this catalog was measured in a large room with hard surfaces for the walls and floor. It is considered to be the worst case (i.e. loudest). The sound level in the occupied space will always be considerably less than this, depending on where the unit is located. To determine the actual sound level, subtract the TL for the barrier from the sound data of the unit. The table below shows typical TL values for common construction configurations. Subtract these values from the Unico air handler data.

Transmission Loss for Common Construction, dB

Frequency, Hz	125	250	500	1k	2k	4k	R
Sheet Metal, 24 GA	13	17	20	27	34	39	18
Ceiling Tile, mineral fiber	13	21	27	31	35	40	20
Gypsum Frame wall	12	23	31	38	42	37	20
Gypsum Frame wall, insul.	15	30	32	43	46	38	23
Wood Floor, uninsulated	22	28	37	43	46	43	25
Wood Floor, insulated	29	40	51	57	60	58	26
Concrete Block, 190-mm	38	41	43	50	55	61	26
Concrete, 100-mm (4 in.)	41	41	45	52	56	64	26

Ref: Handbook of Acoustical Measurements and Noise Control, 1998
 R = Overall Loss for typical Blower Module (based on MB4260H-50HZ)